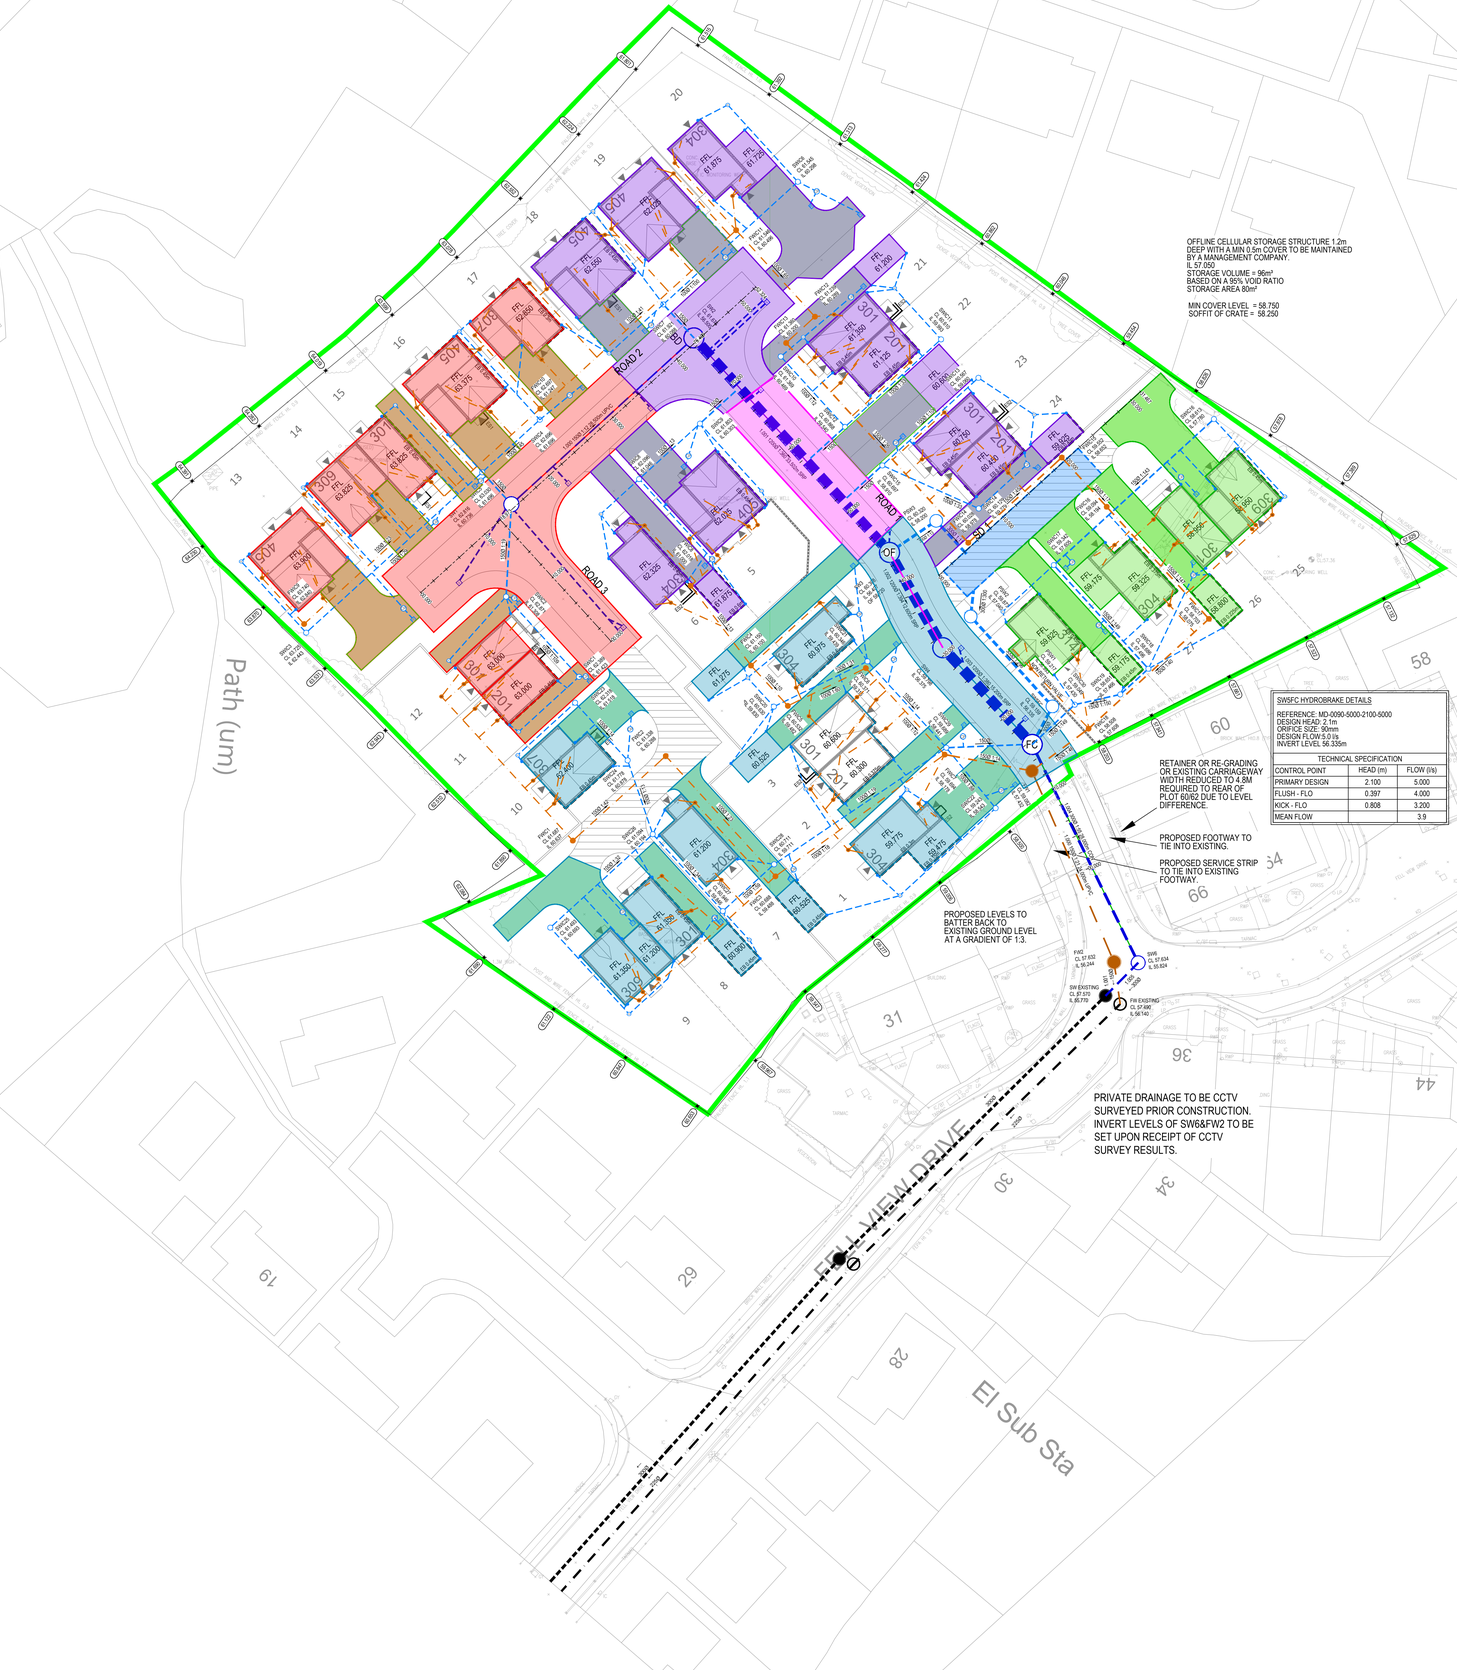

SWSFC HYDROBRAKE DETAILS

REFERENCE: MD-0090-5000-2100-5000
DESIGN HEAD: 2.1m
ORIFICE SIZE: 90mm
DESIGN FLOW:5.0 l/s
INVERT LEVEL 56.335m

TECHNICAL SPECIFICATION		
CONTROL POINT	HEAD (m)	FLOW (l/s)
PRIMARY DESIGN	2.100	5.000
FLUSH - FLO	0.397	4.000
KICK - FLO	0.808	3.200
MEAN FLOW		3.9

KEY

- SITE BOUNDARY
- EXISTING ADOPTED SURFACE WATER
- EXISTING ADOPTED FOUL WATER
- PROPOSED ADOPTED SURFACE WATER
- PROPOSED ADOPTED FOUL WATER
- FC — PROPOSED FLOW CONTROL
- OF — PROPOSED OVERFLOW
- PROPOSED CELLULAR STORAGE
- PROPOSED ADOPTED HIGHWAY GULLY
- PROPOSED PRIVATE SURFACE WATER
- PROPOSED PRIVATE SURFACE WATER MANHOLE
- PROPOSED PRIVATE SURFACE WATER PPC
- PROPOSED PRIVATE SW CATCHPIT BY POLYPIPE OR SIMILAR (600DIA@1M DEPTH)
- PROPOSED PRIVATE SW ACCESS CHAMBER (300Ø)
- PROPOSED RAINWATER PIPE
- PROPOSED PRIVATE PERMEABLE OUTLET
- PROPOSED PRIVATE FOUL WATER
- PROPOSED PRIVATE FOUL WATER PPC
- PROPOSED PRIVATE FW ACCESS CHAMBER (300Ø)
- PROPOSED SW/SFGI/SPIBG

DRAINAGE SPECIFICATIONS

1. ALL ADOPTABLE DRAINAGE WORKS AND MATERIALS TO BE IN ACCORDANCE WITH 'SEWERS FOR ADOPTION' 6TH EDITION, THE RELEVANT BRITISH/EUROPEAN AND YORKSHIRE WATER'S STANDARDS/REQUIREMENTS/ADDENDUM TO THE MECHANICAL AND ELECTRICAL SPECIFICATION AND KITEMARKED.
2. FILLED GROUND MUST BE FILLED AND CONSOLIDATED UNDER THE SUPERVISION AND TO THE SATISFACTION OF YORKSHIRE WATER BEFORE ANY SEWER WORKS ARE CARRIED OUT.
3. ALL ADOPTABLE SEWERS TO BE KITEMARKED CERTIFIED TO WIS 4-35-01 AND BS/EN14615.
4. PLASTIC CHANNEL SECTIONS IN MANHOLES ARE 'NOT' ACCEPTABLE AND THE WATER AUTHORITY PREFERS CLAY/PVC CHANNEL SECTIONS. PLASTIC CHANNELS ARE OFTEN CAST IN CONCRETE FROM SUCH PVC CHANNELS SATISFACTORILY. PLASTIC BENCHING IS NOT ACCEPTABLE BENCHING.
5. THE WATER AUTHORITY IS NOT OBLIGED TO ACCEPT FILTER DRAINS AND DRAINAGE RUN-OFF INTO THE PUBLIC SEWER NETWORK OR ADOPTABLE DRAINAGE SYSTEM DIRECTLY OR INDIRECTLY. AN ALTERNATIVE METHOD OF DISPOSAL OF THE LAND DRAINAGE RUN-OFF WILL THEREFORE BE REQUIRED AND YOU WILL HAVE TO LIAISE WITH THE LOCAL AUTHORITY, LAND DRAINAGE SECTION WITH REGARD TO THE DISPOSAL OF THE FILTER DRAIN/LAND DRAINAGE RUN-OFF.
6. SULPHATE RESISTANT CEMENT (GO/CO) AND PRECAST CONCRETE PRODUCTS MUST BE USED OR A LABORATORY REPORT PROVIDED PROVING THAT SUCH PRECAUTIONS ARE NOT NECESSARY.
7. THE ADOPTABLE SEWERS SHOULD BE A MINIMUM OF 1M AND MANHOLES 0.5M FROM KERB FACES AND SERVICE MARGINS.
8. 'SEWERS MUST HAVE 5 METRES CLEARANCE FROM TREES AND HEDGES (PLEASE ALSO REFER TO FIGURE 2.3 ON PAGE 33 IN "SEWERS FOR ADOPTION' 6TH EDITION FOR RESTRICTIONS ON TREE PLANTING ADJACENT TO SEWERS)'.
9. SEWERS TO BE LAID IN CLASS "S" BEDDING (150MM GRANULAR BED AND SURROUND). WHERE DEPTH OF COVER TO TOP OF THE SEWER IS LESS THAN 1.2M IN HIGHWAYS AND VERGES OR LESS THAN 900MM IN NONE VEHICULAR ACCESS AREAS THEN A CONCRETE SLAB SHOULD BE PROVIDE ABOVE GRANULAR BED AND SURROUND.
10. CLASS Z BEDDING DETAIL SHALL BE PROVIDED WHERE COVER TO THE PIPE BARREL IS LESS THAN 1.2M IN VEHICULAR TRAFFICKED AREAS AND 0.9M ELSEWHERE. TO ALL ROAD GULLY CONNECTIONS AND WITHIN AREAS OF DEEP ROOTING VEGETATION.
11. WHERE CLASS Z TRENCH BEDDING DETAIL IS USED, THE CONCRETE BED AND SURROUND SHALL BE DISCONTINUED AT EACH PIPE JOINT OVER THE FULL CROSS SECTION BY MEANS OF A SHAPED COMPRESSIBLE FILLER.
12. BEDDING AND BACKFILL MATERIAL TO CONFORM TO THE REQUIREMENT OF WATER INDUSTRY SPECIFICATION 4-08-02 (TABLE A2).
13. THE CHAMBER SIZE OF MANHOLES WITH MORE THAN ONE CONNECTION IN THEM MAY NEED TO BE INCREASED AN INCREMENT TO ACCOMMODATE THE CONNECTIONS AND BENDS.
14. ALL PRIVATE DRAINAGE WORKS SHALL BE CARRIED OUT IN ACCORDANCE WITH BUILDING REGULATIONS 2002 EDITION.
15. CONTRACTOR TO ESTABLISH POSITION SIZE AND DEPTH OF ALL EXISTING SEWERS AND SERVICES PRIOR TO COMMENCEMENT ON SITE.
16. THE CONTRACTOR SHALL ALLOW FOR THE PROTECTION, TEMPORARY AND PERMANENT SUPPORT. AND TEMPORARY AND PERMANENT DIVERSION WORKS, AS NECESSARY TO ALL EXISTING SERVICES.
17. THE CONTRACTOR SHALL ALLOW FOR ALL TRAFFIC MANAGEMENT IN CONNECTION WITH ROAD AND SEWER WORKS.
18. THE CONTRACTOR SHALL ALLOW FOR KEEPING SEWER TRENCHES AND EXCAVATIONS AS DRY AS PRACTICABLE BY PUMPING FROM TEMPORARY SUMPS AND DE-WATERING AS APPROPRIATE. THE POINT AND METHOD OF DISCHARGE TO BE AGREED WITH THE DRAINAGE AUTHORITY.
19. FOR PIPE SPECIFICATION PLEASE REFER TO ADDITIONAL NOTES.
20. VITRIFIED CLAY PIPES AND FITTINGS SHALL COMPLY WITH THE RELEVANT PROVISIONS OF BS EN295 AND BS 65 RESPECTIVELY AND BE KITEMARKED. ALL PIPES SHALL BE EXTRA STRENGTH TO BS 65 OR EQUIVALENT BS EN295 PIPE CRUSHING STRENGTH.
21. STRUCTURED WALL PLASTIC PIPES TO WIS 4-35-01 MAY BE USED FOR FOUL & SURFACE WATER DRAINAGE, SUBJECT TO ADOPTING AUTHORITY APPROVAL.
22. PRECAST CONCRETE PRODUCTS SHALL COMPLY WITH THE RELEVANT PROVISIONS OF BS 5911 AND BE KITEMARKED. CONCRETE PIPES TO BE CLASS 120 UNLESS NOTED OTHERWISE.
23. GULLY GRATES AND FRAMES SHALL COMPLY WITH THE RELEVANT PROVISIONS OF BS EN124 AND BE OF A NON-ROCKING DESIGN WITH CAPTIVE HINGE ACCESS AND BE KITEMARKED. LOAD CLASS D400 FOR ROADS AND C250 FOR FOOTPATHS AND PEDESTRIAN AREAS UNLESS NOTED OTHERWISE.
24. BACKFILLING AND REINSTATEMENT TO TRENCHES IN PUBLIC HIGHWAYS SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS AND SPECIFICATIONS OF THE ADOPTING AUTHORITY. OR, IN THE ABSENCE OF SUCH, IN ACCORDANCE WITH THE REQUIREMENTS OF "THE STREET WORKS REGULATIONS 1992" AND RELEVANT PROVISIONS OF H.A.U.C. "SPECIFICATION FOR THE REINSTATEMENT OF OPENINGS IN HIGHWAYS" JUNE 1992, BOTH UNDER SECTION 71 OF THE NEW ROADS AND STREET WORKS ACT 1991.
25. ALL TRADITIONAL RAINWATER PIPE DOWN COMERS TO DISCHARGE TO TRAPPED GULLIES.
26. ALL SIPHONIC DRAINAGE DOWN COMERS TO MANUFACTURER SPECIFICATION.
27. ALL ROOF GULLIES ARE TO BE TRAPPED GULLIES.
28. ALL GULLY LEADS TO BE 150mm DIAMETER.
29. ALL REDUNDANT EXISTING DRAINAGE TO BE GRUBBED UP OR GROUTED. ANY EXISTING LIVE DRAINAGE SHOULD BE REPORTED TO THE ENGINEER AND RECONNECTED.
30. ALL ROOF GULLIES & LEADS TO BE CLEARED OF DEBRIS UPON COMPLETION OF WORKS.
31. THE CONTRACTOR MUST ENSURE THAT ANY OF THE EXISTING DRAINAGE WHICH IS LIVE IS KEPT CLEAR OF DEBRIS AND SHOULD ALLOW FOR JETTING THROUGH THE NEW & EXISTING DRAINAGE UPON COMPLETION.
32. CONTRACTOR TO TAKE MEASURES TO PROTECT HIS OPERATIVES WITH RESPECT TO THE PRESENCE OF GAS IN EXISTING TRENCHES AND MANHOLES THROUGH THE USE OF GAS MONITORING EQUIPMENT AND BREATHING APPARATUS AS REQUIRED.
33. CONTRACTOR TO APPLY FOR SEWER PERMITS AND ROAD OPENING PERMITS AS NECESSARY FROM THE APPROPRIATE AUTHORITIES, PRIOR TO COMMENCING WORKS.
34. ADOPTABLE PLASTIC SEWER PIPES TO BE LAID IN MAXIMUM 3m LENGTHS UNLESS THERE IS A SPECIFIC OPERATIONAL NEED TO LAY LONGER LENGTHS.
35. WHERE PLASTIC PIPES ARE INSTALLED PRIOR TO GETTING APPROVAL THEN A LIGHT LINE CCTV SURVEY AND REPORT ARE REQUIRED PRIOR TO APPROVAL.

NETWORK IMPERMEABLE AREAS	
PIPE NODE	AREA (Ha)
1.000	0.082
1.001	0.079
1.002	0.019
1.003	0.097
1.004	0.000
1.005	
TOTAL	0.277

FOUL AREAS	
PIPE NODE	NO. OF PLOTS.
1.000	29
1.001	0
TOTAL	29.000

DRAINAGE NOTES:

1. ALL PIPES 1500 UNLESS OTHERWISE STATED.
2. ALL PRIVATE TO ADOPTABLE CONNECTIONS 1500 UNLESS OTHERWISE STATED.
3. ALL PPICS IN TRAFFICKED AREAS TO HAVE D400 COVERS & CONCRETE SURROUND.
4. ALL INTERNAL PLOT DRAINAGE REQUIRES CONFIRMATION PRIOR TO CONSTRUCTION.
5. CONTRACTOR TO CONFIRM MH COVER & INVERT LEVEL OF PROPOSED CONNECTION POINT PRIOR TO CONSTRUCTION. ANY VARIATION TO BE REPORTED TO ENGINEER.
6. CONTRACTOR TO VISIT SITE AND CHECK ALL EXISTING DRAINAGE PRIOR TO COMMENCEMENT OF ANY DRAINAGE WORKS. ANY DISCREPANCY MUST BE NOTIFIED TO THE ENGINEER.
7. EXISTING MANHOLES TO BE MODIFIED TO ACCOMMODATE THE PROPOSED LATERAL CONNECTIONS. CONTRACTOR TO APPLY TO THE WATER AUTHORITY FOR THE SECTION 106 APPROVAL, TO MAKE THE CONNECTIONS. PIPES ARE TO BE LAID WITH COMMON INVERT LEVELS.
8. ALL STUB PIPES ARE TO BE CAPPED.
9. ALL PIPES CONNECTIONS TO BE SOFFIT TO SOFFIT UNLESS STATED OTHERWISE. REFER TO MANHOLE SCHEDULE FOR FURTHER INFORMATION.
10. ALL PROPOSED FILTER DRAINS TO CONNECT BACK INTO PLOT DRAINAGE.
11. STONE FILLED LAND DRAINS REQUIRED IN BACK GARDENS WHERE FALLING TOWARDS PROPERTY

PIPE MATERIALS

- **150-225Ø: UPVC PIPES TO BE BSI KITEMARKED AND CERTIFIED TO WIS 4-33-01 & BS/EN13476.**
- **300-825Ø: CONCRETE PIPES TO BE BSI KITEMARKED, CLASS 120 CONCRETE & CERTIFIED TO BS3911 & 5195.**
- **900Ø-OWN/ADS: COMPOSITE STEEL REINFORCED PIPE (AQUASPIRA) TO BE BSI KITEMARKED & CERTIFIED TO BS/EN13476.**

SUBJECT TO LOCAL AUTHORITY & WATER AUTHORITY APPROVAL

Date	Revisions	Drawn	Checked	Rev
09/04/2020	AMENDED TO SUIT LEI COMMENTS.	KRS	AE	4
10/03/2020	REVISED TO SUIT LATEST LAYOUT.	AE	RWO	3
12/12/2019	SERVICE STRIP ADDED AND GULLY ANNOTATION AMENDED	KRS	RWO	2
21/05/2019	FIRST ISSUE	KS	AE	1

Dwg Status: INFORMATION

NORTH EAST 0191 2589532
YORKSHIRE 01748 900480
RWO CONSULTING ENGINEERS
WWW.RWOASSOCIATESUK.COM
INFO@RWOASSOCIATESUK.COM

Client: GLEESON HOMES

Project: FELL VIEW DRIVE, EGREMONT

Title: IMPERMEABLE AREA PLAN

DO NOT SCALE	Scale @ A0: 1:250	Drawn JG	Checked AE	Date 01/02/19
Job No 18184		Dwg No D202		Rev 4