


STRUCTURE


PROVIDE NOGGINS TO LATERAL RESTRAINT STRAPS TO ROOF TRUSSES.
MINIMUM SLATE LATH SIZE TO BE 50 x 25mm.
WALL TIES TO BE 225 ST. STL. RAWLTIES.

VENTILATION

VENTILATION AT EAVES TO BE 25mm CLEAR ALONG LENGTH OF EAVES.
VENTILATION AT RIDGE TO BE 5mm CLEAR ALONG LENGTH OF RIDGE.

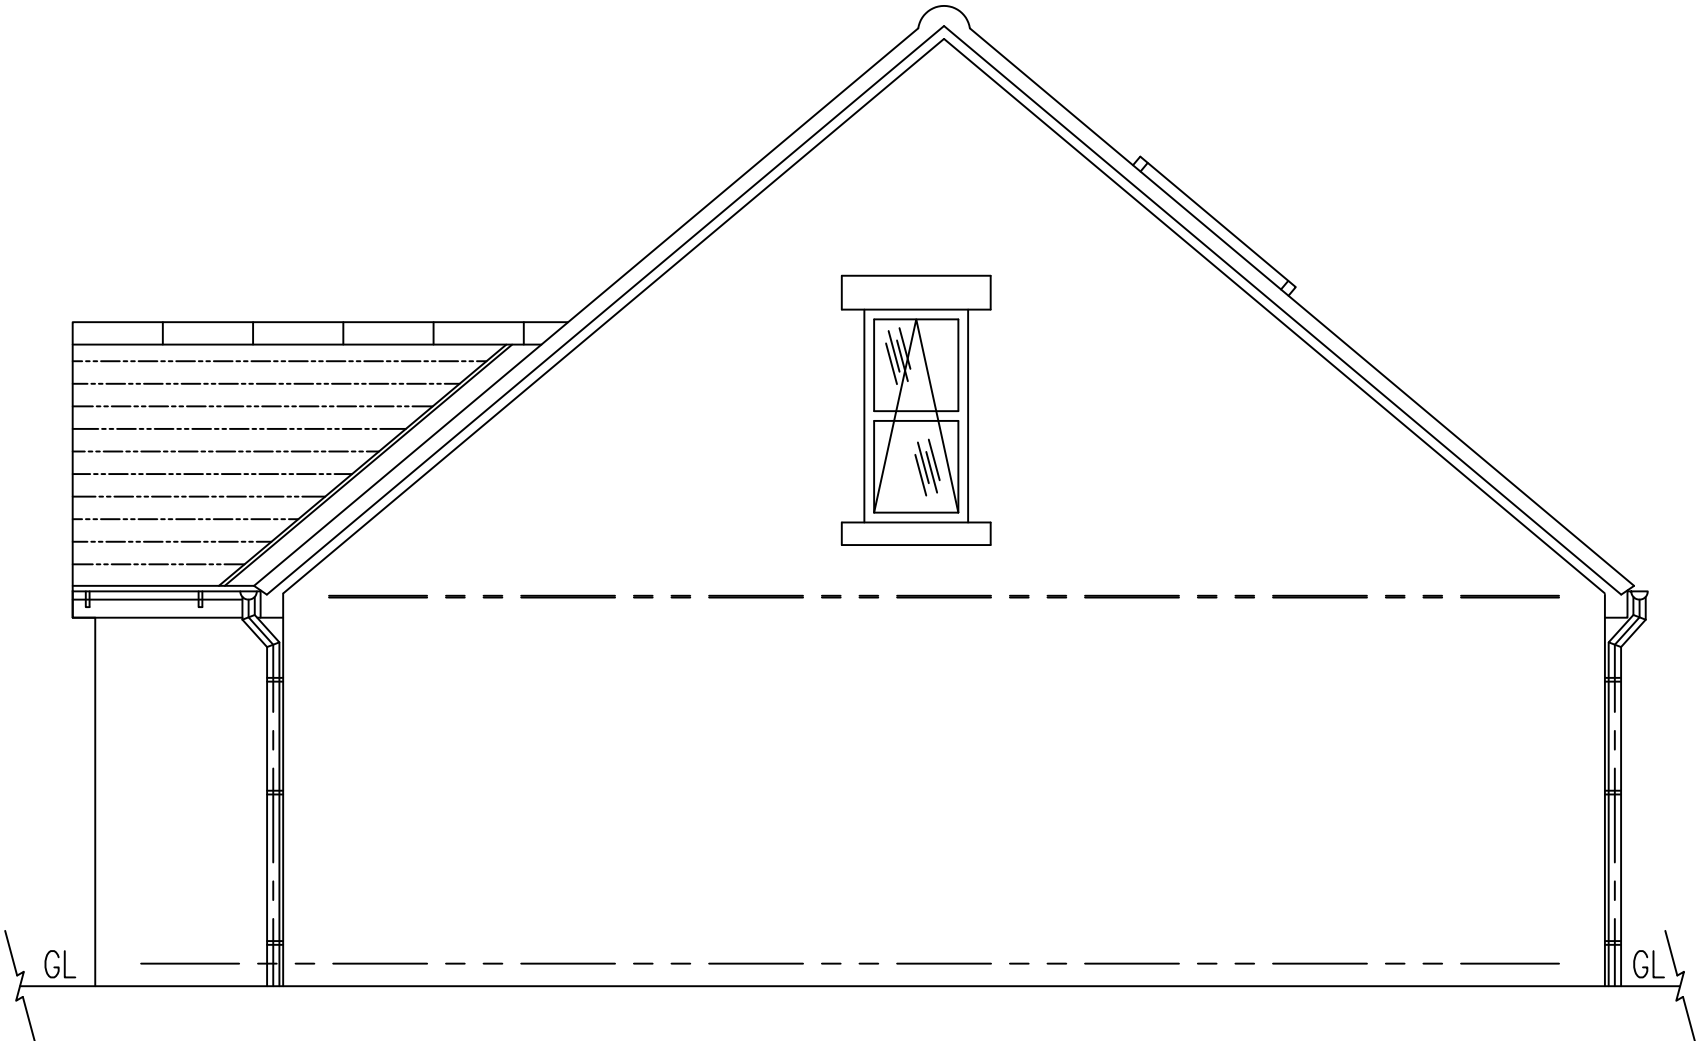

EXISTING WEST ELEVATION

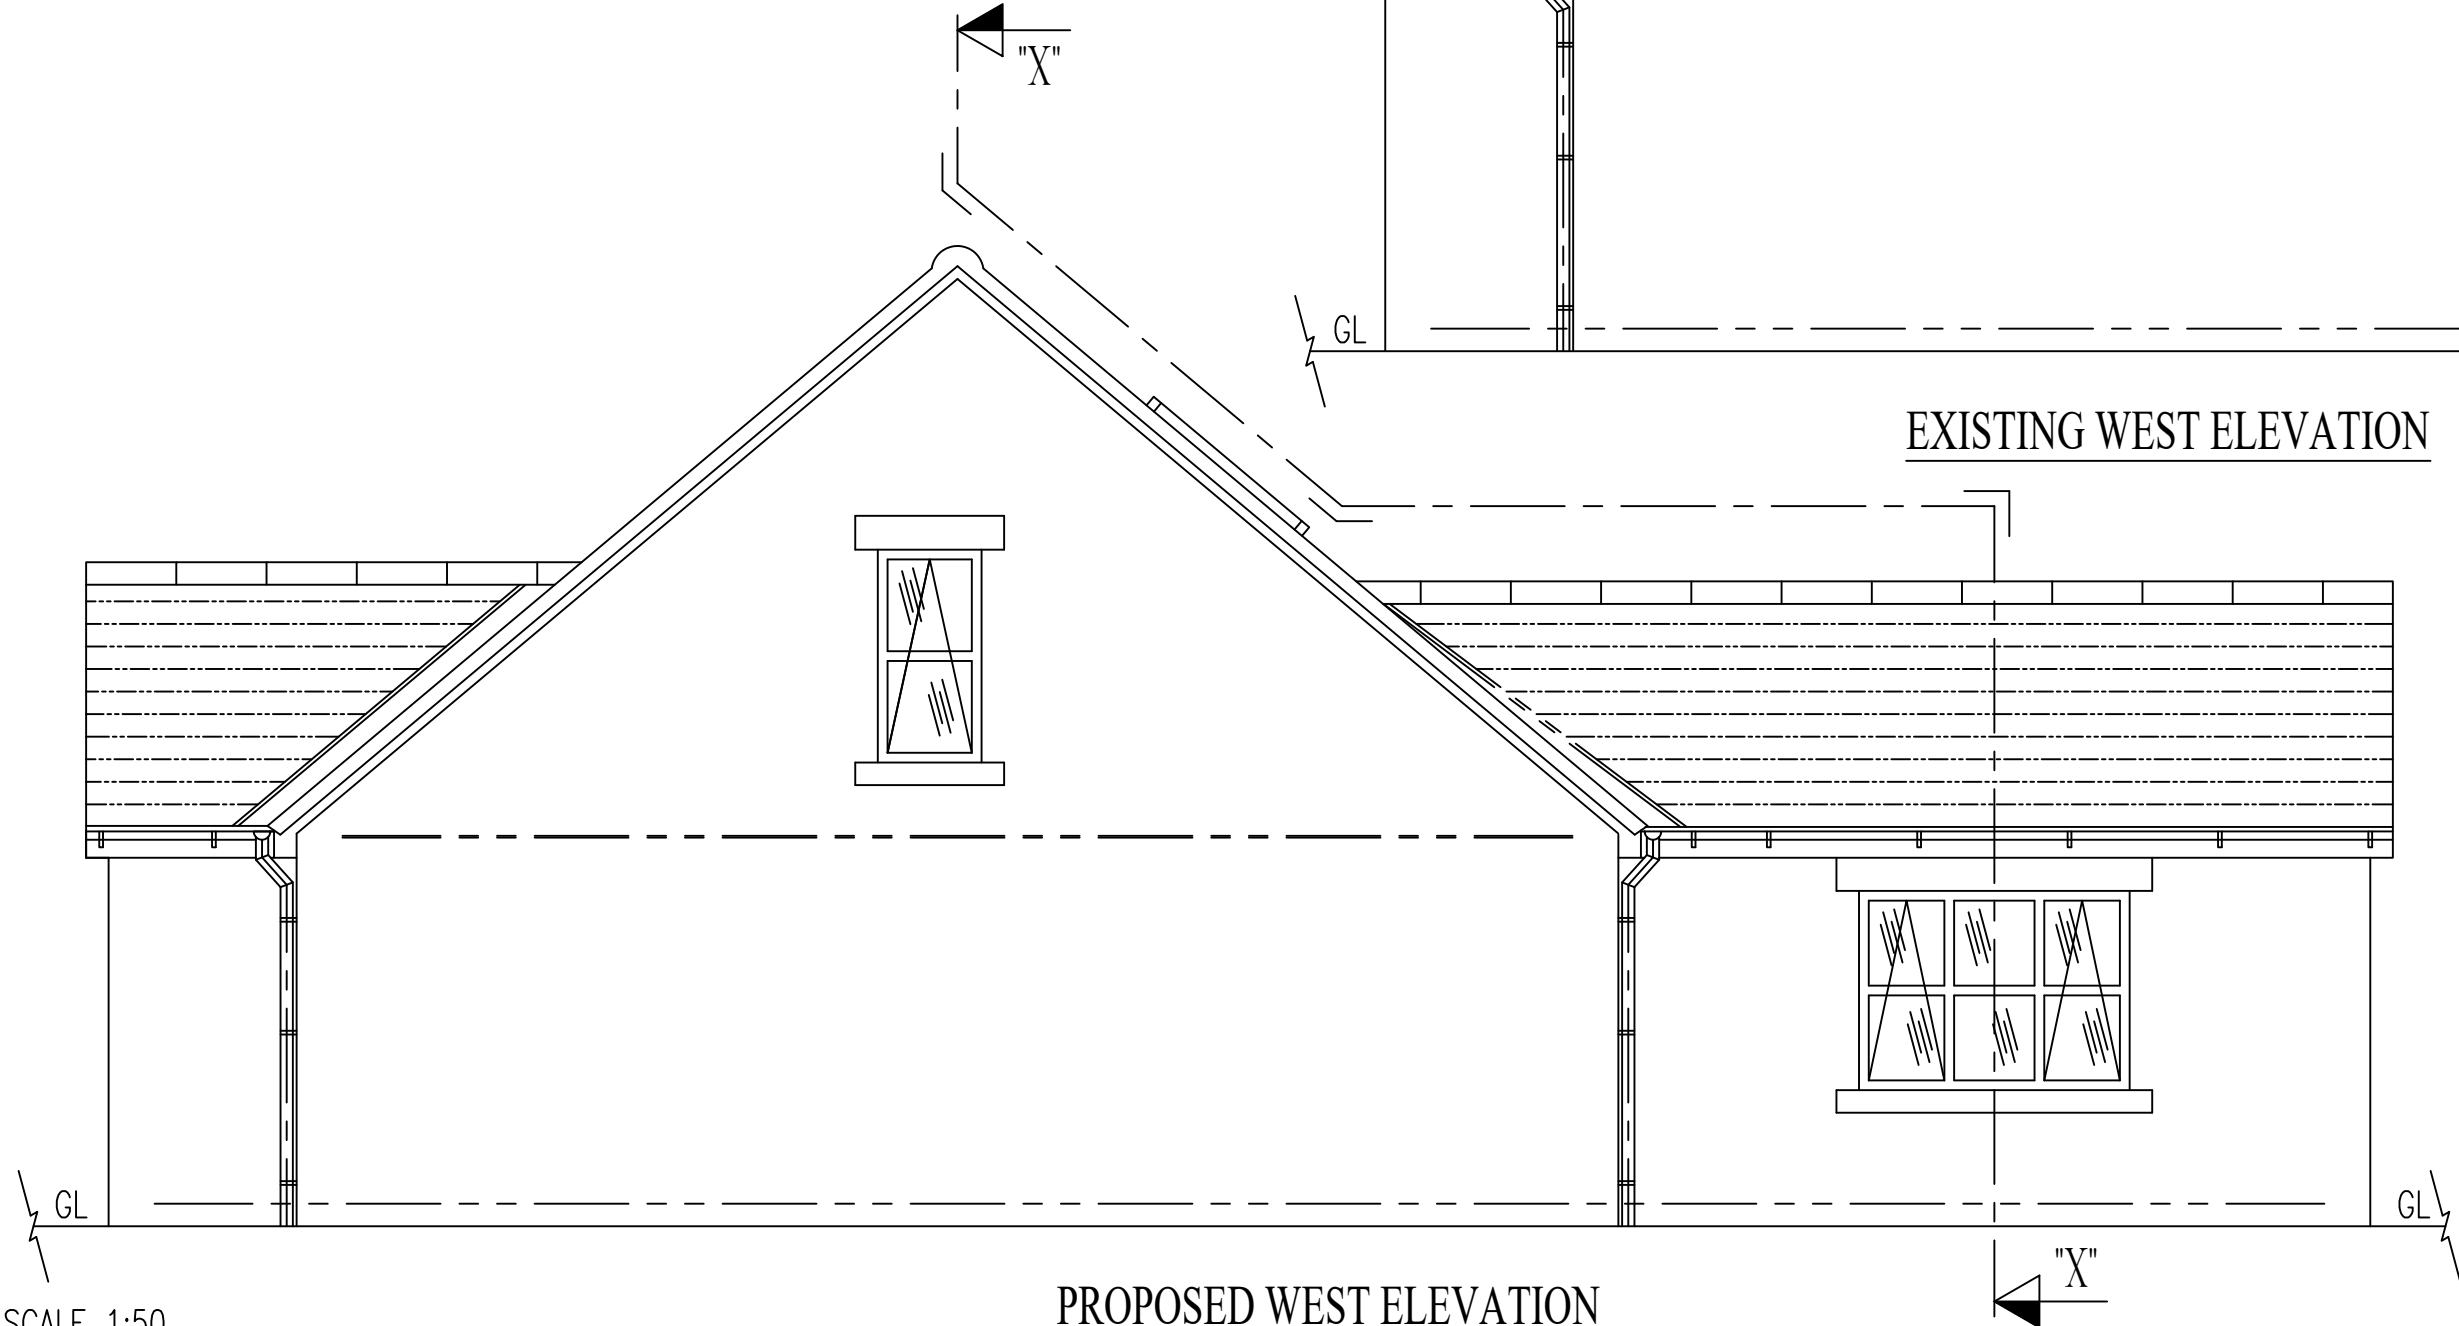

PROPOSED WEST ELEVATION

SCALE 1:50

