


DRAINAGE

1. THE LOCATION AND LEVEL OF EXISTING DRAINAGE CONNECTIONS AND EXISTING SERVICES IS TO BE CHECKED PRIOR TO COMMENCEMENT OF DRAINAGE WORKS. ANY VARIANCE TO THE DETAILS ON THE DRAINAGE DRAWING AND THE SCHEDULE IS TO BE BROUGHT TO THE ATTENTION OF THE ENGINEER.
2. THIS DESIGN IS BASED ON INFORMATION SUPPLIED BY PARTIES (Eg. ARCHITECT AND M&E ENGINEER), AND MAYBE SUBJECT TO CHANGE RESULTING FROM UPDATES AVAILABLE FROM THIRD PARTIES.
3. THE DRAWINGS ARE TO BE READ IN CONJUNCTION WITH THE NBS SPECIFICATIONS, ASSOCIATED MANHOLE SCHEDULE AND STANDARD DRAINAGE DETAIL DRAWINGS WHERE APPLICABLE.
4. THE POSITIONS OF FOUL AND SURFACE WATER DRAINAGE POINTS ARE INDICATIVE ONLY, REFER TO THE ARCHITECTS DRAWINGS FOR LOCATION AND SETTING OUT DETAILS.
5. MANHOLES, SEWERS, LATERAL CONNECTIONS ETC AND ANY OTHER PART OF THE WORKS INTENDED FOR ADOPTION UNDER A SECTION 104 AGREEMENT OR GULLIES ETC INTENDED FOR ADOPTION AS HIGHWAY DRAINAGE ARE TO BE CONSTRUCTED IN ACCORDANCE WITH SEWERS FOR ADOPTION 7TH EDITION (OR LATEST) AND TO THE APPROVAL OF THE WATER AND HIGHWAY AUTHORITIES.
6. UNADOPTED FW & SW DRAINAGE IS TO BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENT BUILDING REGULATIONS, BS EN752 AND BS EN12056.
7. DRAINS ARE TO BE CONSTRUCTED USING FLEXIBLY JOINTED VITRIFIED CLAY PIPES TO BS EN 295-1 SUPER STRENGTH SPECIFICATION (EG HEPWORTH SUPERSLEVE OR SIMILAR APPROVED) OR UPVC BUILDING DRAINAGE SYSTEM PIPEWORK TO BS 4660 AND BS EN1401-1, BEDDED AND BACKFILLED IN ACCORDANCE WITH THE MANUFACTURERS INSTRUCTIONS AND THE SPECIFICATIONS UNLESS OTHERWISE SPECIFIED.
8. ALL SOIL CONNECTIONS UNDER BUILDINGS TO BE GENERALLY 100mm DIA LAID AT A MINIMUM GRADIENT OF 1:60 UNLESS NOTED OTHERWISE AND BE RODDABLE FROM ABOVE GROUND LEVEL.
9. ALL RWP CONNECTIONS TO BE GENERALLY 100mm DIAMETER AND BE LAID AT A MINIMUM GRADIENT OF 1:150 UNLESS NOTED OTHERWISE AND BE RODDABLE FROM ABOVE GROUND LEVEL.
10. RAINWATER DOWN PIPES TO CONNECT TO A DRAIN VIA A REST BEND OR BE CONNECTED DIRECT TO A TRAPPED GULLY OR A 'P' TRAP ON A COMBINED SYSTEM, WHERE INTERNAL RWP'S OCCUR THESE MUST BE CONNECTED TO A 'P' TRAP WITH RODDABLE ACCESS ABOVE FLOOR LEVEL.
11. IN CASES OF IN SITU OR RC FLOOR SLABS, DRAINS ARE TO BE CAST INTEGRAL WITH THE SLAB WHERE PIPE COVER TO THE CROWN IS LESS THAN 300mm - NOTE SPECIAL PROVISIONS APPLY TO BASEMENT FLOOR SLABS - SEE DETAILED DRAINAGE AND STRUCTURAL DRAWINGS. CONCRETE ENCASEMENT TO BE REINFORCED AS PER DRAINAGE DETAIL.
12. WHERE DRAINS PASS THROUGH FOUNDATIONS OR OTHER RIGID STRUCTURES A LINTEL OR SLEEVE IS TO BE USED AND PROVISION FOR FLEXIBILITY IS TO BE MADE USING ROCKER PIPES.
13. BACKFILLING OF DRAIN TRENCHES ADJACENT TO BUILDINGS OR OTHER STRUCTURES IS TO BE IN ACCORDANCE WITH DIAGRAM 8 OF THE BUILDING REGULATIONS.
14. ALL INTERNAL FLOOR DRAINS TO BE SPECIFIED BY THE ARCHITECT.
15. ANY PIPE, GULLY OR OTHER FITTING OR DUCT PENETRATING THE BASEMENT SLAB OR WALLS IS TO BE WATERPROOFED USING HYDROPHILIC STRIPS OR PUDDLE FLANGES TO ENSURE A WATER TIGHT JOINT. CONCRETE SURROUND TO DRAINAGE PIPES AND FITTINGS MAY BE REQUIRED IN CERTAIN CASES - REFER TO DETAILED DRAINAGE DRAWINGS AND RELEVANT STRUCTURAL DETAILS.
16. THRESHOLD DRAINS TO BE ACODRAIN BRICKSLOT OR SIMILAR APPROVED BY ARCHITECT. DRAINS TO BE FITTED WITH SUMP UNIT & FOUL AIR TRAP.

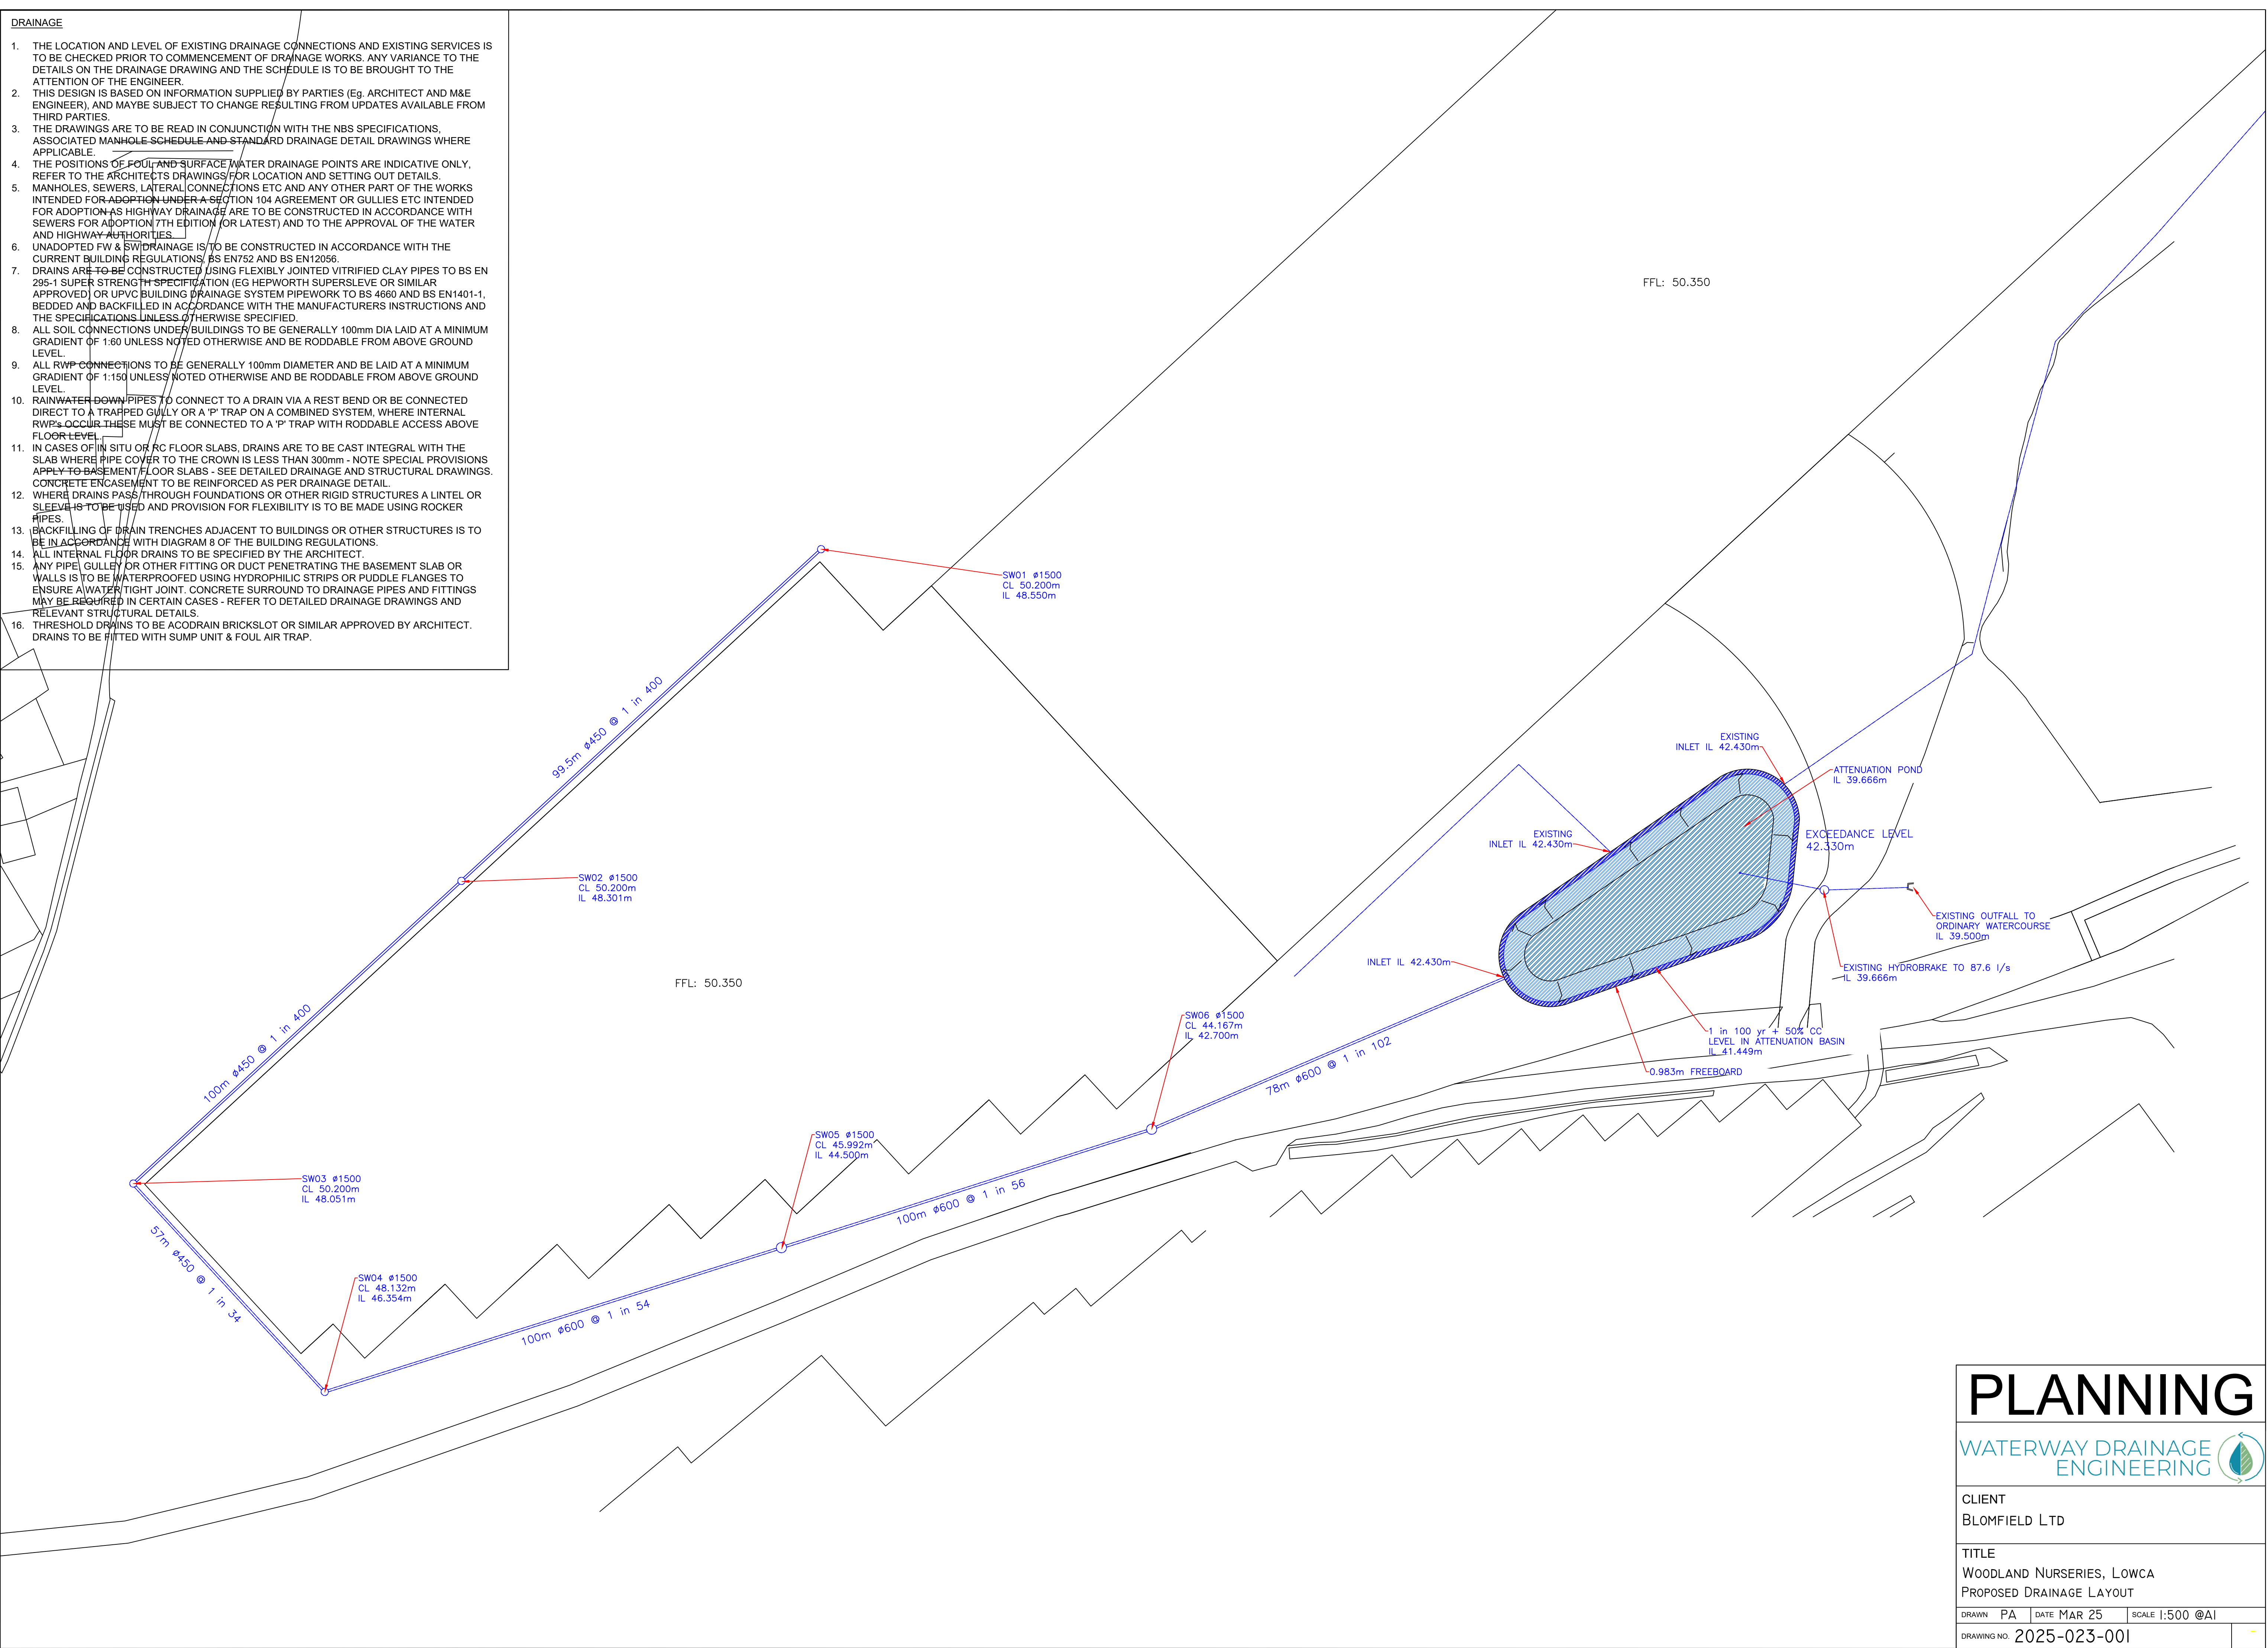

PLANNING

WATERWAY DRAINAGE
ENGINEERING



CLIENT
BLOMFIELD LTD

TITLE
WOODLAND NURSERIES, LOWCA
PROPOSED DRAINAGE LAYOUT

DRAWN	PA	DATE	MAR 25	SCALE	1:500 @AI
DRAWING NO. 2025-023-001					