


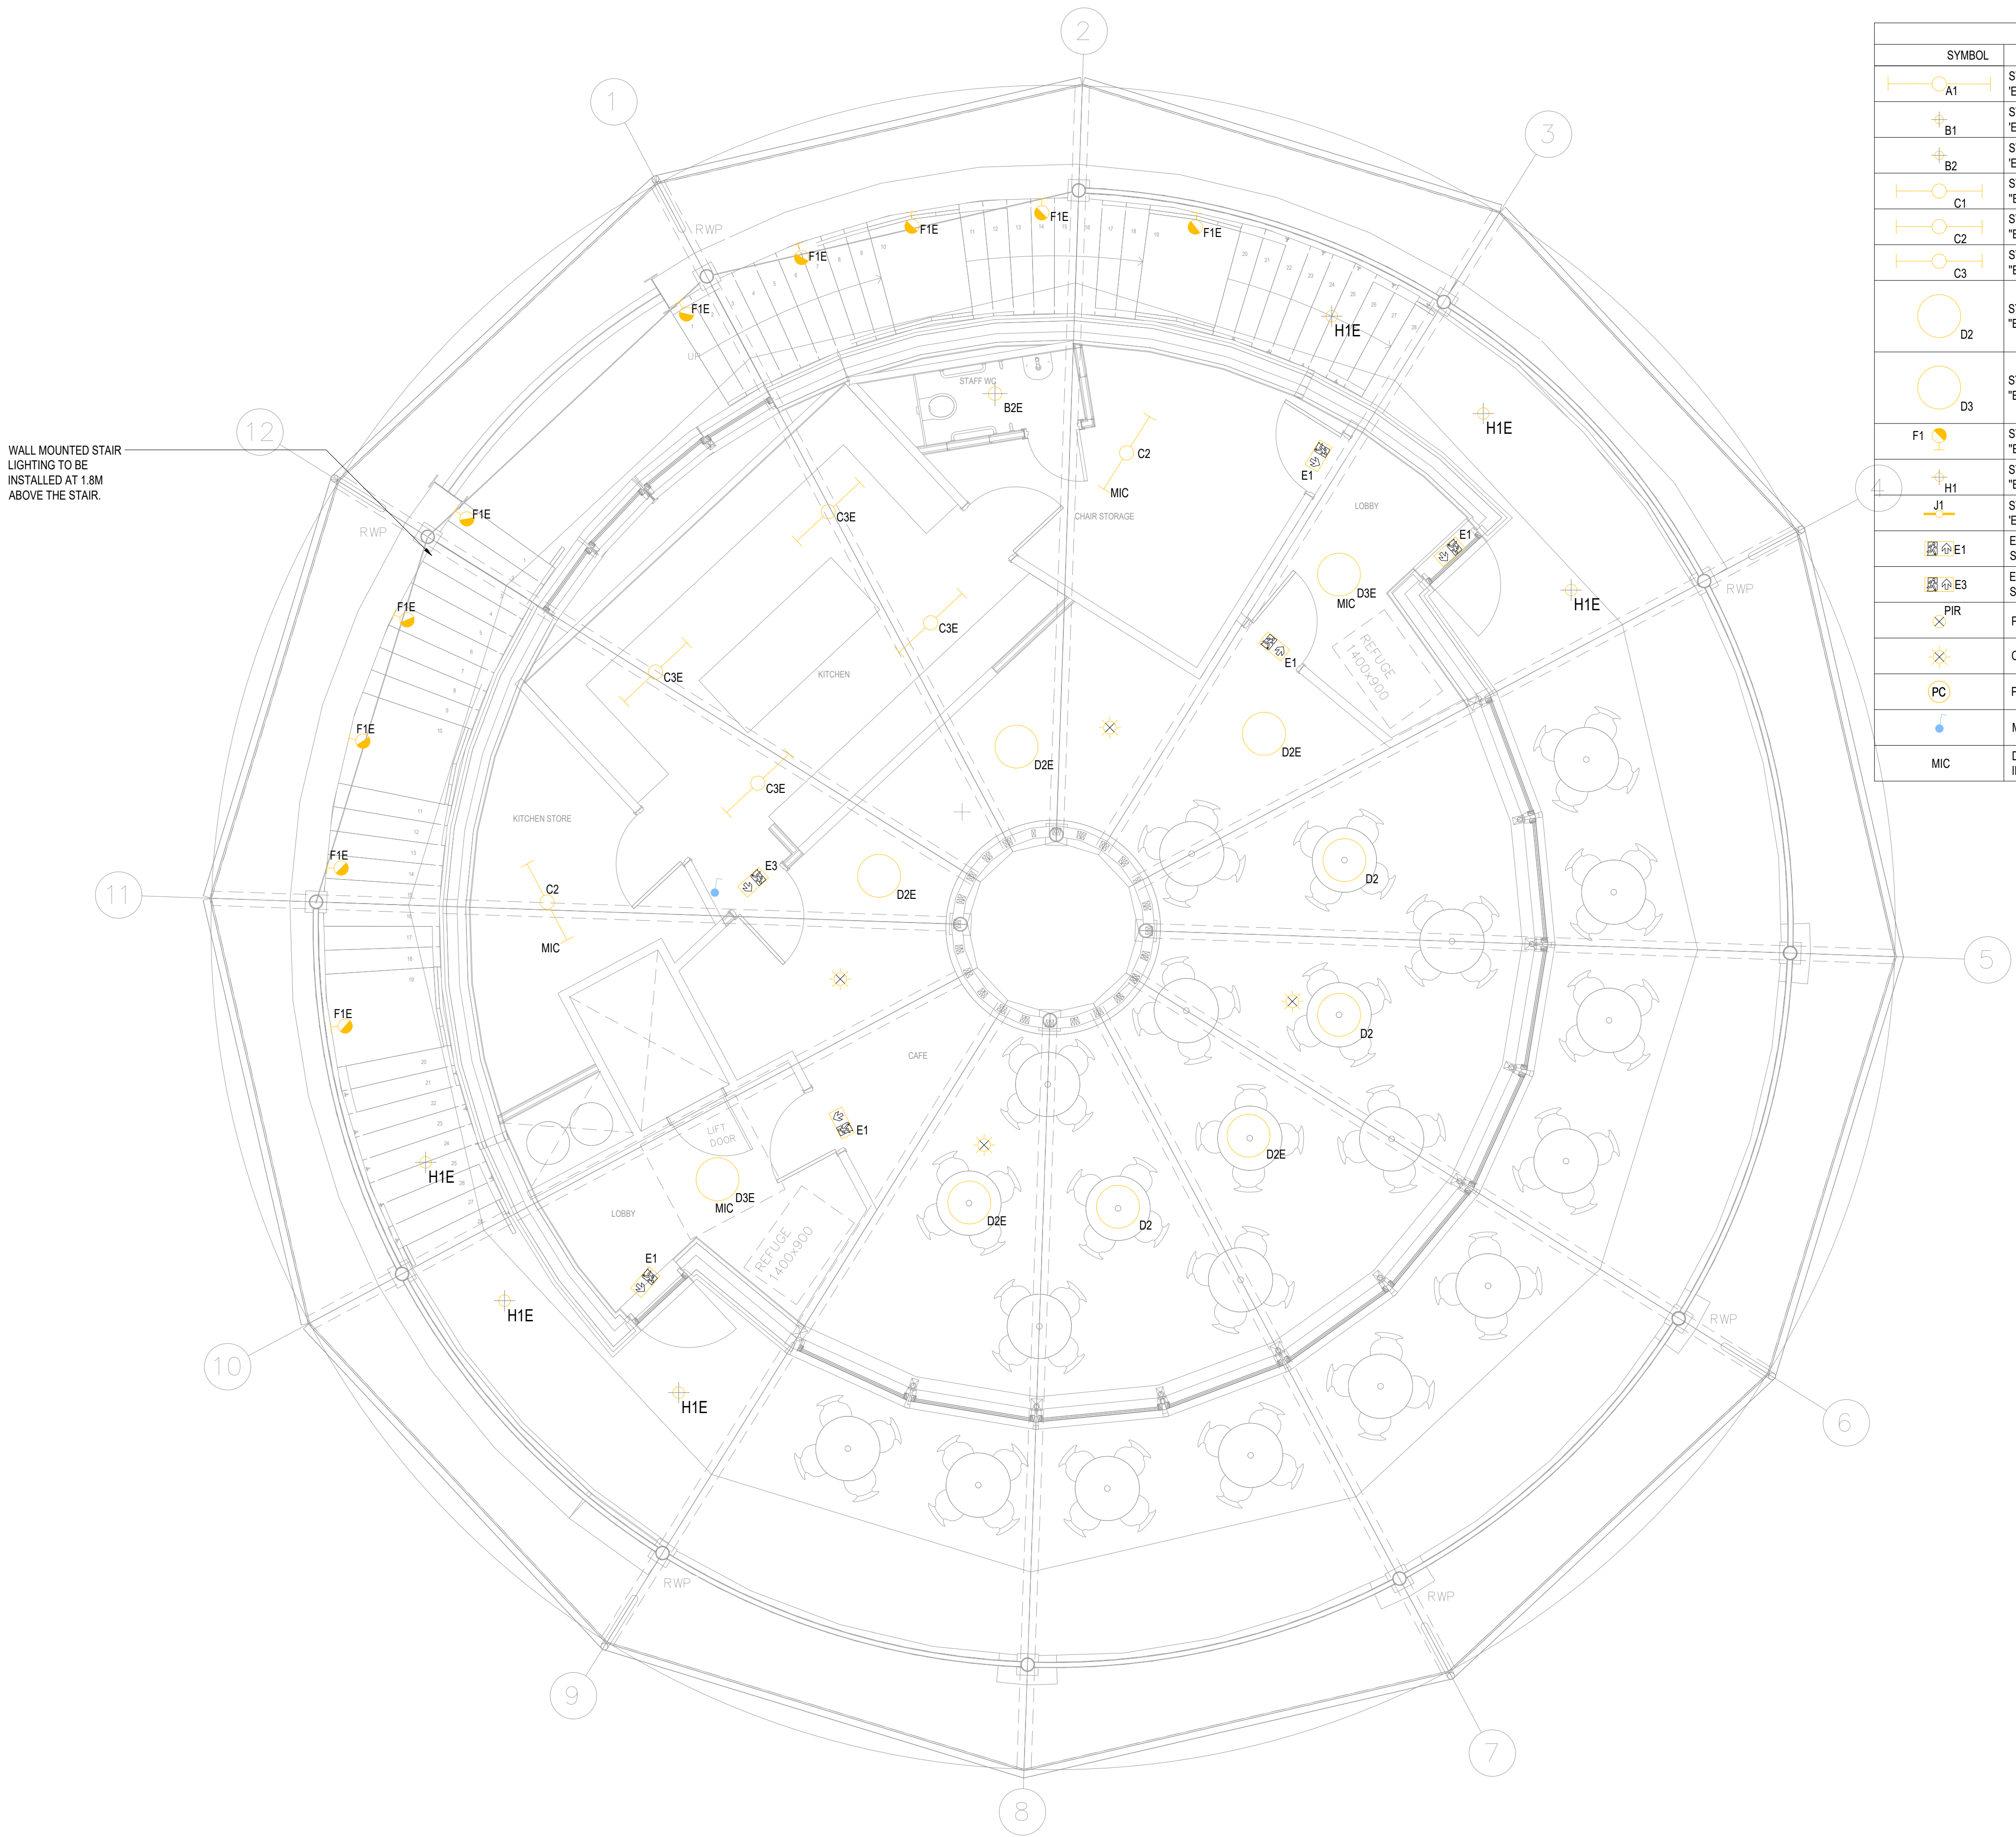

WALL MOUNTED STAIR LIGHTING TO BE INSTALLED AT 1.8M ABOVE THE STAIR.

LEGEND	
SYMBOL	DESCRIPTION
	STEON ACOUSTIC LINEAR, 33W, 1430mm, 4000K 'E' DENOTES EMERGENCY LUMINAIRE
	STEON PETRUS MIDI, 15W, 4000K 'E' DENOTES EMERGENCY LUMINAIRE
	STEON PETRUS MIDI, 21W, 4000K 'E' DENOTES EMERGENCY LUMINAIRE
	STEON CHALLENGER 66, 17W, 1200mm, 4000K, WITH MIC 'E' DENOTES EMERGENCY LUMINAIRE
	STEON CHALLENGER 66, 24W, 1200mm, 4000K 'E' DENOTES EMERGENCY LUMINAIRE
	STEON CHALLENGER 66, 37W, 1200mm, 4000K 'E' DENOTES EMERGENCY LUMINAIRE
	STEON ROTOONDO PENDANT, 33W, 600mm, 3000K 'E' DENOTES EMERGENCY LUMINAIRE
	STEON ROTOONDO SURFACE, 33W, 600mm, 3000K 'E' DENOTES EMERGENCY LUMINAIRE
	STEON HARRIER MIDI, 10W, 2700K 'E' DENOTES EMERGENCY LUMINAIRE
	STEON SEREN MIDI, 12W, 2700K 'E' DENOTES EMERGENCY LUMINAIRE
	STEON FUSION, TRACK MOUNTED SPOTLIGHT, CR190, 3000K 'E' DENOTES EMERGENCY LUMINAIRE
	EMERGENCY EXIT SIGN (3HR MAINTAINED) STEON SUBSIDIUM
	EMERGENCY EXIT SIGN (3HR MAINTAINED) STEON SLIM PACK LED
	PIR PRESENCE DETECTOR
	COMBINED PIR PRESENCE DETECTOR AND PHOTOCELL
	PHOTOCELL
	MANUAL LIGHT SWITCH
	DENOTES AUTOMATIC PRESENCE DETECTION MODULE INTEGRAL TO FITTING.

This document and its contents are the property of the Purchaser/Employer and Crookes Walker Consulting. They may not be copied or reproduced in any way, in part or whole, without prior written approval of both parties. Violations will result in legal action.
This drawing shall be read in conjunction with the CWC Mechanical and / or Electrical Specification(s).
DO NOT SCALE FROM THIS DRAWING

DESIGNERS RISK ASSESSMENT
REFER TO APPENDIX 1 OF M&E SPECIFICATION FOR DESIGNERS RISK ASSESSMENT SCHEDULE

DRAWING BACKGROUND(S):		
COMPANY	DRAWING NUMBER	REV
ARCHITECTS PLUS	24044-2005	D

- NOTES:**
- LUMINAIRES ADJACENT TO WINDOWS / WHERE DAYLIGHT PRESENCE DETECTION IS PROVIDED WILL BE DIMMABLE TO EXPLOIT AVAILABLE NATURAL DAYLIGHT.
 - ILLUMINATED EMERGENCY EXIT SIGNAGE & EXTERNAL EMERGENCY BULKHEAD LUMINAIRE SUPPLIES SHALL BE DERIVED FROM THE LOCAL INTERNAL LIGHTING CIRCUIT
 - THE LIGHTING LAYOUT DRAWING SHALL BE READ IN CONJUNCTION WITH THE LUMINAIRE SCHEDULE
 - GENERAL LIGHTING SHALL BE DESIGNED, INSTALLED, TESTED AND COMMISSIONED TO BS12464-1.
 - EMERGENCY LIGHTING SHALL BE DESIGNED, INSTALLED, TESTED AND COMMISSIONED TO BS 5266-1 & BS 1838.
 - EACH EXIT TO THE OUTSIDE SHALL BE SUPPLIED COMPLETE WITH AN OVERHEAD (OR TO ONE SIDE) 3HR SELF CONTAINED EMERGENCY LUMINAIRE TO PROVIDE EMERGENCY ILLUMINANCE ON EGRESS.
 - EMERGENCY LUMINAIRES SHALL BE SUPPLIED FROM THE SAME ELECTRICAL CIRCUIT SUPPLYING THE GENERAL ILLUMINATION WITHIN THE ROOM THEY ARE INSTALLED.

- SPECIFIC NOTES:**
- ALL THE LUMINAIRES SHALL BE SUSPENDED AT 2800mm ABOVE FINISHED FLOOR EXCEPT FOR RECESSED/SURFACE MOUNTED LUMINAIRES.
 - REFER TO DB SCHEDULE FOR CIRCUITING DETAILS.


T02	22.08.25	ISSUED FOR STAGE 4	GV	AP
T01	15.08.25	TENDER ISSUE	GV	AP
P01	09.05.25	ISSUE FOR COSTING	GV	AP
Rev	Date	Description	Eng	CHK



CWC
crookes walker
consulting

Suite 9a, Bloc, 17 Marble Street
Manchester M2 3AW
Tel: 0161 834 9999
The Plaza, Old Hall Street,
Liverpool L3 9QU
Tel: 0151 600 5409
E-mail: admin@cwcon.co.uk
Website: www.cwcon.co.uk

Client



Cumberland Council



STORY

Project
**THE IRON LINE
CUMBRIA**

Drawing Title
**FIRST FLOOR
GENERAL LIGHTING AND
EMERGENCY LIGHTING**

Status		
STAGE 4		
Project No.	Drawn	Scale / Paper Size
3468	SJW	1:50 @ A1
Drawing No.	Rev	
3468-CWC-XX-01-DR-E-6301	T02	