


Hydra Plan - 7838



Using fire protection from 

ref: undefined

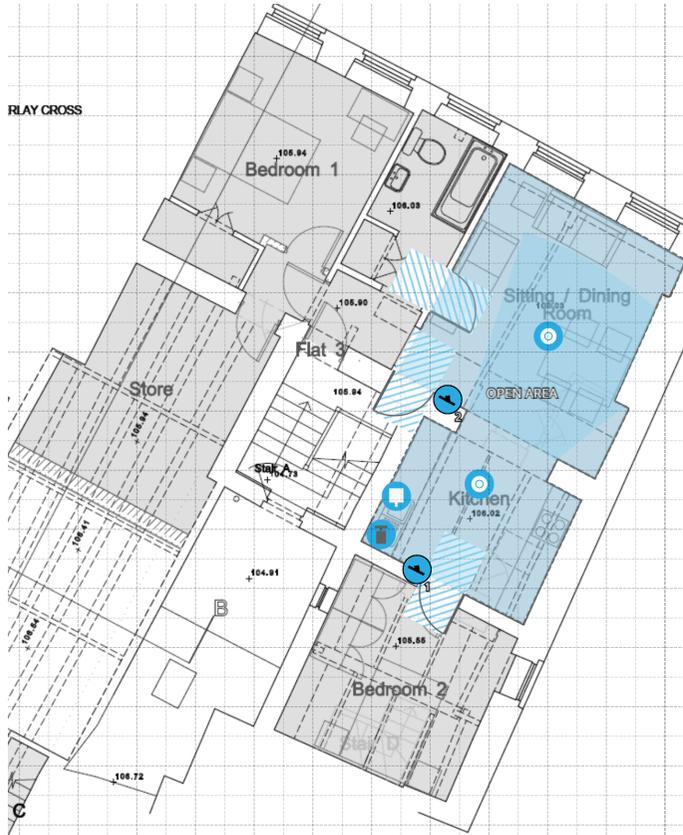

Spray heads must be located a minimum of 1.5m from the cooking hob/oven location.

Spray heads must be located a minimum of 3m from any open fire source including log burners.

Spray heads must be at least 0.5m away from a window to avoid being covered/blocked by curtains/blinds.

Spray heads must not be covered or blocked by any piece of furniture.

Spray heads mounted above the kitchen work surfaces require a minimum of 400mm clearance from the spray head centre and the work top and a minimum of 100mm clearance from the spray head centre and the underside of any wall mounted units.

SYSTEM INVENTORY

-  DETECTOR (2)
-  PUMP (1)
-  SMARTSCAN (2)
-  CONTROLLER (1)
-  ZONE TO CONSIDER
-  PROTECTED AREA
-  STERILE AREA
-  DOOR
-  WINDOW

◀1m▶

SPECIFIER: Charlie
EMAIL: info@bluelightsafety.co.uk

ADDRESS: 14 Coates Lane
United Kingdom

AREA DETAILS
TOTAL: 20.11m²
HIGHEST CEILING HEIGHT: 2.4m

SYSTEM DETAILS
PUMP COVERAGE: 20.10m²
UNPROTECTED AREA: 0.01m²

NOTES:
Objective: Code compliance. Meeting building regulations