


- 1) ROOF COVERING TO BE BOX PROFILE SHEET, JUNIPER GREEN TO BS 12629.
- 2) LOWER WALLS TO BE REINFORCED CONCRETE PANELS - NATURAL COLOUR.
- 3) UPPER SIDE CLADDING TO BE YORKSHIRE TYPE BOARDING.
- 4) DOOR TO BE GALVANISED SHEET CLAD - SLIDING TYPE. GATES TO BE GALV STEEL DIAGONAL RAIL TYPE.
- 5) ALL TIMBERWORK TO BE TREATED WITH A PRESERVATIVE.
- 6) ALL STEELWORK TO BE EITHER GALVANISED OR COATED WITH 2 LAYERS NON TOXIC PAINT.
- 7) STEEL FRAME BUILDING TO BE MANUFACTURED TO BS 5802, CLASS 2.
- 8) ALL ELECTRICAL WORK TO BE DESIGNED, INSTALLED & TESTED TO BS 7671 (IEE WIRING REG'S - LATEST EDITION) BY COMPETENT PERSON.
- 9) INTERNAL LIGHTING TO BE FLUORESCENT - TUBE OR COMPACT, MIN 40 LUMENS PER CURCUT WATT.
- 10) EXTERNAL LIGHTING TO BE AS ABOVE OR AN A TIMER & AUTOMATICALLY EXTINGUISHED IN DAYLIGHT.
- 11) UNDER FLOOR SLURRY STORE = 110.0 m³ CAPACITY. 35 GMS AT 44 LITRES/DAY EFFLUENT = 1.54 CUM/DAY. ∴ STORE HAS 76 DAYS CAPACITY.
- 12) FLOOR AREA OF BUILDING, INCLUDING OVERHANG = 283.11 m².
- 13) WATER TROUGH & OPENING TO BE INSTALLED TO RELEVANT CODES OF PRACTICE, & BE INSULATED.
- 14) RAINWATER TO DISCHARGE INTO SOAKAWAYS INITIALLY, MIN 3 OF 1 CU. M AQUAVOID CRATES, TO CARE FOR 290 CU. M ROOF AREA, & OVER FLOW FROM SAME TO DRAIN TO WATERCOURSE SOUTH OF COMPLEX - WITHOUT INTERFERING WITH EXISTING SEPTIC TANK & ASSOCIATED SUB-RECEPTION.

4/21/23 03/05/1

SURFACE WATER TREATMENT

14/7/21

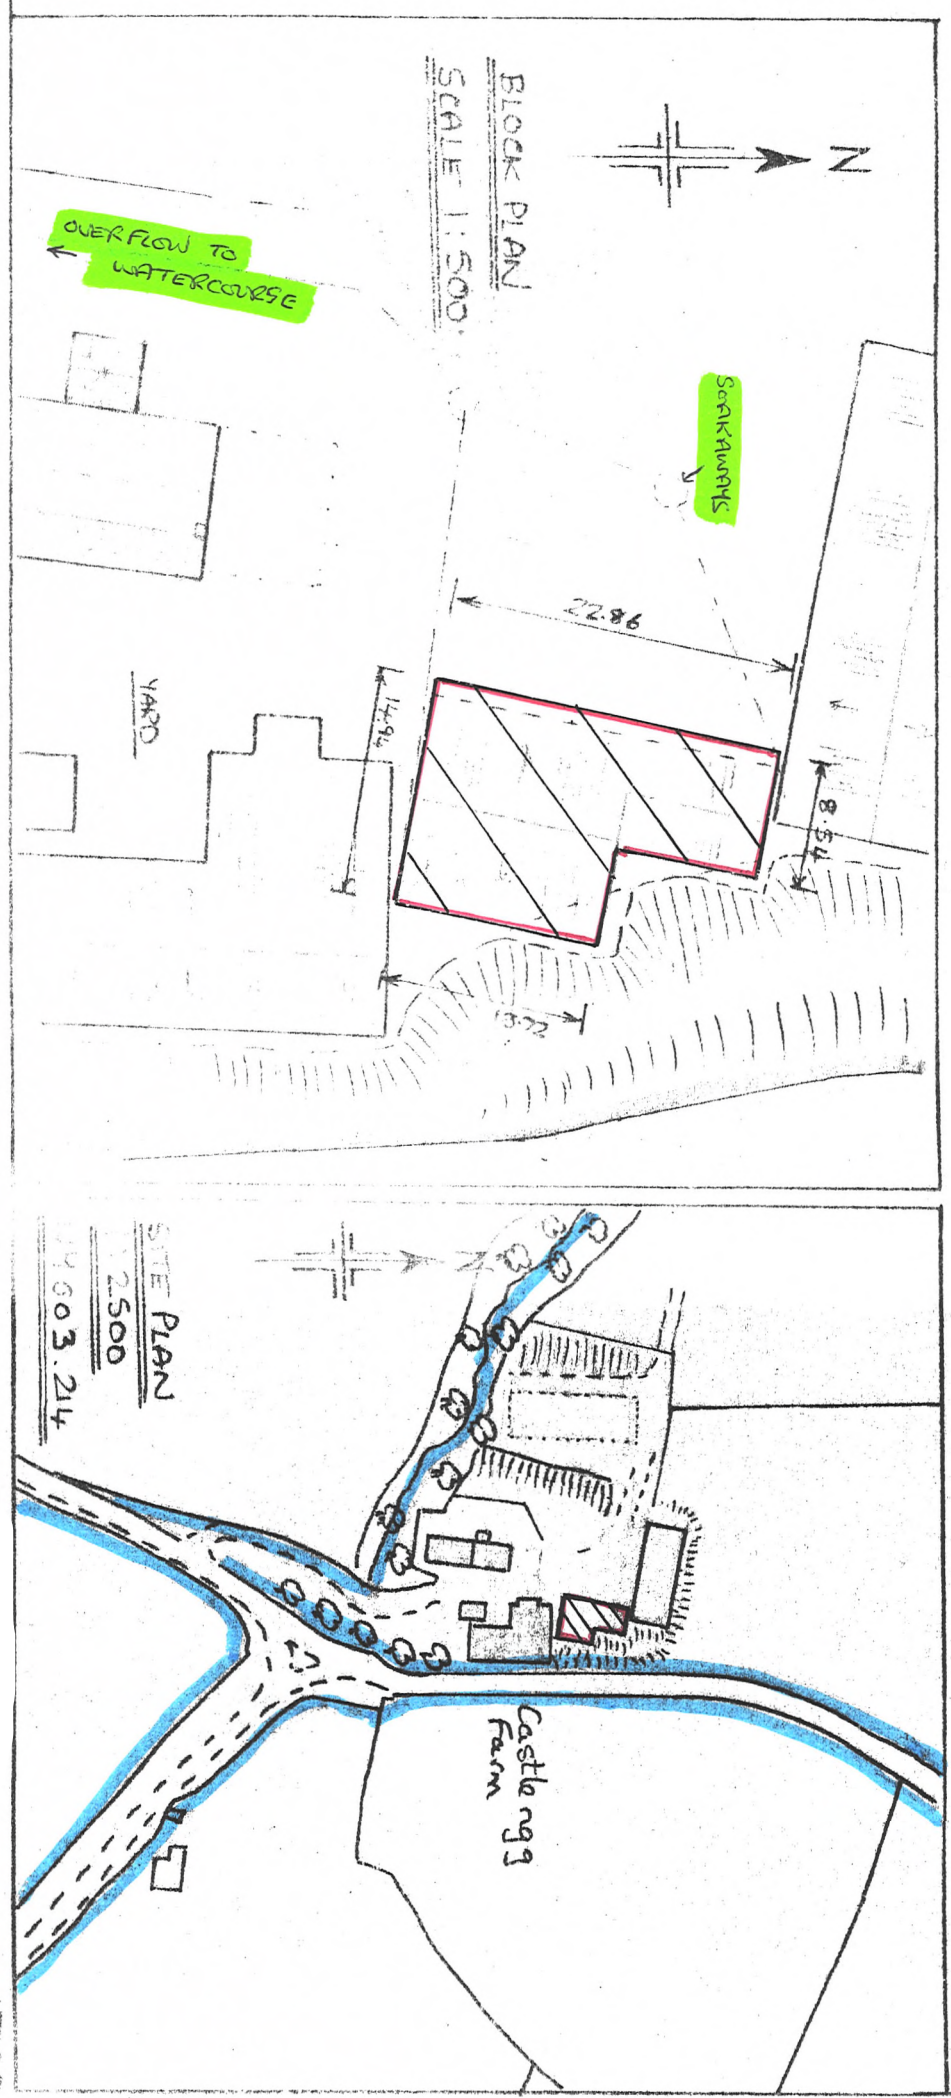

10-6-23

1702