

West Cumberland Hospital

Ground Investigation Report

Curtins Ref: 073983-CUR-00-XX-RP-GE-002


Revision: 03

Issue Date: 09 December 2021

Client Name: CCL Solutions

Client Address: Unit 18, The South Range, Hackthorpe Business Centre, Hackthorpe, Penrith,
Cumbria, CA10 2HX

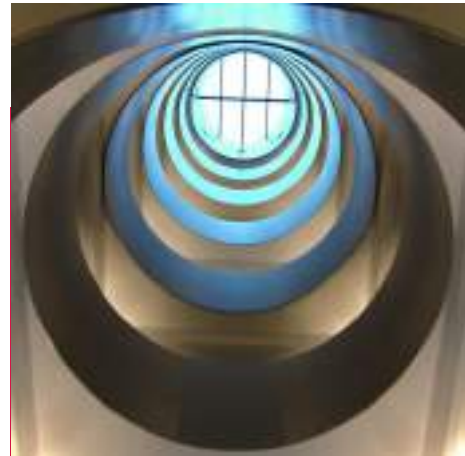

Site Address: West Cumberland Hospital, CA28 8JG






Ground Investigation Report

Rev	Description	Issued by	Checked	Date
V01	First Issue	JJ	RA	25/03/2021
V02	Updated following post demolition ground investigation	JJ	NF	28/09/2021
V03	Updated with revised borehole plan and appended shear box results	TW	NF	09/12/2021

This report has been prepared for the sole benefit, use, and information for the client. The liability of Curtins Limited with respect to the information contained in the report will not extend to any third party.

Author	Signature	Date
J. James BSc GC EnvMgt MCIWEM C.WEM Principal Engineer		25 March 2021
T. Walker BSc MSc Graduate Geo-environmental Engineer		09 December 2021

Reviewed	Signature	Date
R Amirhosseiny Meng Senior Geotechnical Engineer		25 March 2021
N Farnworth BSc (Hons) MCIWEM Senior Geo-Environmental Engineer		28 September 2021

Authorised	Signature	Date
M Lomas BSc (Hons) CEnv CSci CWEM MCIWEM Associate		25 March 2021
J. James BSc GC EnvMgt MCIWEM C.WEM Principal Engineer		09 December 2021

Executive Summary

Appointment	<p>In November 2020, Curtins were instructed by Graham Construction to undertake a Phase 2 Ground Investigation for the construction of a new hospital wing and refurbishment of existing buildings with associated car parking, communal soft landscaped, clinical and recycling waste storage in the north of the site.</p> <p>Subsequent phases of ground investigation were instructed by Graham Construction in February and June 2021.</p> <p>The site is centred on National Grid Reference NS 298950, 516040.</p>
Current Site Status	<p>Most of the site is currently vacant, having undertaken demolition of the previous hospital building in the west, and previous buildings in the north-east.</p>
Summary of Phase 1	<p>The site was vacant up until the 1960s from when the West Cumberland Hospital was constructed. The site underwent significant development in the mid to late 1960s and remained relatively the same up until the present day, where the site structures have been demolished with significant earthworks also undertaken.</p> <p>Based on the site's historical land use and considering the nature of present demolition and earthworks, made/reworked ground is anticipated at varying depths. Superficial deposits are indicated to comprise Till underlain by bedrock noted as the Hensingham Grit and Stainmore Formations, comprising sandstone and mudstone.</p> <p>Superficial deposits are not assigned an Aquifer designation. The bedrock is classified as a Secondary A aquifer. The site is not located within a source protection zone and there are no groundwater abstraction points within 1km of the site.</p> <p>The nearest surface water feature is located 264m south west of the site. Which appears to relate to a small drain. There are no surface water abstraction points recorded within 1km of the site.</p> <p>The site is located in a lower probability radon area, where less than 1% of properties are estimated to be above the radon action level.</p> <p>Primary potential risks to be investigated during the Phase 2, as well as establishing ground conditions for geotechnical design, included; potential for land gas and risks to human health from Made Ground soils.</p>
Fieldworks	<p>Fieldworks were carried out in December 2020 and comprised six cable percussion / rotary cored boreholes to a maximum depth of 17.30m bgl and seven windowless sampling boreholes up to 3.65m bgl.</p> <p>Groundwater and gas monitoring wells installed within select borehole locations, with six return ground gas monitoring visits have been completed. Selected soil and rock samples were scheduled for chemical and geotechnical analysis.</p> <p>Further ground investigation were undertaken in March 2021 comprising three open-hole rotary boreholes to 12.00m bgl and dynamic probing within the north of the site to obtain CBR values for road/pavement design.</p> <p>Additionally, further ground investigation works were undertaken in August 2021 comprising six machine excavated trial pits up to 1.90m bgl, four window sample boreholes up to 3.00m bgl, two concrete cored inspection pits up to 0.25m bgl, six hand dug foundation inspection pits up to 1.65m bgl, with soakaway infiltration tests conducted in three of the machine excavated trial pits. Selected soil samples were scheduled for chemical and geotechnical analysis.</p>
Ground Conditions	<p>Made Ground deposits were encountered in all of the exploratory holes (with exception of WS02), to base depths ranging from 0.18m bgl (BH23) to 2.50m bgl (WS05). The Made Ground generally comprised an upper layer of predominantly granular material with demolition material and the deeper Made Ground encountered as a cohesive material, likely reworked material.</p> <p>Residual soils were encountered locally within north-western to south-western area of the site within WS01 and WS02. These were encountered to underlie either Topsoil or Made Ground at shallow depths (<0.80m bgl) to depths of 3.65m bgl.</p> <p>Bedrock has been encountered within all of the rotary boreholes, comprising sandstone to circa 10.0m bgl with Limestone thereafter within BH01, BH02 and BH06 all within the northern portion only. The sandstone is described Medium strong light brownish grey coarse rained crystalline SANDSTONE with rare microline coal laminations.</p>

Ground Investigation Report

	<p>The Limestone was described as Strong light whitish grey crystalline LIMESTONE. Small pyritic inclusions noted and common quartz veins throughout.</p>
<p>Environmental Laboratory Testing and Ground Gas Monitoring Results</p>	<p>With respect to the proposed 'Commercial' end use, no exceedances were recorded within any samples collected from the made ground.</p> <p>Selected soil samples were screened for asbestos. No suspected asbestos containing materials (ACMs) were identified in the exploratory hole logs and no asbestos fibres were positively identified during laboratory analysis of the soil samples.</p> <p>No flow, carbon dioxide or methane concentrations above the machine's limit of detection have been recorded.</p>
<p>Generic Quantitative Risk Assessment</p>	<p>The risk presented to site end users from made ground soils is Low due to no exceedances above <i>Commercial</i> thresholds were recorded in any samples recovered.</p> <p>The risk presented to site end users from ground gases is Low, with a CS-1 classification and no gas protection measures required for the site. Radon protection measures are not required.</p>
<p>Geotechnical Assessment</p>	<p>It is considered that the underlying bedrock could potentially provide a suitable bearing stratum. For foundations founded on moderately strong sandstone with discontinuity spacings >60mm, allowable bearing capacities of 1500 to 2000 kN/m² are estimated.</p> <p>Where bedrock is too deep and overlaid by variable made ground (encountered across the site to depths of up to 2.50m bgl) and along with variable residual soils (locally to 3.65m bgl) it may affect the feasibility with potential mass trench fill foundations required within areas of deep made ground/residual soils. It is also considered that a piled foundation solution could be used to transfer the loads to the underlying bedrock. The carrying capacity of piles depends not only on their size and the ground conditions but also on their method installation. If a piled foundation solution is to be adopted, consideration should be given to the fractured/poor quality bedrock at from approximately 9.00 – 11.50m bgl, within the vicinity of BH02A.</p> <p>Based on the observations on site together with the results of laboratory tests, it is recommended that consideration is given to a suspended ground floor slab, unless founded on a suitable natural stratum with allowable bearing capacities satisfying the required pressures from the slab. Where piled foundations are anticipated, a suspended slab is recommended to bear on the pile caps by a network of beams which will minimise any differential settlement between the floor and piled structure. Laboratory test results indicate a Design Sulphate Class for concrete may be taken as DS-2 and ACEC class of AC-2 would be appropriate.</p>
<p>Recommendations</p>	<p>Based on the findings of the ground investigation, the following recommendations are made:</p> <ol style="list-style-type: none"> 1. It is recommended that construction workers are provided with appropriate PPE and sanitary facilities, with reference to the environmental testing results presented herein and within Appendix C. 2. Where unexpected contamination is discovered during future earthworks and/or construction, works should be stopped and the advice of a qualified geo-environmental engineer should be sought.

Table of Contents

1.0	Introduction.....	1
1.1	Project Background.....	1
1.2	Scope of Works.....	1
2.0	Site Setting.....	2
2.1	Available Sources.....	2
2.2	Current Setting.....	2
2.3	Previous Site Use.....	3
2.4	Geology and Hydrogeology.....	4
2.5	Hydrology.....	5
2.6	Mining.....	6
2.7	Unexploded Ordnance.....	6
2.8	Ground Gas.....	6
3.0	Conceptual Site Model & Qualitative Risk Assessment.....	8
3.1	Additional Risk Assessments.....	8
4.0	Field and Laboratory Studies.....	10
4.1	Ground Investigation.....	10
4.2	Laboratory Analysis.....	12
4.3	Monitoring Well Installations.....	14
5.0	Ground Conditions.....	16
5.1	General.....	16
5.2	Topsoil.....	16
5.3	Made Ground.....	16
5.4	Residual Soils.....	21
5.5	Bedrock.....	22
5.6	Observed Potential Contamination.....	24
5.7	Groundwater.....	24
5.8	Aggressive Ground Conditions.....	25
5.9	Dynamic Cone Penetrometer Tests.....	25
5.10	Foundation Inspection Pits.....	25
5.11	Soakaway Infiltration Tests.....	26
6.0	Ground and Groundwater Contamination Assessment.....	27
6.1	Human Health GQRA.....	27
6.2	Controlled Waters GQRA.....	29
6.3	Ground Gas GQRA.....	29
7.0	Revised Conceptual Site Model.....	32



8.0	Geotechnical Conclusions and Recommendations	34
8.1	Foundation Recommendations	34
8.2	Ground Floor Slabs	34
8.3	Chemical Attack on Buried Concrete	35
8.4	Excavations	35
9.0	Geo-Environmental Conclusions and Recommendations.....	36
9.1	Geo-Environmental Conclusions.....	36
9.2	Recommendations	37
10.0	Bibliography.....	38

Appendices

- Appendix A - Drawings
- Appendix B - Exploratory Hole Logs
- Appendix C - Chemical Laboratory Testing Results
- Appendix D - Geotechnical Laboratory Testing Results
- Appendix E - Ground Gas and Groundwater Monitoring Results
- Appendix F - GAC Screening Thresholds
- Appendix G - Soakaway Infiltration Results
- Appendix H - Risk Assessment Methodology

1.0 Introduction

1.1 Project Background

Curtins have been instructed by CCL Solutions on behalf of Grahams Construction to undertake a Ground Investigation for the proposed development at the West Cumberland Hospital in Whitehaven.

Subsequent phases of ground investigation were instructed by Graham Construction in February and June 2021.

The proposed development comprises the construction of a new hospital wing and refurbishment of existing buildings with associated car parking, communal soft landscaped, clinical and recycling waste storage in the north of the site.

The site is located on approximate National Grid Reference (NGR) 298950, 516040.

The current development plans can be referred to within Appendix A of this report.

1.2 Scope of Works

This report includes a review of the readily available information for the site, as presented in the Curtins 2020 Phase 1 Preliminary Risk Assessment Report (Curtins, 2020) and the previous ground investigations and recent ground investigations undertaken by Curtins. This report will provide an assessment of the geo-environmental and geotechnical conditions across the site and present an account of the ground and groundwater conditions along with any anticipated limitations or constraints caused by contamination or geohazards.

The Phase 2 report is intended to determine:

- a) Likelihood of potential shallow site soils contamination, due to site's current and historic land use, adversely impacting the end-user;
- b) Likelihood of potential groundwater contamination, due to site's current and historic land use, adversely impacting the end-user;
- c) Likelihood of potential ground gas, adversely impacting the end-user; and
- d) Likelihood of the proposed works being adversely impacted by potential geo-hazards across the site.

In addition, recommendations on foundation solutions for the proposed structures will be provided.

Detailed flood risk assessment, ecology and archaeological studies are outside of the scope of this report.

2.0 Site Setting

Information about the current site setting, history, geology and hydrogeology/hydrology, have been previously detailed within the Phase 1 Preliminary Risk Assessment, undertaken by Curtins, Ref: 073096-CUR-00-XX-RP-GE-001. Additional sources of readily available information have also been assessed as a part of this report. A summary of these are provided in the subsequent sections.

This information will feed into the geo-environmental risk assessment (refer to Section 7.0) and geotechnical assessment (refer to Section 9.0).

2.1 Available Sources

In addition to the Phase 1 report undertaken by Curtins, other sources of relevant information reviewed for this scheme comprise:

- Envirocheck Report, included in the Curtins Phase 1
- British Geological Society (BGS) Scotland Map Sheet 30E, Scale 1:50,000 Glasgow Solid Geology (British Geological Society, 1993)
- British Geological Society (BGS) Scotland Map Sheet 30E, Scale 1:50,000 Glasgow Solid Geology (British Geological Society, 1994)
- BGS GeoIndex Online Map Viewer (British Geological Society, 2020)

2.2 Current Setting

The development site is indicated within boundary A in the figure below. Most of the site is currently vacant, having undertaken demolition of the previous hospital building in the west, and previous buildings in the north-east.

Figure 2.2 on the following page shows the approximate site boundary.

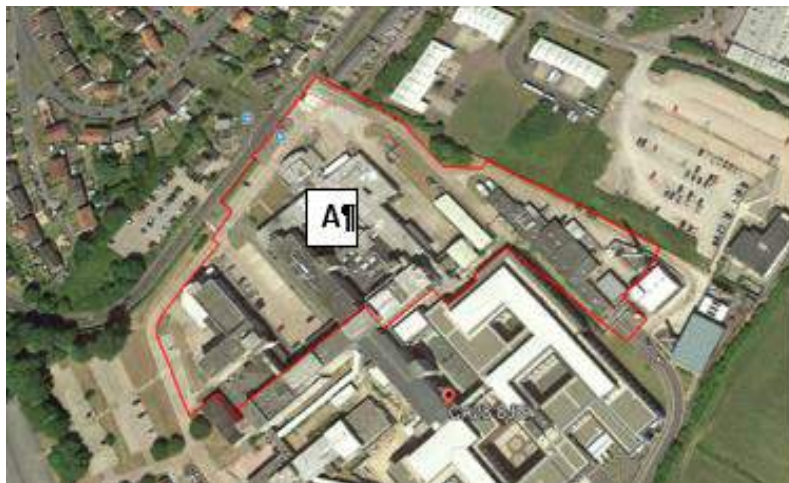


Figure 2.2 Site Location Plan (approx. site boundary shown in pink), centred on National Grid Reference NS 298950, 516040.

The surrounding land use is summarised in *Table 2.2*.

Table 2.2 Surrounding Land uses

Surrounding Area	N	Homewood road and mixed commercial and residential properties.
	E	Buildings associated with West Cumberland Hospital and open fields with a helipad.
	S	Residential properties and fields.
	W	Residential properties.

2.3 Previous Site Use

A summary of the review of the historical maps undertaken within the Curtins Phase 1 report is provided below:

- **Table 2.3** – Previous Site Uses and Potential Sources of Contamination

Date	Description	Potential Sources of Contamination
1865-1957	The subject site is spread across several bounded fields. Three trees are present on the western boundary.	N/A
1961-1963	West Cumberland Hospital is first identified. The previously mentioned trees have been removed. A rectangular building is constructed in the eastern corner of the site as per present day as is a secondary rectangular building that is built parallel. A footpath provides access to these buildings from Homewood Road. A chimney is shown on the east of the site.	Uncontrolled deposition of Made Ground from construction onsite.

Date	Description	Potential Sources of Contamination
1965-1968	<p>A large phase of development occurs between O.S. publications and West Cumberland Hospital largely resembles the same general layout as per present day.</p> <p>Construction of numerous buildings, many remain till present day. A row of 8No. square buildings are orientated toward NW-SE in the north west of the site. Several trees are planted along the north eastern site boundary.</p>	Uncontrolled deposition of Made Ground from construction / demolition onsite.
1999	<p>The site remains largely unchanged.</p> <p>The row of square structures previously mentioned appears to have been demolished in the north west of site and replaced by car parking.</p>	Uncontrolled deposition of Made Ground from construction / demolition onsite.
1999-2019	Site remains largely unchanged until present day.	N/A

The contaminants, likely to be present from the historic site and surrounding area uses, include but are not limited to: asbestos within construction materials, petroleum hydrocarbons from localised fuel spillages, and inorganic compounds including heavy metals.

No significant geo-hazards have been previously recorded.

2.4 Geology and Hydrogeology

The British Geological Society (BGS) 1:50,000 maps and the BGS historic exploratory holes have been reviewed. A summary of the anticipated ground conditions is provided in *Table 2.4*.

Table 2.4 *Geological/Hydrogeological Succession*

Geology	Associated Hydrogeological Classification
Till, Devensian ¹	Secondary Undifferentiated ²
Hensingham Grit ³	Secondary A Aquifer ⁴
Stainmore Formation ⁵	Secondary A Aquifer ⁴

Notes:

1. *Diamicton. Superficial Deposits formed up to 2 million years ago in the Quaternary Period. Local environment previously dominated by ice age conditions.*
2. *Assigned in cases where it has not been possible to attribute either category A or B to a rock type*

3. Sandstone. Sedimentary Bedrock formed approximately 328 to 329 million years ago in the Carboniferous Period. Local environment previously dominated by rivers.
4. Permeable layers capable of supporting water supplies at a local rather than strategic scale, and in some cases forming an important source of base flow to rivers. These are generally aquifers formerly classified as minor aquifers.
5. Mudstone, Siltstone and Sandstone. Sedimentary Bedrock formed approximately 319 to 329 million years ago in the Carboniferous Period. Local environment previously dominated by swamps, estuaries and deltas.

2.4.1 BGS Data

A review of the available online BGS borehole records did not record any historic boreholes on site, however historical boreholes were identified immediately adjacent to the site. These were summarised within the Curtins Phase 1 Preliminary Risk Assessment and are presented in *Table 2.4.1*.

Table 2.4.1 Summary of BGS Historic Boreholes

Reference	Location (NGR)	Details (depth to top of strata/details/thickness)
NX91NE50/52	298730, 515980	0.40m bgl, Topsoil 3.75m bgl, Broken sandstone and sandy clay. 4.50m bgl, Grey sandstone. Borehole completed at 4.50m bgl.
NX91NE/80	299061, 516308	0.00m bgl, Firm to stiff brown sandy boulder clay. 1.50m bgl, Stiff brown sandy boulder clay. 3.20m bgl, Soft brown sandy clay and grey shale. 5.00m bgl, Dark grey weathered shale. <i>5.00m Borehole completed</i>
NX91NE381	299890, 515910	0.00m bgl, Sandy gravelly cobbly clay. 6.70m bgl, Sand and gravel with cobbles and boulders. 8.35m bgl, Dark reddish-brown sandstone. 18.00m bgl, Dark red sandy clayey siltstone. <i>Borehole continues to 120m bgl prior to termination.</i>

2.5 Hydrology

The nearest surface water feature is located 264m south west of the site. Which appears to relate to a small drain.

There are 17No. discharge consents within 1km of the site. The closest is 390m north east of the site and is operated by Copeland Athletic Stadium Trust for the discharge of surface water into a freshwater stream/river.

There are no surface water abstraction points recorded within 1km of the subject site.

There are 21 pollution incidents to controlled waters within 1km of the site. The closest refers to a Category 3 – Minor incident which occurred in March 1992, 278m to the north west of the site relating to unknown oils being discharged into the Irish Sea catchment area.

2.6 Mining

There are 21 No. BGS Recorded Mineral Sites within 1km of the site. The closest refers to the aforementioned Overend Quarry approximately 200m east of the site.

The site is within a known coal mining region, however, is not located within a development high risk area associated with potential zone of influence of surface or subsurface coal workings.

Based on the foregoing commentary, it is not considered there is a risk to the site from previous mining and mineral extraction activities; it is therefore not considered further.

2.7 Unexploded Ordnance

Risk mapping for UXO's has placed the site in a low-risk area. Low-risk areas are indicated as having 15 bombs per 1000 acre or less. In low risk areas, it may not be essential to undertake a detailed UXO risk assessment. Furthermore, no evidence of ruins is noted in post war mapping on site or in the surrounding area and there are no locally significant targets noted prior to or during WW2.

On this basis the risk from UXO is considered to be Low and no further assessment is required at this stage.

2.8 Ground Gas

There is a single (1No.) BGS Recorded Landfill Site entry 198m NE from the site, this refers to Overend Tip (former quarry).

There are 3No. Historic Landfill Site records within 830m of the site. The two closest refer to Overend Quarry approximately 200m north east of the site.

There are 3No. records of Potentially Infilled Land (non-water) within 1km of the site. The closest is 377m east of the site referring to unknown filled ground (pit, quarry, etc) in 1979.

There are 20 records of Potentially Infilled Land (water) within 1km of the site. A single entry is located within the site boundaries referring to unknown filled ground (pond, marsh, river, stream, dock, etc).

Two (2No.) Registered Landfill Sites are identified within the environmental database report. The closest is 195m north east of the site and also refers to Overend Quarry. The license is operated by Copeland B.C. for the disposal of gully waste and road sweepings.

The BGS Radon Mapping (4) confirms the site is situated in a lower probability radon area where <1% of homes are at or above the radon action level. On this basis radon protection measures are not considered necessary in the construction of new dwellings or extensions.

3.0 Conceptual Site Model & Qualitative Risk Assessment

The Preliminary Conceptual Site Model (PCSM) and Qualitative Risk Assessment (QRA) are presented in the table within this section.

The PCSM details the source-pathway-receptor linkages or potential contaminant linkages (PCLs) that have been identified for the site. The QRA details the associated level of risk relating to these PCLs.

The PCSM and QRA concern the major risks to human health and the water environment with additional, more specific risk assessment protocols contained within the main body of this reporting, as detailed in Section 3.1 below.

The QRA follows the framework outlined within CIRIA C552 which is summarised within Appendix H.

The 'risk rating' within the QRA refers to the risk that the source, pathway, receptor linkage or PCL is complete. Unless specifically stated it does not necessarily refer to an immediate risk and is intended to be used as a tool to assess the necessity for further assessment/investigation.


3.1 Additional Risk Assessments

The following risk assessments, listed below, are not included within the main CSM and QRA but none-the-less can be of critical importance to the onward development of the site.

- The risk presented by **Mining and Mineral Extraction** is discussed and assessed in Section 2.6.
- The risk presented by **Radon** is discussed and assessed in Section 2.8.
- The risk presented by **Unexploded Ordnance** is discussed in Section 2.7.

Under current health and safety legislation, employers are required to carry out their own appropriate risk assessments and mitigation to protect themselves and their employees, other human receptors and the environment from potential contamination. Such risks must be adequately mitigated by law, specifically the Construction Design Management (CDM) Regulations, 2015 which require that potential risks to human health and the environment from construction activities are appropriately identified and all necessary steps taken to eliminate / manage that risk.

It has been assumed that any future construction works on site will be undertaken in compliance with these requirements and therefore construction workers involved in the building works at the site have been discounted as a human receptor in the conceptual site model.

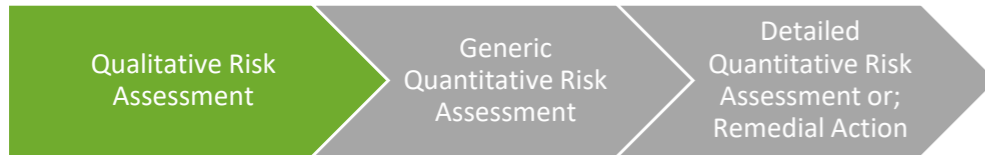

- The table below represents the first stage in the land quality risk assessment process; **the Qualitative Risk Assessment**.
- In order for a development site to be deemed 'suitable for use' the level of risk needs to be brought down to acceptable levels, i.e. low to negligible risk. The purpose of each stage of risk assessment is ultimately to establish if there is a requirement for additional levels of assessment to be made in order to have sufficient confidence to support a risk characterisation or management decision, e.g. remedial action.

Conceptual Site Model			Qualitative Risk Assessment			Recommended Actions
Source	Pathway(s)	Receptor(s)	Consequence	Likelihood of Occurrence	Risk Rating	
<p>Made Ground of unknown composition from uncontrolled deposition of construction / demolition materials on site.</p> <p>Localised contamination within potential chimney base on site.</p>	<p>Direct contact, ingestion, inhalation (dust and vapours)</p>	<p>End-user of site & Construction Workers</p>	<p>Medium</p> <p>Chronic health risk</p>	<p>Low Likelihood</p> <p>Minimal phases of historic development and minimal significant sources of contamination identified.</p> <p>Construction Workers will be protected further by appropriate PPE and Health & Safety Measures.</p>	<p>Moderate / Low</p>	<p>Generic Quantitative Risk Assessment</p> <p>Contamination testing is recommended as part of the ground investigation.</p>
	<p>Vertical migration through the superficial deposits (soils)</p> <p>May occur due to existing service corridors and physical processes including; capillary action and downwards into the natural deposits through infiltration.</p>	<p>Controlled Waters (groundwater)</p> <p>High vulnerability of superficial Principal Aquifer.</p> <p>Secondary A Aquifer of bedrock.</p> <p>No groundwater abstraction points within 1km & the site is not within a designated Source Protection Zone.</p>	<p>Medium</p> <p>Pollution of sensitive water resources</p>	<p>Unlikely</p> <p>Widespread contamination is not anticipated given the limited site history and lack of industrial land use.</p> <p>Superficial Till deposits anticipated to have a low infiltration capacity.</p> <p>The risk to the aquifer is considered low due to no SPZ or abstraction points.</p>	<p>Low</p>	<p>Generic Quantitative Risk Assessment</p> <p>No further action required unless visual or olfactory evidence of significant contamination is encountered on site, in this case groundwater testing is recommended.</p>
	<p>Horizontal migration over and through the superficial deposits (soils)</p>	<p>Controlled Waters (surface water)</p> <p>There are no surface water courses within 250m of the site.</p>	<p>Medium</p> <p>Pollution of sensitive water resources</p>	<p>Unlikely</p> <p>Considering the considerable distance from the site to the nearest surface water feature, it is considered unlikely that any contamination would migrate to surface water receptors.</p>	<p>Low</p>	<p>No further action required.</p>
<p>Production of ground generating gases from surrounding areas of known infilled land (water and non-water).</p>	<p>Vertical and horizontal migration through existing service corridors and the underlying superficial deposits</p>	<p>End-user of site</p>	<p>Medium</p> <p>Human health risk</p>	<p>Low</p> <p>Numerous sources of possible ground gas identified in area surrounding site. Gas migration may be limited by superficial Glacial Till deposits.</p>	<p>Moderate/ Low</p>	<p>Generic Quantitative Risk Assessment</p> <p>Ground gas monitoring to confirm risk following the recommended ground investigation.</p>

4.0 Field and Laboratory Studies

4.1 Ground Investigation

Curtins Ground investigation was undertaken in December 2020 with additional drilling works undertaken in March 2021 and in August 2021 following enabling works. The scope of the ground investigation was designed in general accordance with current UK guidance including:

- LCRM (Environment Agency, 2020)
- British Standard (BS) 10175 (British Standards Institution, 2017)
- BS5930:2015 (British Standards Institution, 2010)
- BSEN1997: Part 2:2007 Eurocode 7A (British Standards Institution, 2007)

The scope of the works and rationale is summarised in **Table 4.1**.

Table 4.1 Scope and Rationale of Fieldwork Undertaken

Stage of Works	Exploratory Hole Type	Exploratory Hole Reference	Exploratory Hole Depth (m bgl)	Rationale
December 2020	Windowless Sampling Boreholes	WS01	3.65	<ul style="list-style-type: none"> • Confirm shallow ground conditions. • Undertake in-situ testing. • Collect soil samples for chemical and geotechnical analysis
		WS02	3.65	
		WS03	1.90	
		WS04	2.20	
		WS05	2.50	
		WS06	1.80	
		WS07	2.20	
December 2020	Cable Percussion / Rotary Cored Boreholes	BH01	11.00	<ul style="list-style-type: none"> • Confirm ground conditions. • Collect soil and water samples for chemical and geotechnical analysis. • Undertake in-situ testing. • Gas and groundwater level monitoring.
		BH02A	17.30	
		BH03	13.00	
		BH04	13.00	
		BH05	13.00	
		BH06	12.00	
March 2021	Open Hole Rotary Boreholes	BH07	12.00	<ul style="list-style-type: none"> • Confirm ground conditions within vicinity of BH02A to confirm no voiding present.
		BH08	12.00	
		BH09	12.00	
March 2021		DCP01	1.00	
		DCP02	1.00	

Ground Investigation Report

Stage of Works	Exploratory Hole Type	Exploratory Hole Reference	Exploratory Hole Depth (m bgl)	Rationale
	Dynamic Cone Penetrometer Test	DCP03	1.00	<ul style="list-style-type: none"> Obtain CBR values for proposed road/pavement design.
		DCP04	1.00	
		DCP05	1.00	
		DCP06	1.00	
		DCP07	1.00	
August 2021	Additional Windowless Sampling Boreholes	BH21	2.00	<ul style="list-style-type: none"> Confirm shallow ground conditions to inform contractor's retaining wall design.. Undertake in-situ testing. Collect soil samples for additional geotechnical analysis.
		BH22	2.90	
		BH23	0..20	
		BH24	3.00	
August 2021	Machine Excavated Trial Pits (inc Soakaway Infiltration Tests)	TW TP01	1.40	<ul style="list-style-type: none"> Confirm shallow ground conditions to inform contractors temporary works design. Collect soil samples for additional geotechnical analysis. Confirm estimated infiltration rates within shallow soils.
		TW TP02	1.05	
		TW TP03	1.90	
		TW TP04	1.80	
		SA01	0.95	
		SA02	1.65	
August 2021	Hand Dug Foundation Inspection Pits	HD01	0.83	<ul style="list-style-type: none"> Confirm foundation design for existing building. Complete hand drawn sketches of any observed foundations.
		HD02	1.65	
		HD02A	N/A	
		HD03	0.50	
		HD04	0.30	
		HD05	N/A	
August 2021	Concrete Cored Inspection Pits	CO1	0.25	<ul style="list-style-type: none"> Determine thickness of existing concrete on the site.
		CO2	0.25	

For the exploratory hole locations refer to Curtins Drawings Ref: 073096-CUR-VV-XX-DR-C-04004 and -CUR-00-XX-DR-GE-001-V01, Appendix A.

Graham Construction provided a Specification of works to be undertaken as part of August 2021 works Ref. Ground Investigation Specification – West Cumberland Hospital, ref. EJ20-GCL-TW-XX-SP-0006-C01.

Ground Investigation Report

The exploratory holes were logged on site by an engineer from Curtins in accordance with the requirements of BS5930:2015, including recording of any observed visual and olfactory indications of contamination.

Copies of the exploratory hole logs are provided within Appendix B.

4.1.1 In-Situ Tests

The in-situ testing undertaken during the initial ground investigation works and additional ground investigation works is summarised in *Table 4.1.1*.

Table 4.1.1 *In-Situ Testing*

Activity	Rationale
SPT tests within window sample boreholes	To obtain in-situ density and investigate bedrock profile across the site.
Rotary coring within rotary boreholes	To obtain Rock Quality Designation (RQD) values of intact bedrock
Additional SPT tests within window sample boreholes	To obtain in-situ density and investigate bedrock profile across the site.

4.2 Laboratory Analysis

Representative soil samples were obtained for laboratory geotechnical and geochemical testing, based on the field observations. Additional samples for testing were obtained in specific locations on the proposed working platform (TW TP01, TW TP02, TW TP03, TW TP04 and BH21) on the site at the request of Graham Construction in line with their Specification (Ref. EJ20-GCL-TW-XX-SP-0006-C01), to further investigate the geotechnical parameters of the granular made ground.

Soil samples for geochemical analysis were placed in appropriate laboratory provided containers and stored in temperature-controlled conditions prior to being transported to a UKAS accredited laboratory under chain of custody documentation.

The representative rock samples were collected and scheduled for laboratory geotechnical testing. Geotechnical samples were transported to a UKAS and MCerts accredited laboratory under chain of custody documentation for testing.

4.2.1 Geo-environmental – Soils

Soil samples were taken from shallow ground across the site, and 13 made ground samples from across the site were tested for a broad environmental suite as detailed below.

Ground Investigation Report

The contaminants of concern potentially present on the site was considered to include, amongst others; organic matter, ash and fill, hydrocarbons (e.g. fuel/oils), heavy metals and asbestos the extent of which is captured by the broad environmental testing suite listed in *Table 4.2.1*.

Table 4.2.1 *Environmental Chemistry Analysis Suite : Soils*

Suite Ref.	Analyte	LOD
Soils Suite A	Asbestos Screen, pH and Soil Organic Matter (SOM)	N/A
	Arsenic, Chromium, Chromium VI, Copper, Lead, Selenium, Zinc, Nickel	1 mg/kg
	Boron (water soluble)	0.2 mg/kg
	Cadmium	0.2 mg/kg
	Mercury	0.3 mg/kg
	Cyanide (total)	1 mg/kg
	Phenols (screen)	<0.1 – 0.3 mg/kg
	PAHs (USEPA 16)	0.05 mg/kg
	TPH (Aro/Ali Split)	0.01 to 10 mg/kg

Copies of the environmental chemistry testing certificates are presented in Appendix C.

4.2.2 Geo-environmental – Groundwater

Groundwater samples were taken from the wells installed in BH01, BH03 and BH06 during the second monitoring visit and were scheduled for a specific groundwater suite listed in *Table 4.2.2*.

Table 4.2.2 – *Environmental Chemistry Analysis Suite: Waters*

Suite Ref.	Analyte	LOD
Water Suite A	pH	-
	Total Hardness	1 mg/l
	Arsenic, Lead, Nickel, Selenium, Zinc	1 µg/l
	Boron (water soluble), Chromium, Copper, Mercury, Phenols (screen)	0.1 µg/l
	Cadmium	0.5 µg/l
	Cyanide, Sulphide	0.2 mg/l
	Sulphate	10 mg/l

Suite Ref.	Analyte	LOD
	PAHs (USEPA16)	0.01 µg/l
	TPH (Aro/Ali Split)	10 µg/l

Copies of the environmental chemistry testing certificates are presented in Appendix C.

4.2.3 Geotechnical

Soil samples for testing were prepared in accordance with BS1377 (British Standards Institution, 2016). The following geotechnical tests have been undertaken:

- 1 No. Particle Size Distribution Test;
- 29 No. Point Load (PL) Tests; and
- 13 No. Unconfined Compression Strength (UCS) Test.

Additional soil samples for testing were sent for testing as part of the August 2021 ground investigation works. The following additional geotechnical tests have been undertaken in line with Graham Construction's Specification to further characterise granular made ground and inform possible material classification by Graham Construction:

- 4 No. Particle Size Distribution Tests;
- 4 No. Los Angeles Coefficient N Tests;
- 3 No. Compaction (Vibrating Hammer) Tests; and
- 3 No. direct (large) Shear Box Tests; tested at normal stress(es) of 50, 100, and 200 kPa.

Copies of the geotechnical testing certificates are presented within Appendix D.

4.3 Monitoring Well Installations

Single installations comprising 50mm diameter standpipes have been installed in BH01, BH02A, BH03, BH04, BH06, WS03 and WS05, for the purposes of gas and groundwater monitoring.

A bentonite seal was placed above the screened section of the boreholes to minimise potential for migration of contaminants and the creation of a preferential migratory pathway. A gravel surround was installed in the annulus between the sides of the borehole and the slotted sections of pipe.

The installations are summarised in *Table 4.3*.

Table 4.3 *Monitoring Well Response Zones*

Borehole Ref.	Diameter (mm)	Response Zone (m bgl)	Strata Description(s)
BH01	50	2.0-11.0	Sandstone
BH02A	50	8.0-12.0	Sandstone
BH03	50	3.0-13.0	Sandstone
BH04	50	4.0-13.0	Sandstone
BH06	50	2.0-12.00	Sandstone
WS03	50	1.0 – 2.0	Made Ground
WS05	50	1.0 – 2.0	Made Ground

Copies of borehole logs can be referred to in Appendix B of this report.

4.3.1 Post-Investigation Monitoring

Six rounds of groundwater and ground gas monitoring over a three-month period have been completed, to assess the groundwater and ground gas conditions, identified in the Preliminary Conceptual Site Model within the Phase 1 Preliminary Site Assessment.

5.0 Ground Conditions

5.1 General

The updated ground conditions encountered during the Curtins Ground Investigation and during the additional post demolition ground investigation is summarised in *Table 5.1*, with detailed information presented on the exploratory hole logs, Appendix B.

Table 5.1 Ground Conditions Summary

Stratum	Depth to top of strata (m bgl)	Thickness (m)	
		Min	Max
Topsoil	0.0	0.40	-
Concrete	0.0	0.20	
Made Ground	0.0	0.18	3
Residual Soils	0.4 – 0.80	2.8	3.25
Bedrock: Hensingham Grit	0.2-3.65	-	

5.2 Topsoil

Topsoil was encountered within a single location (WS02) comprising a dark brown slightly silty fine and medium SAND. The material was encountered to 0.40m bgl.

Topsoil was not encountered in any of the August 2021 exploratory holes (BH21 to BH24, TW TP01 to TW TP04, and HD01 to HD05).

5.3 Made Ground

Made Ground deposits were encountered in all of the exploratory holes (with exception of WS02), to base depths ranging from 0.18m bgl (BH23) to 2.50m bgl (WS05). The Made Ground generally comprised a predominate upper layer of granular material with demolition material and the deeper Made Ground encountered as a cohesive material, likely reworked material.

Concrete surface cover was encountered in the areas of CO1 and CO2, the concrete was recorded at 0.20m in thickness overlying Made Ground subbase material.

Ground Investigation Report

Granular Material

The granular material comprised light brown sand and gravel with gravel of sandstone, breeze block, wood, plastic, metal and cloth fragments. This unit was predominately encountered to circa 1.0m to 2.20m bgl.

August 2021 Investigation- Granular Soils

During August 2021 ground investigation works similar granular material was encountered to depth of between 0.18m (BH23 and SA01) to 1.90m bgl (TW TP03). Samples were obtained of this material in BH21 and in TW TP01 to TW TP04 from various depths for additional geotechnical testing with the results summarised below. Particle Size distribution tests were conducted on all of the above samples and the results are presented below in Table 5.3a and Table 5.3b and graphs present in Figure 5.3a.

Table 5.3a Summary of geotechnical test results– Granular Made Ground

Test	No. of tests	Minimum	Maximum	Average
In situ				
SPT 'N' Value	2	6	7	6.5
Laboratory Testing				
PSD (% Dry Mass)				
Cobbles		0	16	
Gravel	5	46	58	-
Sand		18	31	
Silt/Clay		8	17	

Table 5.3b – Granular Made Ground Particle Size Distribution

Exploratory Hole Location	Depth (m bgl)	Percent Passing (%)					Uniformity Coefficient
		125	75	10	2	0.063	
BH21	0.5	100	89	38	26	8	350
TW TP01	0.5	100	100	59	42	14	>170
TW TP02	0.3	100	98	48	94	7	3.4
TW TP03	0.9	100	92	53	45	14	>260
TW TP04	1.4	100	100	59	47	17	>170

Only two SPT 'N' values were recorded in the granular Made Ground strata as part of the August 2021 investigation, ranging between 6 and 7. The greatest value was recorded in BH21 at 1.20m bgl, however the results generally correlate with loose sands and gravels.

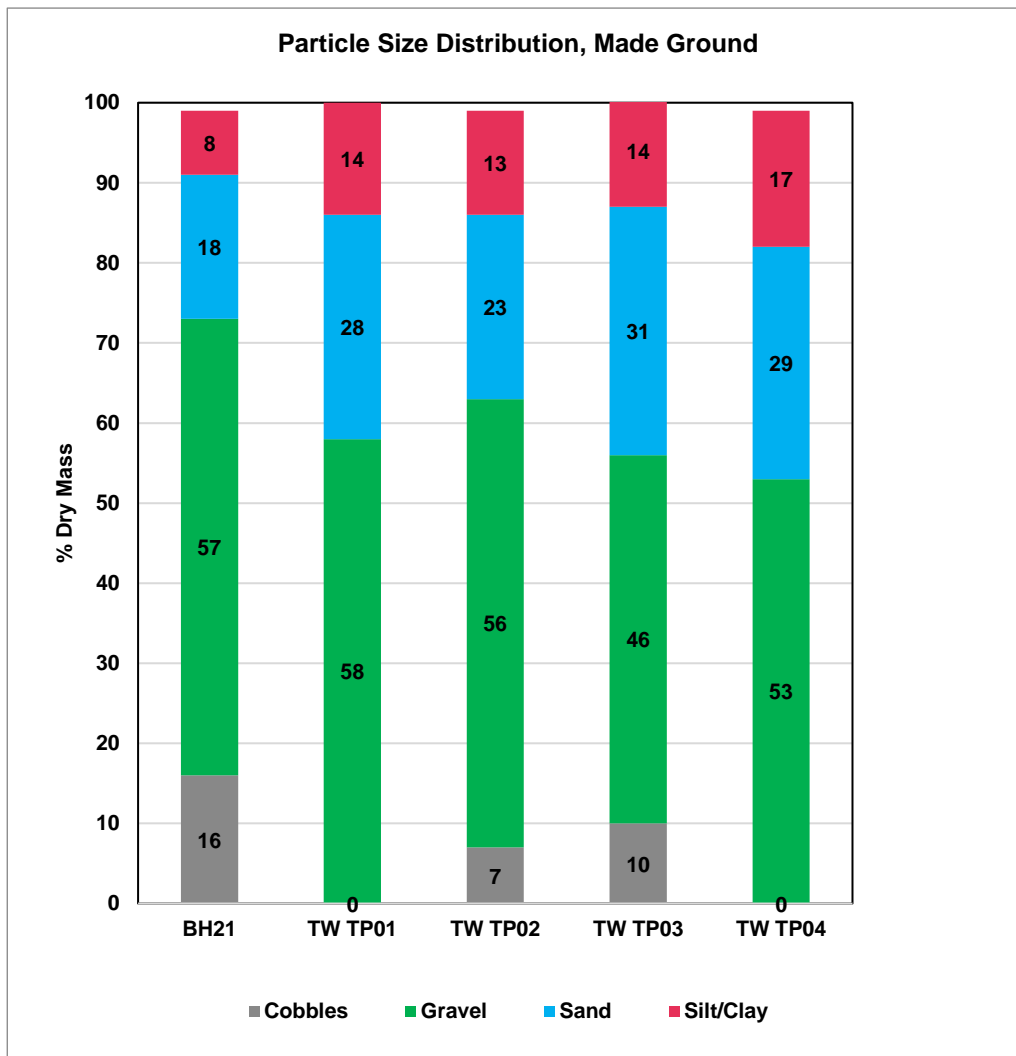


Figure 5.3a – Summary of PSD test results in Made Ground.

Uniformity coefficients generally have tested as being greater than 170.

Natural moisture content (MC) and Optimum Moisture Content (OMC) tests have been undertaken on made ground samples obtained on site with the results summarised in Table 5.3c and Figure 5.3b.

Table 5.3c – Made Ground Moisture Content

Exploratory Hole Location	Depth (m bgl)	Moisture Content %
TW TP01	0.5-0.6	10
TW TP02	0.3-0.4	10
TW TP04	1.40-1.50	14

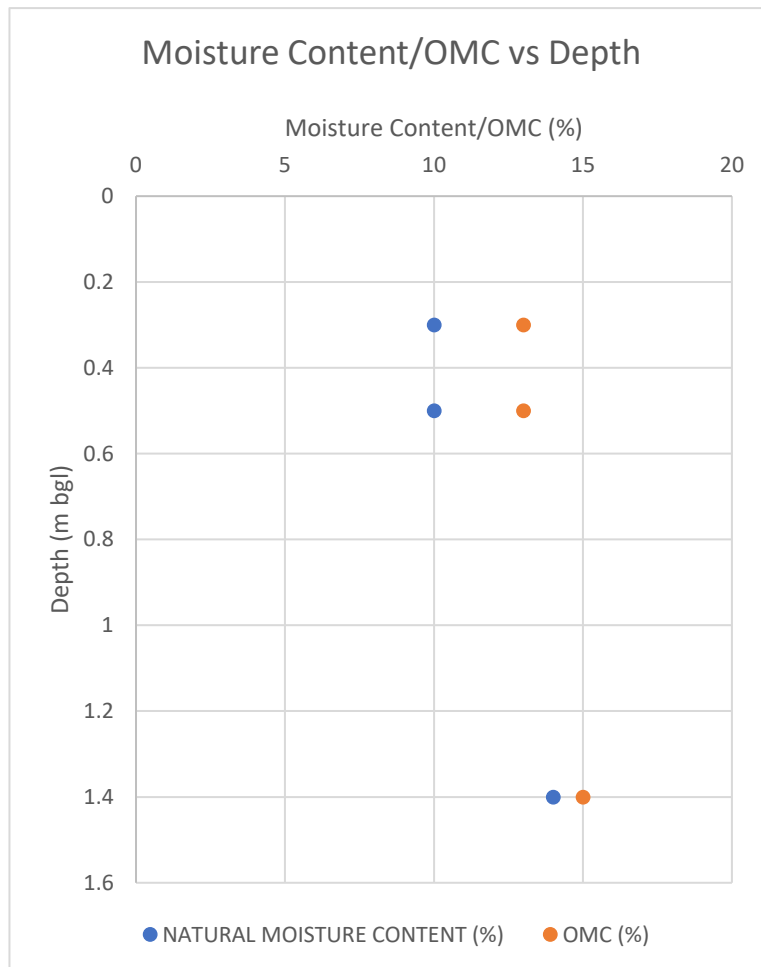


Figure 5.3b – Made Ground Moisture Content and OMC vs. Depth

In summary:

- The OMC for TW TP01 is 13%.
- The OMC for TW TP02 is 13%.
- The OMC for TW TP04 is 15%.
- The Maximum Dry Density (DD) for TW TP01 is 1.91mg/m³.
- The Maximum Dry Density (DD) for TW TP02 is 1.90mg/m³.
- The Maximum Dry Density (DD) for TW TP04 is 1.79mg/m³.
- OMC has been achieved between 5% and 10% air voids for TW TP04.

For detailed graphs in geotechnical test reports refer to Appendix D.

The Los Angeles Coefficient of the granular Made Ground samples has been used to characterise determination of resistance to fragmentation in accordance with BS EN 1097-2:2020. Three LA Coefficient tests were undertaken within the Made Ground, and the results are summarised in Table 5.3d.

Table 5.3d– Made Ground Los Angeles Coefficient

Exploratory Hole Location	Depth (m bgl)	LA Coefficient (%)
TW TP01	0.5	57
TW TP02	0.3	59
TW TP04	1.4	64

As shown in Table 5.3d the range of Los Angeles Coefficient ranges from 55 to 65%.

Full details of the results of Los Angeles Coefficient testing are presented in Appendix D.

The Angle of Shearing Resistance has been determined using a Shear Box for granular Made Ground samples in accordance with BS EN 1377 1990. Three Shear Box tests were undertaken within the Made Ground and the results are summarised in *Table 5.3e*.

Table 5.3e– Made Ground Angle of Shearing Resistance

Exploratory Hole Location	Depth (m bgl)	Angle of Shearing Resistance
TW TP01	0.5	46.5
TW TP02	0.3	43
TW TP04	1.4	45

Cohesive Material

The cohesive Made Ground was typically encountered to underlie the granular material and was considered to be reflective of reworked residual soils. The unit comprised a brown sandy gravelly clay with gravel of sandstone, wood, brick and nails. This material was typically encountered prior to intact bedrock.

August 2021 Investigation- Cohesive Soils

Cohesive Made Ground material was only encountered in the August 2021 ground investigation works in the areas of BH21, BH22 and BH24. Cohesive Made Ground was recorded to underlie the granular material in BH21 and BH22 at depths from 1.50m to 2.40m bgl. BH24 encountered cohesive material from ground level to 3.0m bgl consisting of sandy gravelly clay with a medium cobble content.

Table 5.3e Summary of geotechnical test results – Cohesive Made Ground

Test	No. of tests	Minimum	Maximum	Average
In situ				
SPT 'N' Value	4	5	30	16

On-situ SPTs within the made ground indicate a highly variable stratum as shown in Figure 5.3c

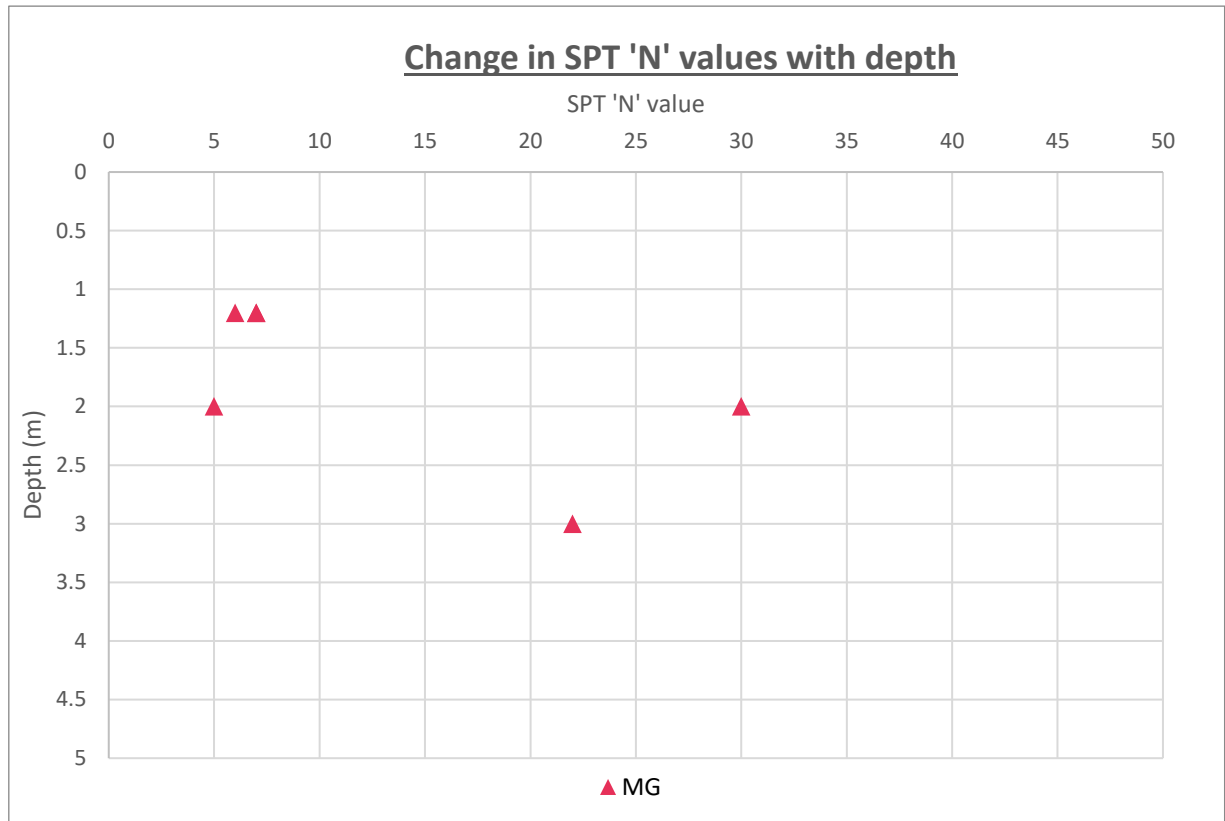


Figure 5.3c – Graph showing changes in SPT results with depth in Made Ground.

Due to the small cohort of results within both cohesive and granular Made Ground, the graph above shows highly variable strength within Made Ground material with depth but does generally increase with depth.

5.4 Residual Soils

Residual soils were encountered locally within north-western to south-western area of the site within WS01 and WS02. These were encountered to underlie either Topsoil or Made Ground at shallow depths (<0.80m bgl) to depths of 3.65m bgl.

The residual soils were recorded as both granular and cohesive material. The cohesive material comprised a stiff brownish red sandy slightly gravelly CLAY, whilst granular material comprised a medium dense light brown slightly clayey gravelly fine to coarse SAND. The geotechnical test results recorded within the residual soils are summarised in *Table 5.4*. However, given the localised area of these deposits on-site, no geotechnical parameters have been derived for this unit.

Residual soils were only encountered in the area of BH21 during the post demolition works from 1.70 to 1.95m bgl comprising light brown sandy gravelly CLAY. Given the localised area of these deposits on-site, no geotechnical parameters have been derived for this unit.

Table 5.4 Summary of geotechnical test results – Residual Soils

Test	No. of tests	Minimum	Maximum	Average
In-situ				
SPT 'N' Value (cohesive)	3	20	38	30
SPT 'N' Value (granular)	1	22	-	-

5.5 Bedrock

Bedrock has been encountered within all of the rotary boreholes, comprising sandstone to circa 10.0m bgl with Limestone thereafter within BH01, BH02 and BH06 all within the northern portion only. The sandstone is described Medium strong light brownish grey coarse grained crystalline SANDSTONE with rare microlite coal laminations. The Limestone was described as Strong light whitish grey crystalline LIMESTONE. Small pyritic inclusions noted and common quartz veins throughout.

Bedrock was encountered at shallow depths within most of the exploratory boreholes during the post demolition ground investigation comprising medium to coarse grained crystalline SANDSTONE with varied weathering and fracturing and occasional clay infill from depths of 0.18m (BH23) to 2.40m bgl (BH22). In situ SPT results recorded refusals (SPT N = 50) in presumed bedrock of SANDSTONE in BH21 at 2.0m bgl and BH22 at 2.45m bgl. Due to the small cohort of results, no parametric analysis has been undertaken from SPT results from the post demolition exploratory boreholes.

It is noted that during drilling of BH02A, a significant reduction in RQD was noted at the apparent limestone interface at approximately 9m bgl. Three additional boreholes (BH07 – BH09) were advanced approximately 5m from BH02A in different directions in March 2021, to investigate whether this potentially arose due to presence of voids. Locations of additional boreholes are presented within Appendix A.

It is noted that within all three locations broken sandstone was encountered from approximately 9m bgl to and at the beginning of the limestone bedrock interface. During groundwater monitoring visits, groundwater was recorded within the bedrock at BH02A at approximately 11m bgl, at levels coinciding with the weakened/fractured bedrock.

As such, it is anticipated that this is reflective of a geological fault with noted reduction of the RQD at the interface between sandstone and limestone within this area and/or weakened/fractured bedrock coinciding with a groundwater bearing unit, rather than voiding.

Ground Investigation Report

The geotechnical test results recorded within the sandstone are summarised in *Table 5.5a*. The test result certificates are included within Appendix D. At this stage, no geotechnical test results or parameters have been derived for the Limestone owing to localised area on-site.

Table 5.5a Summary of geotechnical test results – Sandstone

Test		No. of tests	Value	
In-Situ				
RQD (%)		57	Min: 0* Max: 100 Average: 86	
Laboratory				
Point Load Test	Point Load Strength Index (I _{s50}) (MPa)	28	Diametral	Min: 0.48 Max: 6.94 Average: 2.19
		28	Axial	Min: 0.53 Max: 5.55 Average: 2.26
UCS (MPa)		12	Min: 26.6 Max: 50.7 Average: 37	

Notes - *At the interface between the sandstone and limestone

UCSs were determined from the Unconfined Compressive Strength (UCS) test results and Point Load test results. A factor of 20 has been used to correlate the I_{s50} determined from the Point Load tests to the UCS, Figure 5.5.

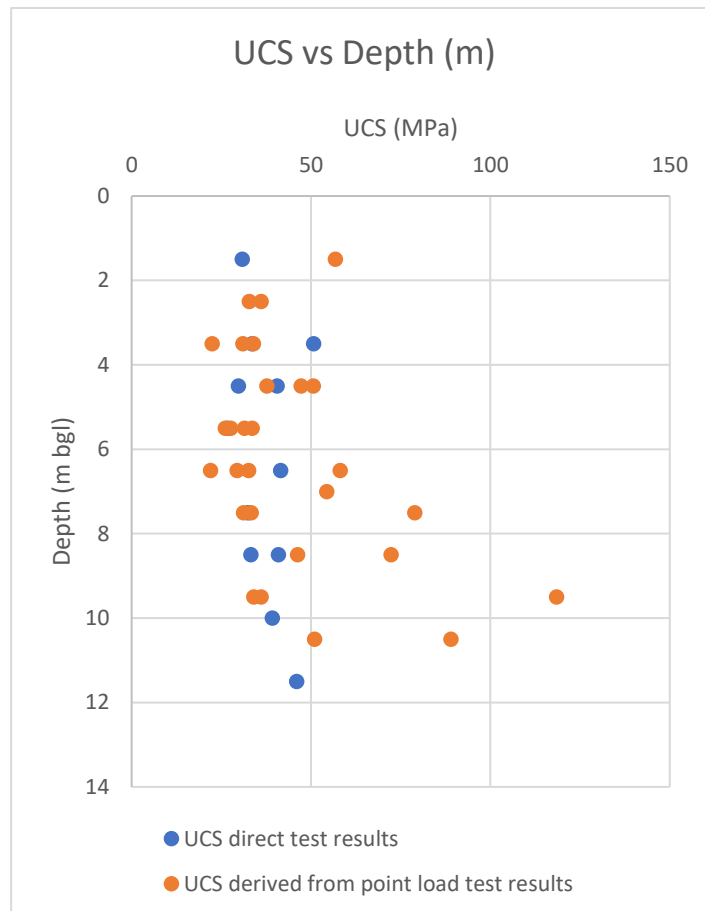


Figure 5.5 UCS vs. Depth

5.6 Observed Potential Contamination

No potential contamination was noted within the soils/groundwater.

5.7 Groundwater

Perched groundwater was encountered within the Made Ground during the investigation ranging from 0.50m (WS03) to 2.10m bgl (BH05). A single groundwater strike was recorded within the residual deposits of WS01 at 2.10m bgl.

Groundwater was not encountered during the post demolition ground investigation exploratory holes.

Groundwater monitoring wells were installed as summarised in *Table 5.7*.

Six rounds of groundwater monitoring have been undertaken to assess the groundwater regime across the site.

Table 5.7 Groundwater Monitoring Results

Borehole Ref.	Installation Strata	Depth (m bgl)				
		07/01/21	20/01/21	04/02/21	17/02/21	08/03/21
BH01	Sandstone / limestone	0.77	0.00	0.0	0.65	0.99
BH02A		*	11.20	10.80	11.09	11.00
BH03		1.97	0.98	1.57	1.96	1.91
BH06		0.66	0.0	0.0	0.04	0.75
WS03	Made Ground	0.40	0.00	0.0	0.0	*
WS05		2.05	1.02	1.63	1.96	1.95

Notes - *Unable to be accessed

It is considered that perched water exists within the Made Ground as noted within WS03 and WS05, at depths of 0.0m to 2.05m bgl.

The installations within the sandstone (BH01, BH03 and BH06) installed within the underlying bedrock has recorded shallow groundwater, at depths of between 0.0m to 1.96m bgl, with locally deep groundwater of 10.80m to 11.20m bgl within BH02A indicating the groundwater within the bedrock aquifer is under an element of hydrostatic pressure.

5.8 Aggressive Ground Conditions

The classification of the site in terms of concrete in aggressive ground is based on the guidance provided in Table C2 of the Building Research Establishment (BRE) Special Digest 1, third edition of 2017 (Building Research Establishment, 2017). *Table 5.7* details the classification.

Table 5.8 Aggressive Chemical Environment for Concrete (ACEC) Site Classification

Stratum	Design Sulphate Class	ACEC Class *
Made Ground	DS-2	AC-2

* ACEC assessment was based on the mobile groundwater condition for the scheme area

5.9 Dynamic Cone Penetrometer Tests

Seven dynamic cone penetrometer tests were advanced to approximately 1.00m bgl to obtain CBR values within areas of proposed road/hardstanding in the new waste recycling facility.

Copies of Test results are included within Appendix D.

5.10 Foundation Inspection Pits

Six hand dug existing foundation inspection pits were dug in positions along the northern wall of the building adjacent to the south of the site. The maximum depth excavated was 1.65m bgl.

HD01 encountered concrete potential footing at 0.45m bgl protruding 0.65m from the building wall which stepped 0.08m to a relict concrete slab extending a further 3.25m away from the wall. The base of the relict concrete slab was not encountered and is at a depth greater than 0.8m bgl and as such formation strata was not proven.

HD02 and HD02A was undertaken against the 'black corridor' and did not encounter the base of the concrete corridor, encountered to a maximum depth of 1.65m bgl as such the formation strata was not proven.

HD03 encountered a possible concrete footing from ground level to 0.4m bgl extending 0.24m away from the building wall and the base of the footing appeared to be formed within formation strata of Made Ground gravel.

HD04 encountered a possible footing from ground level to 0.23m bgl extending 0.30m from the building wall. The base of the possible footing was formed within formation strata of sandstone.

HD05 encountered a possible footing at 0.88m projecting 0.65m from the building wall. The base of the footing was not proven, as such a formation strata was not proven.

All cross-sectional drawings of the foundation inspection pits are presented with the exploratory hole logs in Appendix B.

5.11 Soakaway Infiltration Tests

Soakaway tests were conducted in three of the six machine excavated trial pits (SA01, SA02 and TW TP01 (SA03)). All tests were conducted in natural strata of fine to medium grained SANDSTONE. SA01 infiltration test was repeated three times. One test was completed in SA02 and SA03 due to negligible infiltration rates and as such no rate could be calculated over 1.5 hr tests.

SA01 infiltration tests were conducted between 0.50 and 0.53m bgl to the base of the pit at 0.95m bgl. Test 1 recorded an infiltration rate of 2.12×10^{-4} m/s, Test 2 recorded infiltration rate of 1.03×10^{-4} m/s, and Test 3 recorded an infiltration rate of 7.05×10^{-5} m/s.

The variation in infiltration rates is likely due to variability in weathering and fracture spacings in the bedrock. Infill between fractures also appeared more clayey in SA02 and SA03 which may limit infiltration. As such, based on the estimated infiltrations rates it is considered unlikely that soakaway drainage will be feasible across the site. Further testing would be required where soakaway drainage is being considered.

Full results for the soakaway tests conducted are presented within Appendix G.

6.0 Ground and Groundwater Contamination Assessment

This section of the report includes the assessment of the potential contamination, solid, liquid and gas, identified on the subject site which may present a risk to the proposed end users, associated utilities and the wider environment.

In guidance published by the Environment Agency, the risk to human health or controlled waters is determined through an assessment of pollutant linkages between a source of contamination (within the ground or groundwater either on or off site) and a sensitive receptor such as end users of the site, building materials, edible plants grown in gardens or groundwater abstracted for drinking. This is termed a source-pathway-receptor relationship. The same model is applied to the assessment of risk arising from ground gases as detailed within BS8576:2013 (British Standards Institution, 2013).

These models have a common approach, which is one of a tiered assessment. At each stage of the assessment further detail can be applied to the conceptual site model to provide a detailed interpretation on a site by site basis. As part of the planning process this approach is adopted to establish either if the site is 'suitable for use' or whether additional work or else remedial work is required for the site to be deemed so.

The sub-sections hereafter therefore incorporate the first tier (Tier 1) of this approach otherwise referred to as the Generic Quantitative Risk Assessment (GQRA). The GQRA builds on the qualitative risk assessment presented in Section 3.0 in conjunction with observations made during the ground investigation and is based solely on the results of the chemical and other testing data obtained as part of Curtins ground investigation. The GQRA is used to build/refine the Conceptual Site Model (CSM) for the site as detailed and presented in *Section 8.0* of this report.

The following sections present more detail on the risk assessment methodology rationale for the main receptors.

6.1 Human Health GQRA

Detailed guidance on human health risk assessment is available within several documents, published by both the Environment Agency and Defra. Guidance includes Contaminated Land Exposure Assessment (CLEA) v1.071 model (Environment Agency, 2014), Science Report 2 (Environment Agency, 2009) and Science Report 3 (Environment Agency, 2009).

A generic quantitative risk assessment (GQRA) has been carried out for the Potential Contaminant Linkages (PCLs) investigated by screening of soil contamination data against relevant Generic Assessment Criteria (GAC) where available, including:

- i) **Soil Guideline Values (SGVs):** These have been published by the Environment Agency and are trigger values for screening out low risk areas of land contamination. SGV's give an indication of representative average concentrations of chemicals in soil, below which long-term health risks are likely to be minimal. SGVs have been published for several contaminants

- including arsenic, cadmium, mercury, nickel, selenium, BTEX, phenols and dioxins, furans and dioxin-like PCB substances for land uses including residential, allotments and commercial. The SGVs have been developed for a sandy loam soil with 6% soil organic matter (SOM) content;
- ii) **Supplementary Screening Values (SSVs):** In addition to the SGVs developed by the EA, other third-party organisations have derived SSVs for a wider range of contaminants and land uses using the CLEA Model. Curtins have adopted these numbers where applicable, including those developed by Atkins AtriskSoil™, the LQM/CIEH Suitable for Use Levels (S4UL) and EIC/AGS/CL:AIRE published thresholds;
- iii) **Category 4 Screening Levels (C4SLs):** In March 2014 DEFRA published C4SLs for arsenic, benzene, benzo(a)pyrene, cadmium, hexavalent chromium and lead. These values were derived to support the revised Part 2A Statutory Guidance issued in 2012 (Department of Environment Food and Rural Affairs (DEFRA) , 2012) in which four categories of contaminated land are included, ranging from Category 1 (significant/high risk) to Category 4 (low risk). C4SLs are not representative of significant possibility of significant harm (SPoSH) and are low risk levels which, and therefore where the C4SLs are not exceeded, land can be demonstrated to be in Category 4 and cannot be determined as contaminated land.

6.1.1 Adopted Soil Human Health GACs Screening Methodology

The proposed use to the site, as a hospital, is most analogous with a *Commercial* scenario and so assessment has been undertaken against the following GACs, in order of preference:

1. Environment Agency Soil Guideline Values,
2. CL:AIRE, AGS, EIC. Soil Generic Assessment Criteria for Human Health Risk Assessments,
3. LQM/CIEH 2015 S4ULs for Human Health Risk Assessment, and
4. DEFRA Category 4 Screening Levels.

Soil Organic Matter (SOM) has a strong bearing on the availability of potential contaminants and therefore influences the Tier 1 Thresholds. The SOM ranged between 0.2% to 2.9%. As such, the comparison has been made against GACs developed for a sandy soil with a SOM of 1.0%.

The results of the environmental testing can be referred to in Appendix C. Copies of the Tier 1 Thresholds are contained within Appendix F.

6.1.2 Generic Assessment Criteria Screening of Soil Laboratory Results

The results of the environmental testing can be referred to in Appendix C, with testing undertaken on a total of thirteen made ground soil samples across the site.

With respect to the proposed 'Commercial' end use, no exceedances were recorded within any samples collected from the made ground.

Selected soil samples were screened for asbestos. No suspected asbestos containing materials (ACMs) were identified in the exploratory hole logs and no asbestos fibres were positively identified during laboratory analysis of the soil samples.

6.2 Controlled Waters GQRA

No significant visual/olfactory evidence of contamination was identified within shallow site soils during the site investigation. This is further confirmed by laboratory testing of soils highlighted within Section 6.1.2.

Considering the conceptual site model developed within the Phase 1 Preliminary Risk Assessment, due to no surface water receptors being located within 250m of the site, and no recorded abstraction points located within 1km of the site, as well as chemical laboratory it is considered that risks to controlled waters are confirmed as Low with no further action required.

6.3 Ground Gas GQRA

The assessment of risk presented by ground gases is assessed with reference to guidance published by CIRIA (Assessing Risks Posed by Hazardous Ground Gases to Buildings, C665 (CIRIA, December 2007), BSI Publication (Code of practice for the design of protective measures for methane and carbon dioxide ground gases for new buildings BS8485:2015 (British Standards, June 2015), BSI Publication (Guidance on Investigations for Ground Gas-Permanent gases and Volatile Organic Compounds (VOCs) (British Standards Institution, 2013) and other broadly accepted references such as the Ground Gas Handbook 2009 (S.Wilson, G.Card and S.Haines, 2009).

The gas risk assessment adopts a tiered approach. In the first instance, this involves a re-evaluation of the Conceptual Site Model described within the previous reporting and thereafter validating this conceptual model with the ground gas data, a semi-quantitative risk assessment.

6.3.1 Conceptual Site Model

The Preliminary Conceptual Site Model (PCSM) presented within Section 3.0 noted the overall moderate/low risk posed by ground gases based on the identified sources, primarily made ground from previous phases of development and gases associated with potentially infilled ground and historical development.

With respect to ground gas sources;

Made Ground

Ground Investigation Report

Made ground deposits were encountered in all of the exploratory holes, to a maximum depth of 3.65 m bgl.

The Made Ground generally comprised a predominate upper layer of granular material with demolition material and the deeper Made Ground encountered as a cohesive material, likely reworked material.

With respect to ground gas pathways:

Direct gassing of ground gas from the shallow soils to the near surface is considered the main pathway for ground gas migration on site.

6.3.2 Monitoring Results Discussion

In order to characterise the site's gas regime and validate the qualitative assessment of ground gas risk, standpipe installations were incorporated within six exploratory borehole locations as detailed in *Table 4.1.3* within Section 4.0.

Gas monitoring has been undertaken on the following occasions: 07/01/2021, 20/01/2021, 04/02/2021 & 17/02/21.

Gas monitoring has been undertaken during both falling and steady atmospheric pressures with barometric pressure ranging from 1014mb to 954mb.

A summary of the soil gas monitoring results to date is presented in *Table 6.3.2* and copies of the log sheets presented in Appendix E.

Table 6.3.2 Summary of Soil Gas Monitoring Results

Location	Flow (l/hr)		CO ₂ Range of Peak Values (%vol/vol)	CO ₂ Range of Steady State (%vol/vol)	CH ₄ Range (%vol/vol)	Strata Description (50mm well)
	Max	SS				
BH01	-23.7	-0.2	<0.1	<0.1	<0.1	Bedrock
BH02A	4.5	<0.1	1.3	1.3	<0.1	Bedrock
BH03	-63.7	<0.1	<0.1	<0.1	<0.1	Bedrock
BH06	-63.8	<0.1	<0.1	<0.1	<0.1	Bedrock
WS03	-22.7	-0.2	<0.1	<0.1	<0.1	Made Ground
WS05	0.1	0.1	<0.1	<0.1	<0.1	Made Ground

Hydrogen sulphide and carbon monoxide were recorded with maximums of 1ppm and 13ppm respectively.

6.3.3 Gas Assessment

It is noted that high negative flow rates were recorded within BH03, BH06 and WS03 on once occasion each. For the remainder of the visits, these wells were noted as being flooded. On the occasions where high flow rates were recorded, the groundwater levels recorded within the well were significantly above the screened section of the well. As such, it is considered that the cause of these peak flows is a result of pressure build up within the well, and not representative of natural site conditions. As such, these peak flows have been discounted from this assessment.

Considering both a 'worst credible scenario' (maximum 'absolute' flow rate, maximum gas concentration within a single borehole location) and 'worst possible scenario' (maximum 'absolute' flow rate, maximum gas concentration across all borehole locations) the Hazardous Gas Flow Rates (Q_{hg}) for the site are evaluated as 0.059 (carbon dioxide) and 0.001 (methane).

On the basis that encountered ground conditions have a low gassing potential and low ground gas concentrations have been recorded the site is assessed as Characteristic Situation 1 (CS-1) where gas protection measures will not be required.

6.3.4 Radon

As identified in Section 2.8, no radon protection measures are required.

However, where the new development incorporates a basement the advice of a specialist Radon assessor must be obtained.

7.0 Revised Conceptual Site Model

The Preliminary Conceptual Site Model (PCSM) presented in Section 3.0 of this report has been revised following the GQRA in *Section 6.0* above. The Revised Conceptual Site Model (CSM) is summarised in the table overleaf.


The CSM details the source-pathway-receptor linkages or potential pollutant linkages (PPL) that have been identified as relevant for the site. The GQRA details the associated level of risk relating to these potential pollutant linkages.

The CSM follows the framework outlined within CIRIA C552 (CIRIA, 2001) which is summarised within Appendix H.

The 'risk rating' within the CSM refers to the risk that the source, pathway, receptor linkage or PPL is complete. Unless specifically stated it does not necessarily refer to an immediate risk and is intended to be used as a tool to assess the necessity for further assessment/investigation.

Risks presented by Unexploded Ordnance is discussed and assessed in Section 2.7.

Under current health and safety legislation, employers are required to carry out their own appropriate risk assessments and mitigation to protect themselves and their employees, other human receptors and the environment from potential contamination. Such risks must be adequately mitigated by law, specifically the Construction Design Management (CDM) Regulations, 2015 (CITB, 2015) which require that potential risks to human health and the environment from construction activities are appropriately identified and all necessary steps taken to eliminate / manage that risk. It has been assumed that any future construction works on site will be undertaken in compliance with these requirements and therefore construction workers involved in the building works at the site have been discounted as a human receptor in the conceptual site model. Reference should be given to the environmental testing results discussed within Section 6.0 and presented within Appendix C.

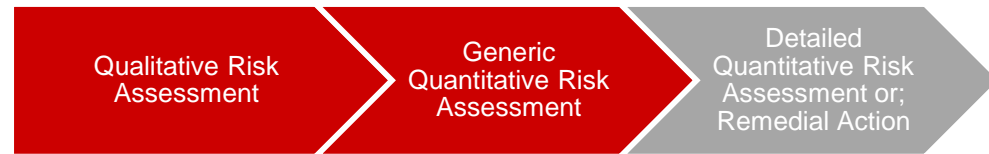

- The table below represents the Second stage in the land quality risk assessment process; the Revised Conceptual Site Model following the Quantitative Risk Assessment.
- For a development site to be deemed 'suitable for use' the level of risk needs to be brought down to acceptable levels, i.e. low to very low risk. The purpose of each stage of risk assessment is ultimately to establish if there is a requirement for additional levels of assessment to be made to have sufficient confidence to support a risk characterisation or management decision, e.g. remedial action.
- In the absence of specific site data, a Generic Quantitative Risk Assessment is invariably recommended.

Conceptual Site Model			Generic Qualitative Risk Assessment			Comments	Action
Identified Source	Pathway(s)	Receptor(s)	Consequence	Likelihood of Occurrence	Risk Rating		
On-site sources of potential contamination: Made ground was encountered to a maximum depth of 3.65m.	Ingestion/direct contact of soils Inhalation of vapours and soil dust/fibres	End users of site Future site users, visitors and trespassers	Mild	Unlikely	Low	No exceedances of Commercial GACs noted within any recovered made ground soils samples.	Standard Health & Safety precautions likely to be used by workers.
	Vertical migration through the Made Ground and residual soils May occur due to processes including; capillary action.	Controlled Waters (Groundwater) Bedrock – Principal Aquifer No groundwater abstractions within 1km of the subject site. The site is not within a SPZ.	Medium Pollution of sensitive water resources	Unlikely	Low	Due to no sources of contamination identified within shallow site soils during the ground investigation and no groundwater abstractions noted within 1km of the site, this SPR linkage is not expected to be realised.	No further action required.
On-site and off-site sources of potential ground gas generation Made ground associated with historic development on-site.	Vertical and horizontal migration through the Made Ground.	End users of site Future site users, visitors and trespassers	Mild Human health risk	Unlikely	Low	Ground gas monitoring to date has recorded no elevated concentrations of carbon dioxide, methane. High negative flow rates have been attributed to pressure build up within monitoring wells due to high water table and are not considered representative of live site conditions. As such, the site is classified as CS-1.	No further action required.

8.0 Geotechnical Conclusions and Recommendations

The recommendations provided within this section are based on a review of the ground conditions encountered across the site, considering the geotechnical and geo-environmental limitations and hazards identified.

8.1 Foundation Recommendations

It is understood, the proposed development comprises the construction of a new two storey hospital wing and refurbishment of existing buildings with associated car parking, communal soft landscaped, clinical and recycling waste storage in the north of the site.

It is considered that the underlying bedrock could potentially provide a suitable bearing stratum. For foundations founded on moderately strong sandstone with discontinuity spacings >60mm, allowable bearing capacities of 1500 to 2000 kN/m² are estimated.

Where bedrock is too deep and overlaid by variable made ground (encountered across the site to depths of up to 2.50m bgl) and along with variable residual soils (locally area to 3.65m bgl) it may affect the feasibility with potential mass trench fill foundations required within areas of deep made ground/residual soils. It is also considered that a piled foundation solution could be used to transfer the loads to the underlying bedrock. It must be noted that due to high strength of the bedrock, where allowable bearing capacities cannot be achieved for a pile end bearing at rockhead, CFA piling may not be a suitable solution, and other piling techniques such as bored piles may have to be considered. In addition, obstructions within the made ground and the high strength bedrock may affect the performance of a CFA rig. Therefore, a suitably qualified and experienced piling contractor should be consulted prior to commencement of the works.

The carrying capacity of piles depends not only on their size and the ground conditions but also on their method of installation.

If a piled foundation solution is to be adopted, consideration should be given to the fractured/poor quality bedrock at from approximately 9.00 – 11.50m bgl, within the vicinity of BH02A.

8.2 Ground Floor Slabs

Based on the observations on site together with the results of laboratory tests, it is recommended that consideration is given to a suspended ground floor slab, unless founded on a suitable natural stratum with allowable bearing capacities satisfying the required pressures from the slab. Where piled foundations are anticipated, a suspended slab is recommended to bear on the pile caps by a network of beams which will minimise any differential settlement between the floor and piled structure.

8.3 Chemical Attack on Buried Concrete

The site has been classified in accordance with BRE Special Digest and laboratory testing undertaken accordingly as detailed in Section 5.7.

Based on the laboratory test results it is considered that for Made Ground a Design Sulphate Class may be taken as DS-2 and an ACEC class for the site of AC-2 would be appropriate.

8.4 Excavations

It is anticipated that excavations will be required during the construction phase. These are likely to be for localised services and dig & replacement works.

Based on observations on site, together with the results of in-situ and laboratory tests, it is considered that excavations to <1.20m bgl should stand unsupported in the short term at suitable batters. However, where soft/loose deposits are present, instability is likely. Side support for safety purposes should of course be provided to all excavations which appear unstable, and those >1.20m deep, in accordance with Health and Safety Regulations.

Suitable side slope batters may be required. These must be designed by a suitably qualified temporary works contractor for any excavations.

Groundwater may be encountered as seepages in shallow excavations for foundations or services as perched water. It is considered that groundwater inflows, if encountered, may be controlled by pumping from sumps.

Excavation through layers of Made Ground encountered across the site should be feasible using conventional site plant. Following periods of heavy rainfall, the use of a tracked excavator may be required to prevent plant subsidence.

All excavation temporary works shall be designed by a suitably qualified temporary works contractor for any excavations.

9.0 Geo-Environmental Conclusions and Recommendations

9.1 Geo-Environmental Conclusions

A revised tabulated Conceptual Site Model has been derived following the findings of the Generic Quantitative Risk Assessment and is presented in Section 7.0.

9.1.1 Ground Contamination

The environmental chemistry soil results have been compared with the Tier 1 criteria for soils with respect to human health against '*Commercial*' thresholds of which no exceedances were noted.

As such, the risk to site end users arising for made ground soils on-site is considered to be **Low**, with no further actions required.

9.1.2 Controlled Waters

No significant visual/olfactory evidence of contamination was identified within shallow site soils during the site investigation.

Considering the conceptual site model developed within the Phase 1 Preliminary Risk Assessment, due to no surface water receptors being located within 250m of the site, and no recorded abstraction points located within 1km of the site, as well as chemical laboratory it is considered that risks to controlled waters are confirmed as **Low** with no further action required.

9.1.3 Ground Gas Assessment

Six ground gas monitoring visits have been undertaken, with low carbon dioxide/methane concentrations recorded during the monitoring visits. The risk to the end-user of the development from soil gases is therefore considered to be **Low**.

It is noted that high negative flow rates were recorded within BH03, BH06 and WS03 on once occasion each. For the remainder of the visits, these wells were noted as being flooded. On the occasions where high flow rates were recorded, the groundwater levels recorded within the well were significantly above the screened section of the well. As such, it is considered that the cause of these peak flows is a result of pressure build up within the well, and not representative of natural site conditions. As such, these peak flows have been discounted from this assessment.

On the basis that encountered ground conditions have a low gassing potential and low ground gas concentrations have been recorded the site is assessed as Characteristic Situation 1 (CS-1) where gas protection measures will not be required.

9.2 Recommendations

Based on the findings of the ground investigation, the following recommendations are made:

- 1) It is recommended that construction workers are provided with appropriate PPE and sanitary facilities, with reference to the environmental testing results presented herein and within *Appendix C*.
- 2) Where unexpected contamination is discovered during future earthworks and/or construction, works should be stopped and the advice of a qualified geo-environmental engineer should be sought.

10.0 Bibliography

- Authority, C., 2020. *Coal Authority Interactive Map*. [Online]
Available at: <https://mapapps2.bgs.ac.uk/coalauthority/home.html>
[Accessed August 2020].
- Barnes, G. E., 2016. *Soil Mechanics Principles and Practice*. s.l.:s.n.
- British Geological Society, 1993. *1:50,000 Geological Map Series, Scotland Sheet 30E*. [Online]
Available at: <https://www.bgs.ac.uk/data/maps/maps.cfc?method=viewRecord&mapId=10783>
[Accessed August 2020].
- British Geological Society, 1994. *1:50,000 Geological Map Series, Scotland Sheet 30E*. [Online]
Available at: <https://www.bgs.ac.uk/data/maps/maps.cfc?method=viewRecord&mapId=11013>
[Accessed August 2020].
- British Geological Society, 2020. *GeoIndex Onshore*. [Online]
Available at: <https://www.bgs.ac.uk/geoindex/>
[Accessed August 2020].
- British Standards (BS), 2013. *BS8576, Guidance on investigations for ground gas. Permanent gases and Volatile Organic Compounds (VOCs)*. s.l.:s.n.
- British Standards Institution, 2007. *Eurocode 7: Geotechnical Design (report no. BSEN1997)*., s.l.: s.n.
- British Standards Institution, 2010. *Code of Practice for Site Investigations (report no. BS5930)*., s.l.: s.n.
- British Standards Institution, 2011. *Investigation of Potentially Contaminated Sites (report no. BS10175)*., s.l.: s.n.
- British Standards Institution, 2013. *Guidance on Investigations for Ground Gas, Permanent Gas and Volatile Organic Compounds (VOCs) (report no. BS8576:2013)*., s.l.: s.n.
- British Standards Institution, 2016. *Methods of test for soils for civil engineering purposes. General requirements and sample preparation (report no. BS1377-1)*., s.l.: s.n.
- British Standards, June 2015. *BS 8485, Code of practice for the design of protective measures for methane and carbon dioxide ground gases for new buildings*. s.l.:s.n.
- Building Research Establishment, 2005. *Concrete in Aggressive Ground (Special Digest 1)*., s.l.: s.n.
- CIRIA, 2001. *Contaminated Land Risk Assessment. A guide to good practice (report no. C552)*., s.l.: s.n.
- CIRIA, 2002. *Special Publication 32: Construction over Abandoned Mine Workings*, s.l.: s.n.
- CIRIA, 2016. *CIRIA Report No C750 Groundwater Control*. s.l.:s.n.
- CIRIA, December 2007. *CIRIA C665, Assessing risk posed by hazardous ground gases to buildings*. s.l.:s.n.

- CITB, 2015. *Construction (Design and Management) Regulations.*, s.l.: s.n.
- Coal Authority, Groundsure, June 2019. *Enviro All-in-One*, ref 51002132338001, s.l.: s.n.
- Contaminated Land: Applications In Real Environments (CL:AIRE), 2011. *Definition of Waste Code of Practice (Version 2).*, s.l.: s.n.
- Curtins, 2020. *Red Tree Central Phase 1 Preliminary Risk Assessment*, ref. 073983.302-CUR-00-XX-RP-GE-0001, s.l.: s.n.
- Department of Environment Food and Rural Affairs (DEFRA) , 2012. *Environmental Protection Act 1990: Part 2A Contaminated Land Statutory Guidance (report no. PB13735).*, s.l.: s.n.
- Envirocheck, July 2020. *Envirocheck Report*, Ref 248034384_1_1. s.l.:s.n.
- Environment Agency, 2004. *Model Procedures for the Management of Land Contamination Contaminated Land Report 11 (report no. CLR11).* , s.l.: s.n.
- Environment Agency, 2006. *Remedial Targets Methodology - Hydrological Risk Assessment for Land Contamination*, s.l.: s.n.
- Environment Agency, 2009. *Human Health Toxicological Assessment of Contaminants in Soil (report no. SC050021/SR2).*, s.l.: s.n.
- Environment Agency, 2009. *Updated Technical Background to the CLEA Model (report no. SC050021/SR3).*, s.l.: s.n.
- Environment Agency, 2014. *Contaminated Land Exposure (CLEA) Tool (version 1.071).*, s.l.: s.n.
- Environment Agency, May 2015. *Guidance on the classification and assessment of waste (1st edition 2015). Technical Guidance WM3.* s.l.:s.n.
- European Community (EC), 2000. *The Water Framework Directive*, s.l.: s.n.
- European Union, 1998. *Drinking Water Directive (Council Directive 98/83/EC)*, s.l.: s.n.
- Gibson, R. E., 1953. Experimental Determination of The True Cohesion and True Angle of Internal Friction in Clays..
- Groundsure, n.d. s.l.:s.n.
- Highways England, 2009. *Interim Advice Note 73/06: Design Guidance for Road Pavement Foundations*, s.l.: s.n.
- NHBC, 2013. *Part 4 (Foundations) Chapter 4.2 (Building near Trees)*, s.l.: s.n.
- S.Wilson, G.Card and S.Haines, 2009. *Ground Gas Handbook.* s.l.:s.n.
- Stroud, M. a. B. F., 1975. *The Standard Penetration Test and the Engineering Properties of Glacial Materials.* s.l.:s.n.
- Stroud, M. A. & Butler, F. G., 1975. *The Standard Penetration Test and the Engineering Properties of Glacial Materials.*, s.l.: s.n.
- Tomlinson, M. J., 2001. *Foundation Design and Construction.* 7th ed. Suffolk: Pearson.

Tomlinson, M. J., 2001. *Foundation Design and Construction*. s.l.:s.n.

UK Radon, 2020. *UK Radon Maps*, <http://www.ukradon.org/information/ukmaps>. s.l.:s.n.


Waltham, T., 2019. *Foundations of Engineering Geology*. s.l.:s.n.







World Health Organisation (WHO), 2017. *Guidelines for Drinking Water Quality*, s.l.: s.n.

WYG, 2013. *Southfield Grange Ground Investigation Report*, ref: A081403-INT-01, s.l.: s.n.

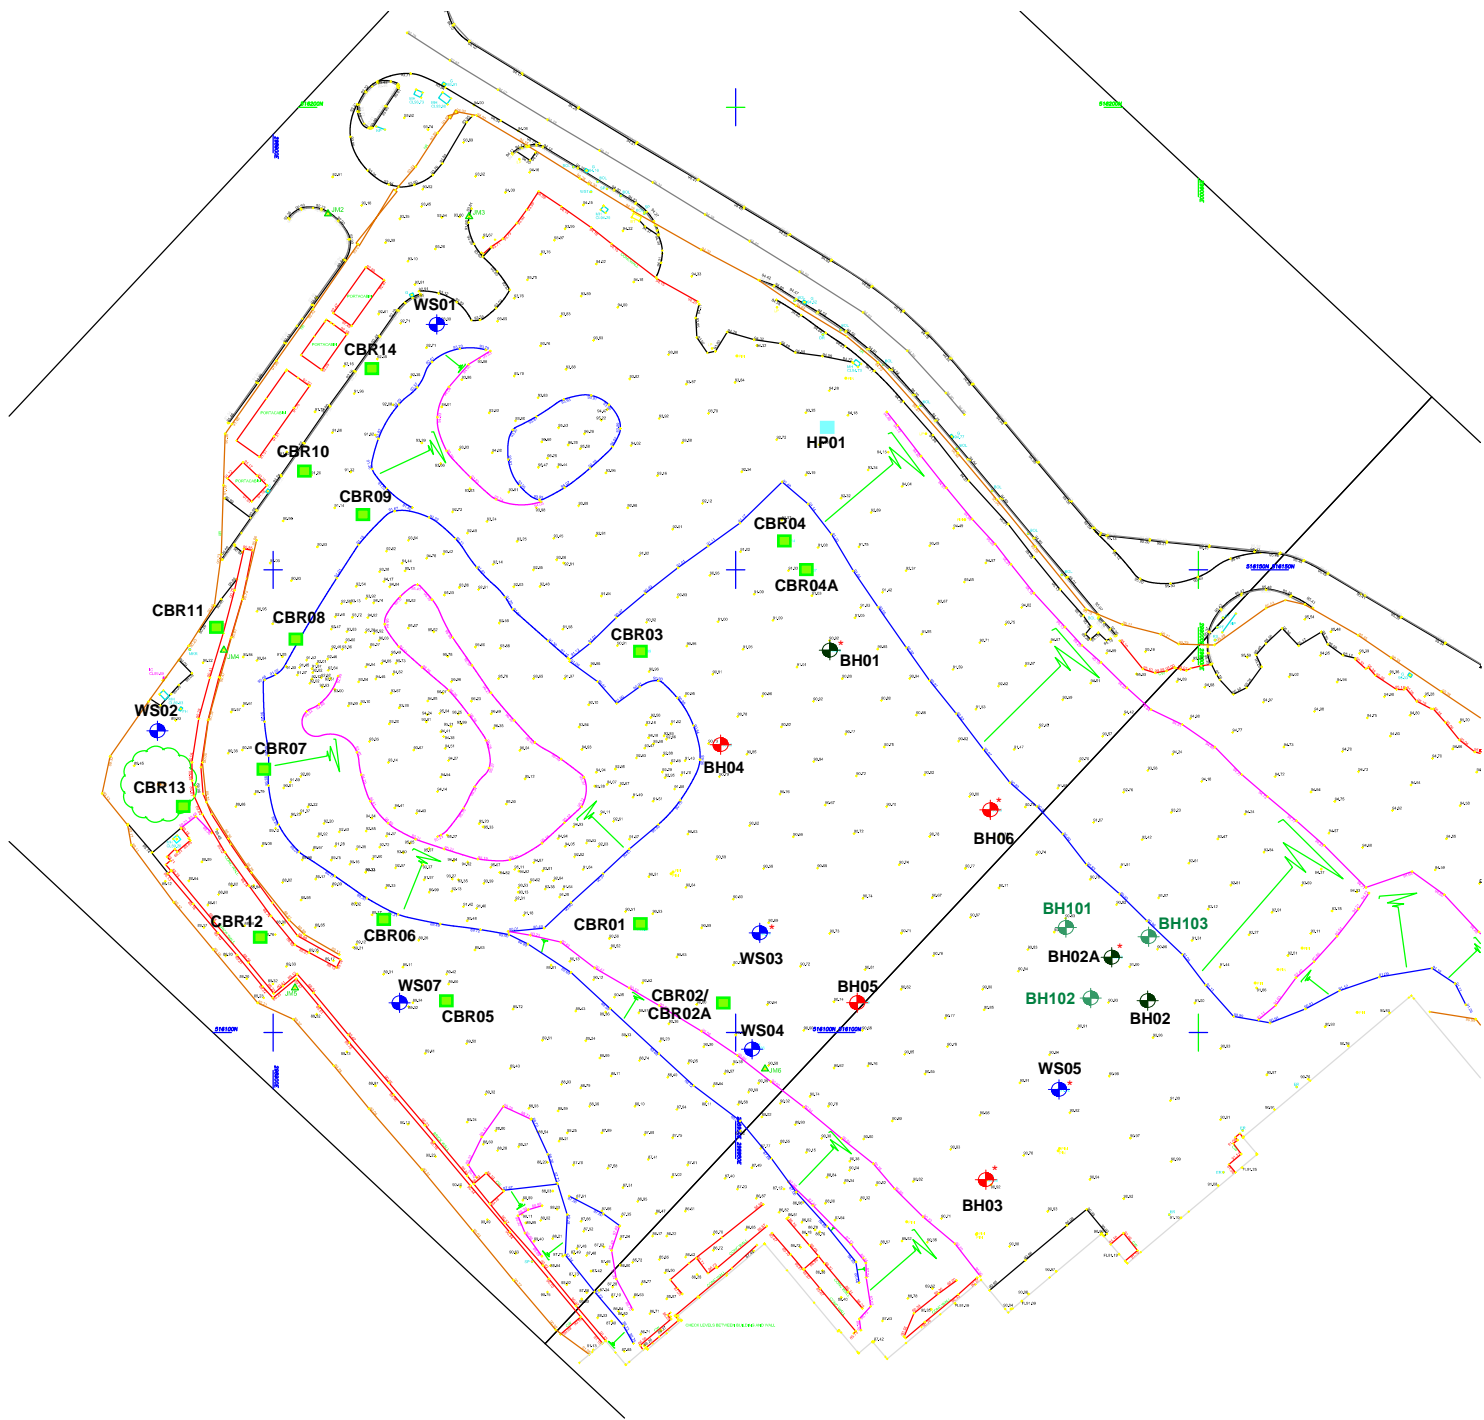

Appendix A – Drawings



-  CABLE PERCUSSIVE BOREHOLE LOCATIONS WITH ROTARY (CORED) FOLLOW ON
-  WINDOW SAMPLE BOREHOLE LOCATIONS
-  WINDOW SAMPLE BOREHOLE LOCATIONS WITH ROTARY (CORED) FOLLOW ON
-  HAND EXCAVATED TRIAL PIT LOCATION
-  PANDA PROBE TEST LOCATION
-  ROTARY OPEN HOLE BOREHOLE LOCATION

* Denotes monitoring installation

Rev:	Description:	Date:	By:	Chkd:
------	--------------	-------	-----	-------



Curtins Consulting Ltd.
 Merchant Exchange, 17-19 Whitworth Street West, Manchester, M1 5WG
 t: 0161 236 2394
 e: manchester@curtins.com
 www.curtins.com

Structures - Civils - Environmental - Infrastructure - Transport Planning - Sustainability - Expert Advisory Services
 Birmingham - Bristol - Cardiff - Douglas - Edinburgh - Kendal - Leeds - Liverpool - London - Manchester - Nottingham



Status: INFORMATION

Project: WEST CUMBERLAND HOSPITAL

Drg Title: EXPLORATORY HOLE LOCATION PLAN

Scale: NTS	Size: A3	First Issue: 22/03/2021	Drawn: RT	Checked: NF
------------	----------	-------------------------	-----------	-------------

Drg No: 073096-CUR-00-XX-DR-GE-003	Rev: V01
------------------------------------	----------

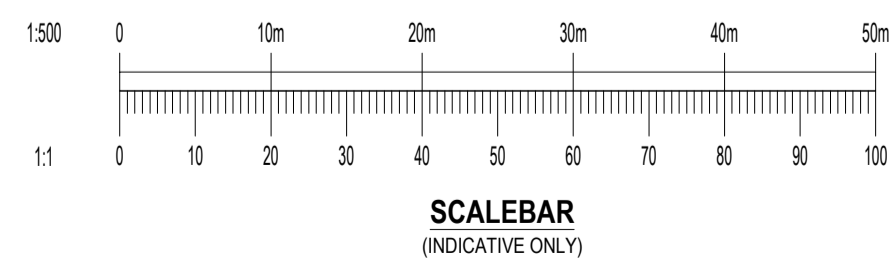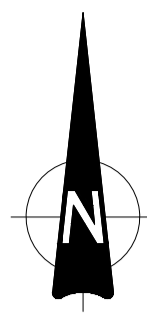

GENERAL NOTES:

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS AND ENGINEERS DRAWINGS AND SPECIFICATIONS.
2. DO NOT SCALE THIS DRAWING. ANY AMBIGUITIES, OMISSIONS AND ERRORS ON DRAWINGS SHALL BE BROUGHT TO THE ENGINEERS ATTENTION IMMEDIATELY. ALL DIMENSIONS MUST BE CHECKED / VERIFIED ON SITE.
3. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE.
4. FOR GENERAL NOTES REFER TO DRAWING.

LEGEND

- SLIT TRENCH FROM BACK OF KERB
- BRE 365 SOAKAWAY TEST
- CORE EXISTING SLAB TO DETERMINE DEPTH. DCP/CBR TEST ON SUBGRADE MATERIAL WITHIN ROAD AND ADJACENT AREA
- HAND DIG TO EXISTING FOUNDATIONS
- BOREHOLE LOCATION
- TRIAL PIT LOCATION AS PER GCL TEMPORARY WORKS REQUIREMENTS

P01	FIRST ISSUE	16/07/21	DM	PT
Rev:	Description:	Date:	By:	Chkd:



Civil & Structures • Transport Planning • Environmental • Infrastructure • Geotechnical • Conservation & Heritage • Principal Designer
Birmingham • Bristol • Cambridge • Cardiff • Douglas • Dublin • Edinburgh • Glasgow • Kendal • Leeds • Liverpool • London • Manchester • Nottingham

Status: **ISSUED FOR INFORMATION** **S2**




Project: **WEST CUMBERLAND HOSPITAL PHASE 2 DEVELOPMENT**

Draw Title: **SITE INVESTIGATION TEST REQUIREMENTS & LOCATIONS**

Project No:	Size:	Date:	Drawn By:	Designed By:	Checked By:
072419	A1	JUL 21	DM	PT	PT
Scale: 1:500					

Project Code: Originator: Zone: Level: Type: Discipline: Category / Number: Rev: WCHPH2-CUR - VV - XX - DR - C - 04004 - P01

072996-CUR-VV-XX-DR-C-04004.dwg

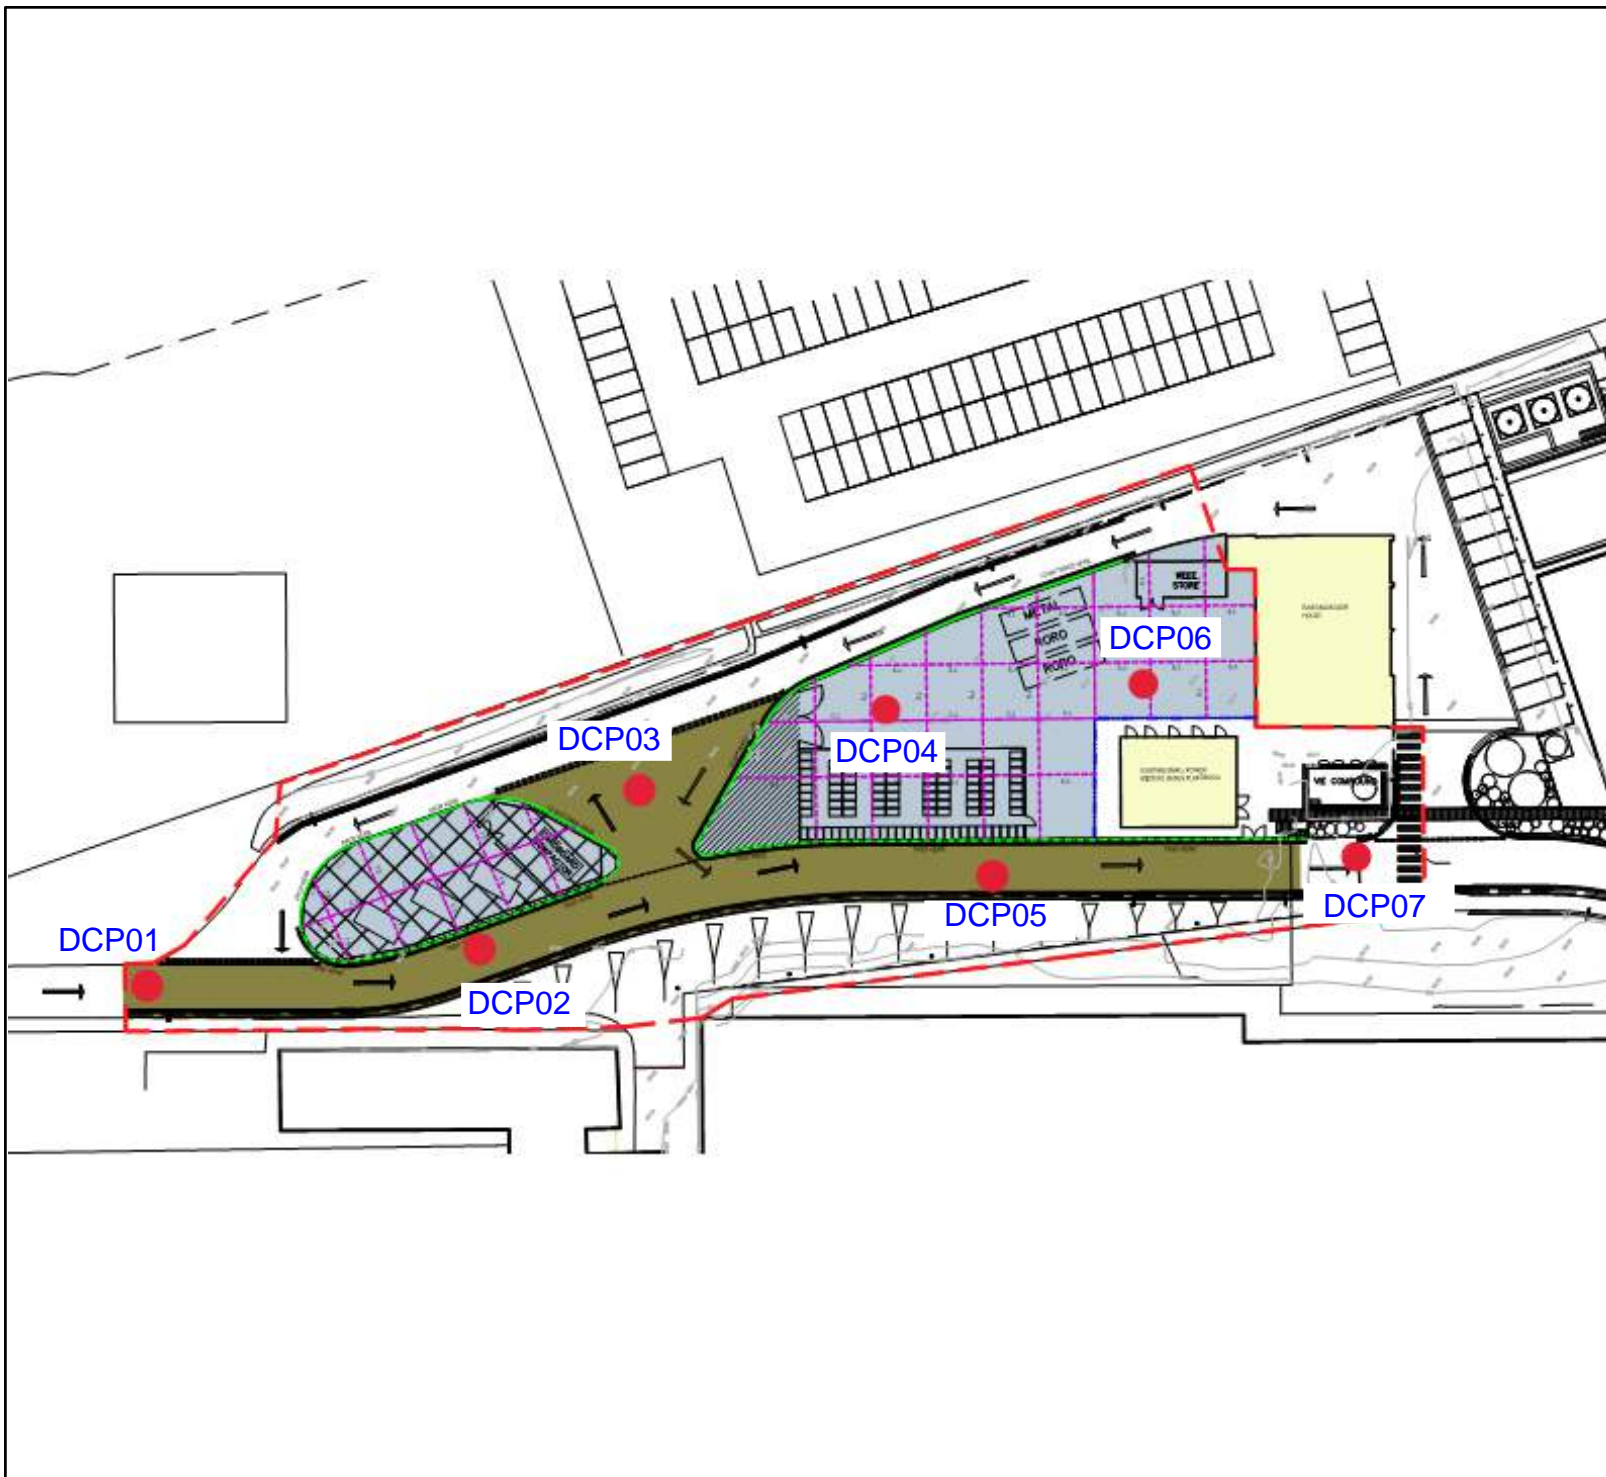

● Dynamic Cone Penetration Test (DCP) Location

Rev:	Description:	Date:	By:	Chkd:
------	--------------	-------	-----	-------



Curtins Consulting Ltd,
 Merchant Exchange, 17-19 Whitworth Street West, Manchester, M1 5WG
 t: 0161 236 2394
 e: manchester@curtins.com
 www.curtins.com

Structures - Civils - Environmental - Infrastructure - Transport Planning - Sustainability - Expert Advisory Services
 Birmingham - Bristol - Cardiff - Douglas - Edinburgh - Kendal - Leeds - Liverpool - London - Manchester - Nottingham

Status: INFORMATION

Project: WEST CUMBERLAND HOSPITAL

Drg Title: DCP LOCATION PLAN

Scale: NTS	Size: A3	First Issue: 22/03/2021	Drawn: RT	Checked: NF
----------------------	-------------	-----------------------------------	---------------------	-----------------------

Drg No: 073096-CUR-00-XX-DR-GE-004	Rev: V01
--	--------------------



Appendix B – Exploratory Hole Logs



Trial Pit Log

Trialpit No
HP01
Sheet 1 of 1

Project Name: West Cumberland Hospital

Project No.
073096

Co-ords: -
Level:

Date
08/12/2020

Location: Whitehaven


Dimensions (m):


Scale
1:20

Client: CCL Solutions

Depth
0.60

Logged
MH

Water Strike	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
	Depth	Type	Results				
	0.50	ES		0.60			MADE GROUND: Light brown slightly silty gravelly fine to coarse sand. Gravel is fine to coarse angular to subrounded sandstone, rare brick, rare coal and wood fragments. Rare boulder of sandstone.
							End of pit at 0.60 m



Remarks:

Stability:





Borehole Log

Borehole No.

WS01

Sheet 1 of 1

Project Name: West Cumberland Hospital

Project No.
073096

Co-ords: -

Hole Type
WS

Location: Whitehaven

Level:

Scale
1:20

Client: CCL Solutions

Dates: 09/12/2020 - 09/12/2020

Logged By
MH

Well	Water Strikes	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
		Depth (m)	Type	Results				
		0.40	ES		0.80		MADE GROUND: Gravel over orangish brown slightly sandy slightly gravelly clay. Gravel is fine to coarse angular to subrounded sandstone of mixed lithologies. Rare cobbles of sandstone.	
		1.20		N=33 (3,4/7,9,8,9)			1.70	
		1.70 - 3.00	Bulk		3.60 3.65		Medium dense light brown slightly clayey gravelly fine to coarse SAND. Gravel is fine to coarse angular to subrounded sandstone.	
		2.00		N=22 (5,4/5,6,4,7)			Grey medium and coarse SANDSTONE. End of borehole at 3.60 m	
		3.00		0 (0 for 0mm/0 for 0mm)				

Remarks





Borehole Log

Borehole No.

WS02

Sheet 1 of 1

Project Name: West Cumberland Hospital

Project No.
073096

Co-ords: -

Hole Type
WS

Location: Whitehaven

Level:

Scale
1:20

Client: CCL Solutions

Dates: 09/12/2020 - 09/12/2020

Logged By
MH

Well	Water Strikes	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
		Depth (m)	Type	Results				
		1.20		N=20 (2,3/4,5,5,6)	0.40		Grass over TOPSOIL: Dark brown slightly silty fine and medium sand.	
					0.70		Light brown and yellowish brown with rare grey mottling sandy CLAY.	
							Stiff reddish brown sandy slightly gravelly CLAY. Gravel is fine and medium angular to subrounded sandstone.	
		2.00		N=38 (5,6/11,8,7,12)				
		3.00		0 (0 for 0mm/0 for 0mm)				
					3.65		End of borehole at 3.65 m	

1

2

3

4

Remarks





Borehole Log

Borehole No.

WS03

Sheet 1 of 1

Project Name: West Cumberland Hospital

Project No.
073096

Co-ords: -

Hole Type
WS

Location: Whitehaven

Level:

Scale
1:20

Client: CCL Solutions

Dates: 07/12/2020 - 07/12/2020

Logged By
MH

Well	Water Strikes	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
		Depth (m)	Type	Results				
		0.40	ES				MADE GROUND: Light brown silty gravelly fine to coarse sand. Gravel is fine to coarse angular to subrounded sandstone, brick, wood fragments, metal fragments and rare nails. Occasional cobbles of sandstone. Rare boulders of sandstone.	
		1.20		N=24 (5,6/7,7,5,5)	1.20		MADE GROUND: Yellowish/greyish brown and brown slightly clayey gravelly medium and coarse sand. Gravel is fine to coarse angular to subrounded sandstone. Rail nails.	
		1.80		0 (0 for 0mm/0 for 0mm)	1.80 1.90		Yellowish/greyish brown medium and coarse SANDSTONE End of borehole at 1.90 m	

1
2
3
4

Remarks





Borehole Log

Borehole No.

WS04

Sheet 1 of 1

Project Name: West Cumberland Hospital

Project No.
073096

Co-ords: -

Hole Type
WS

Location: Whitehaven

Level:

Scale
1:20

Client: CCL Solutions

Dates: 07/12/2020 - 07/12/2020

Logged By
MH

Well	Water Strikes	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
		Depth (m)	Type	Results				
		0.40	ES				MADE GROUND: Light brown silty gravelly fine to coarse sand. Gravel is fine to coarse angular to subrounded sandstone, brick, wood fragments, metal fragments and rare nails. Occasional cobbles of sandstone. Rare boulders of sandstone.	
		1.20		N=20 (4,3/2,5,7,6)	1.20			MADE GROUND: Brown sandy gravelly clay and clayey gravelly fine to coarse sand. Gravel is fine to coarse angular to subrounded sandstone, brick, wood fragments, metal fragments and rare nails.
		1.90		50 (25 for 113mm/50 for 85mm)	1.90			
					2.20			

1
2
3
4

Remarks





Borehole Log

Borehole No.

WS05

Sheet 1 of 1

Project Name: West Cumberland Hospital

Project No.
073096

Co-ords: -

Hole Type
WS

Location: Whitehaven

Level:

Scale
1:20

Client: CCL Solutions

Dates: 08/12/2020 - 08/12/2020

Logged By
MH

Well	Water Strikes	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
		Depth (m)	Type	Results				
		0.50	ES				MADE GROUND: Light brown sand and gravel. Gravel is fine to coarse angular to subrounded sandstone, breeze block fragments, wood, plastic, rare metal and rare cloth fragments. Occasional cobbles of sandstone.	
		1.20		N=15 (3,5/5,3,3,4)				
		2.20		50 (1,2/50 for 160mm)				
					2.50 2.51		Grey medium and coarse SANDSTONE. End of borehole at 2.51 m	

1
2
3
4

Remarks





Borehole Log

Borehole No.

WS07

Sheet 1 of 1

Project Name: West Cumberland Hospital

Project No.
073096

Co-ords: -

Hole Type
WS

Location: Whitehaven

Level:

Scale
1:20

Client: CCL Solutions

Dates: 09/12/2020 - 09/12/2020

Logged By
MH

Well	Water Strikes	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description	
		Depth (m)	Type	Results					
		0.50	ES				MADE GROUND: Light brown sand and gravel. Gravel is fine to coarse angular to subrounded concrete, brick, rare clinker, sandstone, rare breeze block fragments, rare wood and rare metal.	1	
					1.40		MADE GROUND: Brown sandy gravelly clay. Gravel is fine to coarse angular to subrounded concrete, brick, rare clinker, sandstone, rare breeze block fragments, rare wood and rare metal.		
					1.80		MADE GROUND: Red brick,		
					2.00		MADE GROUD: Grey gravelly clay. Gravel is fine to coarse angular to subangular mudstone.	2	
					2.20		End of borehole at 2.20 m	3	
								4	

Remarks



Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins			Date: 14/12/2020	
Location: Whitehaven		Contractor:				
Project No. : 3670		Crew Name: JH			Drilling Equipment: Fraste XL	
Borehole Number BH01	Hole Type RC	Level		Logged By CG	Scale 1:50	Page Number Sheet 1 of 2

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description	
				TCR	SCR	RQD						
											# Drilling carried out by Cable Percussion.	
								0.50			# SANDSTONE.	
		1.00 - 2.00	4	100	100	90		1.00			Medium strong light brownish grey coarse grained crystalline SANDSTONE. Closely spaced horizontal fractures, stepped rough. Rare rust orange oxidised banding noted.	1
		2.00 - 3.00	4	90	100	100						2
		3.00 - 4.00	3	100	100	90						3
		4.00 - 5.00	2	100	100	95						4
		5.00 - 6.00	5	100	100	80						5
		6.00 - 7.00	4	100	100	90						6
		7.00 - 8.00	3	100	100	100						7
		8.00 - 9.00	2	100	100	95						8
		9.00 - 10.00	3	100	100	90					<i>Closely spaced microlite coal laminations.</i>	9
												10

Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
1.00	139	1.00	139									0.00	1.00	Air			100
11.00	115											1.00	11.00	Water			100

Remarks
Description based on drillers records.



Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins		Date: 14/12/2020	
Location: Whitehaven		Contractor:			
Project No. : 3670		Crew Name: JH		Drilling Equipment: Fraste XL	
Borehole Number BH01	Hole Type RC	Level	Logged By CG	Scale 1:50	Page Number Sheet 2 of 2

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description	
				TCR	SCR	RQD						
		10.00 - 10.70	3	100	100	90					Medium strong light brownish grey coarse grained crystalline SANDSTONE. Closely spaced horizontal fractures, stepped rough. Rare rust orange oxidised banding noted.	
		10.70 - 10.80		100	50	0		10.70				
		10.80 - 11.00	0	100	100	100		10.80 11.00			Weak locally very weak dark blackish grey very fine grained pyritic MUDSTONE. Recovered non intact. Strong light whitish grey crystalline LIMESTONE. Small pyritic inclusions noted and common quartz veins. End of Borehole at 11.000m	11
												12
												13
												14
												15
												16
												17
												18
												19
												20

Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
1.00	139	1.00	139									0.00	1.00	Air			100
11.00	115											1.00	11.00	Water			100

Remarks
Description based on drillers records.



Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins			Date: 10/12/2020	
Location: Whitehaven		Contractor:				
Project No. : 3670		Crew Name: JH			Drilling Equipment: Fraste XL	
Borehole Number BH02A	Hole Type RC	Level		Logged By CG	Scale 1:50	Page Number Sheet 1 of 2

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description	
				TCR	SCR	RQD						
											# Drilling carried out by Cable Percussion.	
								0.50			# SANDSTONE.	
		1.00 - 2.00	5	100	100	80		1.00			Medium strong light brownish grey coarse grained crystalline SANDSTONE with rare microline coal laminations. Closely spaced horizontal fractures, stepped rough, preferential along coal laminations. Rare rust orange oxidised banding noted throughout.	1
		2.00 - 3.00	3	100	100	100						2
		3.00 - 4.00	5	100	100	95						3
		4.00 - 5.00	2	100	100	100						4
		5.00 - 6.00	2	100	100	90						5
		6.00 - 7.00	4	100	100	90						6
		7.00 - 8.00	5	40	100	40						7
		8.00 - 9.00	0	40	100	100						8
		9.00 - 10.00		40	100	0						9
								10.00			Becomes very coarse.	10

Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
13.00	139	13.00	139									0.00	1.00	Air			100
17.30	115											1.00	7.80	Water			100
												7.80	13.00	Water			0
												13.00	17.30	Water			100

Remarks
Description based on drillers records.



Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins			Date: 10/12/2020	
Location: Whitehaven		Contractor:				
Project No. : 3670		Crew Name: JH			Drilling Equipment: Fraste XL	
Borehole Number BH02A	Hole Type RC	Level		Logged By CG	Scale 1:50	Page Number Sheet 2 of 2

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description	
				TCR	SCR	RQD						
		10.00 - 11.00		70	80	20					Strong light whitish grey crystalline LIMESTONE. Small pyritic inclusions noted and common quartz veins throughout. Widely spaced sub-horizontal fractures, stepped rough.	11
		11.00 - 12.00	4	80	80	80						12
		12.00 - 13.00	3	70	100	100						13
		13.00 - 14.00	5	100	100	80						14
		14.00 - 15.00	4	100	100	90						15
		15.00 - 16.00	5	100	95	85						16
		16.00 - 17.00		70	80	30						17
		17.00 - 17.30	5	60	70	40		17.30				17
											End of Borehole at 17.300m	18
												19
												20

Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
13.00	139	13.00	139									0.00	1.00	Air			100
17.30	115											1.00	7.80	Water			100
												7.80	13.00	Water			0
												13.00	17.30	Water			100

Remarks
Description based on drillers records.



Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins			Date: 09/12/2020	
Location: Whitehaven		Contractor:				
Project No. : 3670		Crew Name: JH			Drilling Equipment: Fraste XL	
Borehole Number BH03	Hole Type RC	Level		Logged By CG	Scale 1:50	Page Number Sheet 1 of 2

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description	
				TCR	SCR	RQD						
										# Backfill.		1
								1.80		# Weathered SANDSTONE.		2
								2.40		# SANDSTONE.		3
		3.00 - 4.00	3	100	100	100		3.00		Medium strong light brownish grey coarse grained crystalline SANDSTONE. Closely spaced horizontal fractures, stepped rough. Rare rust orange oxidised banding noted.		4
		4.00 - 5.00	6	100	100	95					5	
		5.00 - 6.00	7	100	100	80					6	
		6.00 - 7.00	1	100	100	100					7	
		7.00 - 8.00	3	100	100	95					8	
		8.00 - 9.00	5	100	100	100					9	
		9.00 - 10.00	3	100	100	100					10	
			Type/FI	TCR	SCR	RQD	D/R/(SPT)					



Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
3.00	139	3.00	139									0.00	3.00	Air			100
13.00	115											3.00	13.00	Water			100

Remarks
Description based on drillers records.



Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins		Date: 09/12/2020	
Location: Whitehaven		Contractor:			
Project No. : 3670		Crew Name: JH		Drilling Equipment: Fraste XL	
Borehole Number BH03	Hole Type RC	Level	Logged By CG	Scale 1:50	Page Number Sheet 2 of 2

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description	
				TCR	SCR	RQD						
		10.00 - 11.00	5	100	100	85		13.00			Medium strong light brownish grey coarse grained crystalline SANDSTONE. Closely spaced horizontal fractures, stepped rough. Rare rust orange oxidised banding noted.	11
		11.00 - 12.00	3	100	100	100			12			
		12.00 - 13.00	3	100	100	100			13			
		End of Borehole at 13.000m										14
												15
												16
												17
												18
												19
												20

Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
3.00	139	3.00	139									0.00	3.00	Air			100
13.00	115											3.00	13.00	Water			100

Remarks
Description based on drillers records.



Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins			Date: 14/12/2020	
Location: Whitehaven		Contractor:				
Project No. : 3670		Crew Name: JH			Drilling Equipment: Fraste XL	
Borehole Number BH04	Hole Type RC	Level		Logged By CG	Scale 1:50	Page Number Sheet 1 of 2

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description	
				TCR	SCR	RQD						
											# MADE GROUND: Collapsed borehole.	1
								1.60			# MADE GROUND: Sandstone boulder.	
								2.00			# MADE GROUND: Crushed broken sandstone. (Possible fill).	2
								2.60			# Hard SANDSTONE with fractures.	
		3.00 - 4.00	6	100	100	50		3.00			Medium strong light brownish grey coarse grained crystalline SANDSTONE with rare microlite coal laminations. Closely spaced horizontal fractures, stepped rough, preferential along coal laminations. Rare rust orange oxidised banding noted throughout.	3
		4.00 - 5.00	7	100	100	60						4
		5.00 - 6.00	8	100	100	30						5
		6.00 - 7.00	6	100	95	70						6
		7.00 - 8.00	7	100	100	70						7
		8.00 - 9.00	10	100	95	40						8
		9.00 - 10.00	3	100	95	95						9
			Type/FI	TCR	SCR	RQD	D/R/(SPT)					10



Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
3.00	139	3.00	139									0.00	3.00	Air Water			100
13.00	115											3.00	13.00				100

Remarks
Description based on drillers records.



Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins		Date: 14/12/2020	
Location: Whitehaven		Contractor:			
Project No. : 3670		Crew Name: JH		Drilling Equipment: Fraste XL	
Borehole Number BH04	Hole Type RC	Level	Logged By CG	Scale 1:50	Page Number Sheet 2 of 2

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description	
				TCR	SCR	RQD						
		10.00 - 11.00	3	100	100	100		13.00		Medium strong light brownish grey coarse grained crystalline SANDSTONE with rare microlite coal laminations. Closely spaced horizontal fractures, stepped rough, preferential along coal laminations. Rare rust orange oxidised banding noted throughout.	11	
		11.00 - 12.00	3	100	100	90					12	
		12.00 - 13.00	3	100	95	80					13	
		End of Borehole at 13.000m										13
												14
												15
												16
												17
												18
												19
												20

Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
3.00	139	3.00	139									0.00	3.00	Air			100
13.00	115											3.00	13.00	Water			100

Remarks
Description based on drillers records.



Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins			Date: 11/12/2020	
Location: Whitehaven		Contractor:				
Project No. : 3670		Crew Name: JH			Drilling Equipment: Fraste XL	
Borehole Number BH05	Hole Type RC	Level		Logged By CG	Scale 1:50	Page Number Sheet 1 of 2

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description	
				TCR	SCR	RQD						
▼											# MADE GROUND: Collapsed borehole.	1
								2.10			# Broken SANDSTONE.	2
								2.50			# SANDSTONE.	
		3.00 - 4.00	4	100	100	90		3.00			Medium strong light brownish grey coarse grained crystalline SANDSTONE with rare microline coal laminations. Closely spaced horizontal fractures, stepped rough, preferential along coal laminations. Rare rust orange oxidised banding noted throughout.	3
		4.00 - 5.00	3	100	100	100						4
		5.00 - 6.00	3	100	100	85						5
		6.00 - 7.00	2	100	100	95						6
		7.00 - 8.00	2	100	100	100						7
		8.00 - 9.00	3	100	100	100						8
		9.00 - 10.00	2	100	100	100						9
										10		


Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
3.00	139	3.00	139									0.00	3.00	Air			100
13.00	115											3.00	13.00	Water			100

Remarks
Description based on drillers records.



Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins			Date: 11/12/2020	
Location: Whitehaven		Contractor:				
Project No. : 3670		Crew Name: JH			Drilling Equipment: Fraste XL	
Borehole Number BH05	Hole Type RC		Level	Logged By CG	Scale 1:50	Page Number Sheet 2 of 2

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description	
				TCR	SCR	RQD						
		10.00 - 11.00	4	100	100	90					Medium strong light brownish grey coarse grained crystalline SANDSTONE with rare microlite coal laminations. Closely spaced horizontal fractures, stepped rough, preferential along coal laminations. Rare rust orange oxidised banding noted throughout.	11
		11.00 - 12.00	5	100	100	80					<i>Closely spaced microlite coal laminations.</i>	12
		12.00 - 13.00	2	100	100	90					End of Borehole at 13.000m	13
								13.00				14
												15
												16
												17
												18
												19
												20







Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
3.00	139	3.00	139									0.00	3.00	Air			100
13.00	115											3.00	13.00	Water			100

Remarks
Description based on drillers records.



Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins		Date: 11/12/2020	
Location: Whitehaven		Contractor:			
Project No. : 3670		Crew Name: JH		Drilling Equipment: Frast XL	
Borehole Number BH06	Hole Type RC	Level	Logged By CG	Scale 1:50	Page Number Sheet 1 of 2

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description			
				TCR	SCR	RQD								
											# MADE GROUND: Collapsed borehole.	1		
								1.20				# MADE GROUND: Clay bound sandstone. (Possible fill).		
									1.80				# SANDSTONE.	2
		2.00 - 3.00	6	100	100	80			2.00				Medium strong light brownish grey coarse grained crystalline SANDSTONE. Closely spaced horizontal fractures, stepped rough. Rare rust orange oxidised banding noted.	3
		3.00 - 4.00	4	100	100	95								4
		4.00 - 5.00	6	100	100	70								5
		5.00 - 6.00	5	100	100	90								6
		6.00 - 7.00	2	100	100	100								7
		7.00 - 8.00	3	100	100	100								8
		8.00 - 9.00	3	100	100	100								9
9.00 - 10.00	3	100	100	100								10		
							10.00							

Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
2.00	139	2.00	139									0.00	2.00	Air			100
12.00	115											2.00	12.00	Water			100

Remarks
Description based on drillers records.



Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins			Date: 11/12/2020	
Location: Whitehaven		Contractor:				
Project No. : 3670		Crew Name: JH			Drilling Equipment: Frast XL	
Borehole Number BH06	Hole Type RC	Level		Logged By CG	Scale 1:50	Page Number Sheet 2 of 2

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description	
				TCR	SCR	RQD						
		10.00 - 10.10		100	0	0		10.10		xxxxxxx	Weak locally very weak orangish brown heavily weathered and oxidised fine to medium grained SANDSTONE. Recovered non intact and clay bound. Strong light whitish grey crystalline LIMESTONE. Small pyritic inclusions noted and common quartz veins throughout. Closely spaced sub-horizontal fractures, stepped rough.	
		10.10 - 11.10	5	100	100	60						11
		11.10 - 12.00	2	100	100	80						12
								12.00			End of Borehole at 12.000m	12
												13
												14
												15
												16
												17
												18
												19
												20

Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
2.00	139	2.00	139									0.00	2.00	Air			100
12.00	115											2.00	12.00	Water			100

Remarks
Description based on drillers records.





Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins		Date: 08/03/2021		
Location: Whitehaven		Contractor:				
Project No. : 3775		Crew Name: JS		Drilling Equipment: Fraste ML		
Borehole Number BH101	Hole Type RO	Level		Logged By JM	Scale 1:50	Page Number Sheet 1 of 2

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description	
				TCR	SCR	RQD						
										[Cross-hatch pattern]	# MADE GROUND.	
								0.60		[Dotted pattern]	# Fine grained SANDSTONE.	1
								2.10		[Dotted pattern]	# Fine grained yellow SANDSTONE.	2
								3.20		[Dotted pattern]	# Fine grained grey SANDSTONE.	3
								4.90		[Dotted pattern]	# Fine grain yellow SANDSTONE.	4
								5.90		[Dotted pattern]	# Fine grained SANDSTONE.	5
								6.50		[Dotted pattern]	# Fine grained yellow SANDSTONE.	6
								8.60		[Dotted pattern]	# Badly broken SANDSTONE.	7
										[Dotted pattern]		8
										[Dotted pattern]		9

Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
3.00	139	3.00	139									0.00	8.60	Air/Mist			100
12.00	115											8.60	10.70	Air/Mist			60
												10.70	12.00	Air/Mist			100

Remarks
 # Description based on drillers records.
 Inspection pit pre dug to 1.20m and CAT scanned.





Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins		Date: 08/03/2021	
Location: Whitehaven		Contractor:			
Project No. : 3775		Crew Name: JS		Drilling Equipment: Fraste ML	
Borehole Number BH101	Hole Type RO	Level		Logged By JM	Scale 1:50
Page Number Sheet 2 of 2					

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description	
				TCR	SCR	RQD						
											# Badly broken SANDSTONE.	10
								10.70			# Fine grain SANDSTONE.	11
								11.10			# LIMESTONE.	11
								12.00			End of Borehole at 12.000m	12
												13
												14
												15
												16
												17
												18
												19

Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
3.00	139	3.00	139									0.00	8.60	Air/Mist			100
12.00	115											8.60	10.70	Air/Mist			60
												10.70	12.00	Air/Mist			100

Remarks
 # Description based on drillers records.
 Inspection pit pre dug to 1.20m and CAT scanned.





Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins		Date: 08/03/2021		
Location: Whitehaven		Contractor:				
Project No. : 3775		Crew Name: JS		Drilling Equipment: Fraste ML		
Borehole Number BH102	Hole Type RO	Level		Logged By JM	Scale 1:50	Page Number Sheet 1 of 2

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description	
				TCR	SCR	RQD						
											# MADE GROUND.	
								0.90			# Fine grained yellow SANDSTONE.	1
								1.50			# Fine grained grey SANDSTONE.	2
								4.70			# Fine grained SANDSTONE.	5
								6.20			# Fine grained yellow SANDSTONE.	7
								8.30			# Fine grained SANDSTONE.	9

Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
3.00	139	3.00	139									0.00	9.90	Air/Mist			100
12.00	115											9.90	11.00	Air/Mist			60
												11.00	12.00	Air/Mist			100

Remarks
 # Description based on drillers records.
 Inspection pit pre dug to 1.20m and CAT scanned.





Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins		Date: 08/03/2021		
Location: Whitehaven		Contractor:				
Project No. : 3775		Crew Name: JS		Drilling Equipment: Fraste ML		
Borehole Number BH102	Hole Type RO	Level		Logged By JM	Scale 1:50	Page Number Sheet 2 of 2

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description	
				TCR	SCR	RQD						
								9.90		[Dotted Pattern]	# Fine grained SANDSTONE.	10
										[Dotted Pattern]	# Broken SANDSTONE.	
								11.00		[Brick Pattern]	# LIMESTONE.	11
								12.00		[Brick Pattern]	End of Borehole at 12.000m	12
												13
												14
												15
												16
												17
												18
												19

Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
3.00	139	3.00	139									0.00	9.90	Air/Mist			100
12.00	115											9.90	11.00	Air/Mist			60
												11.00	12.00	Air/Mist			100

Remarks
 # Description based on drillers records.
 Inspection pit pre dug to 1.20m and CAT scanned.





Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins		Date: 09/03/2021		
Location: Whitehaven		Contractor:				
Project No. : 3775		Crew Name: JS		Drilling Equipment: Fraste ML		
Borehole Number BH103	Hole Type RO	Level		Logged By JM	Scale 1:50	Page Number Sheet 1 of 2

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description	
				TCR	SCR	RQD						
										[Cross-hatch pattern]	# MADE GROUND.	
								0.80		[Dotted pattern]	# Fine grain yellow SANDSTONE.	1
								3.10		[Dotted pattern]	# Fine grained grey SANDSTONE.	3
								4.20		[Dotted pattern]	# Fine grained SANDSTONE.	4
								6.10		[Dotted pattern]	# Fine grained yellow SANDSTONE.	6
								7.30		[Dotted pattern]	# Fine grained grey SANDSTONE.	7
								8.60		[Dotted pattern]	# Broken SANDSTONE.	9

Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
3.00	139	3.00	139									0.00	8.60	Air/Mist			100
12.00	115											8.60	9.90	Air/Mist			60
												9.90	12.00	Air/Mist			100

Remarks
 # Description based on drillers records.
 Inspection pit pre dug to 1.20m and CAT scanned.





Rotary Core Log

Project Name: West Cumberland Hospital		Client: Curtins		Date: 09/03/2021		
Location: Whitehaven		Contractor:				
Project No. : 3775		Crew Name: JS		Drilling Equipment: Fraste ML		
Borehole Number BH103	Hole Type RO	Level		Logged By JM	Scale 1:50	Page Number Sheet 2 of 2

Well	Water	Depth (m)	Type /FI	Coring			Diameter Recovery (SPT)	Depth (m)	Level (m)	Legend	Stratum Description	
				TCR	SCR	RQD						
								9.90		[Dotted Pattern]	# Broken SANDSTONE.	
										[Dotted Pattern]	# SANDSTONE.	10
								11.20		[Dotted Pattern]		11
										[Brick Pattern]	# LIMESTONE.	
								12.00		[Brick Pattern]		12
											End of Borehole at 12.000m	13
												14
												15
												16
												17
												18
												19


Hole Diameter		Casing Diameter		Chiselling				Inclination and Orientation				Drilling Flush					
Depth Base	Diameter	Depth Base	Diameter	Depth Top	Depth Base	Duration	Tool	Depth Top	Depth Base	Inclination	Orientation	Depth Top	Depth Base	Type	Colour	Min (%)	Max (%)
3.00	139	3.00	139									0.00	8.60	Air/Mist			100
12.00	115											8.60	9.90	Air/Mist			60
												9.90	12.00	Air/Mist			100

Remarks
 # Description based on drillers records.
 Inspection pit pre dug to 1.20m and CAT scanned.







PLAN VIEW HD01

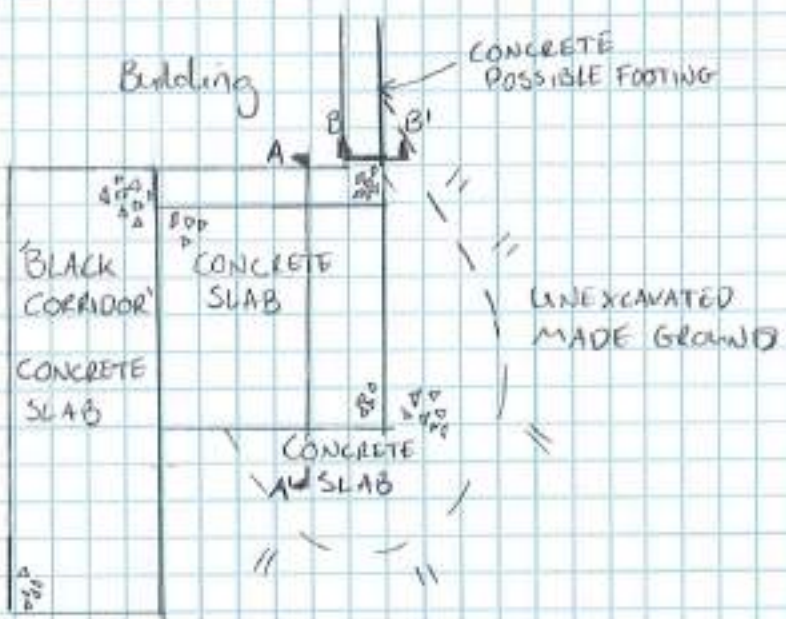

SECTION A HD01

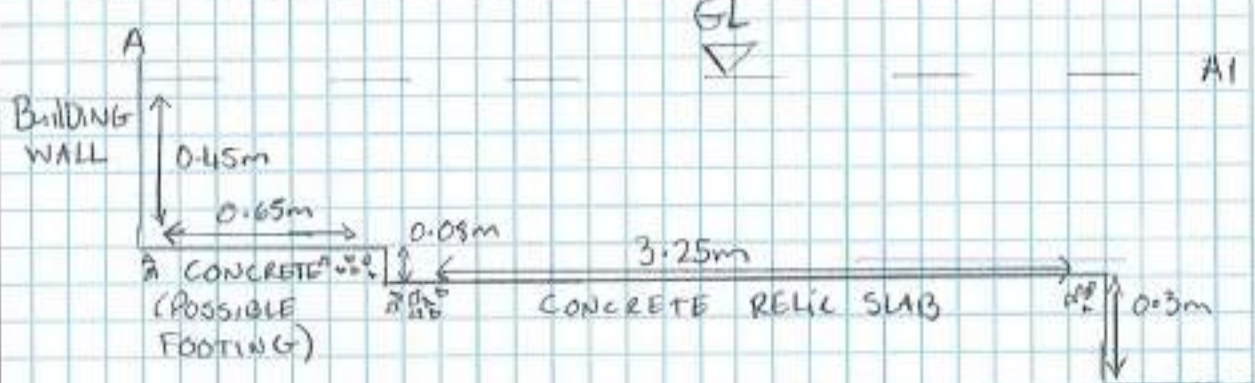


SECTION B HD01

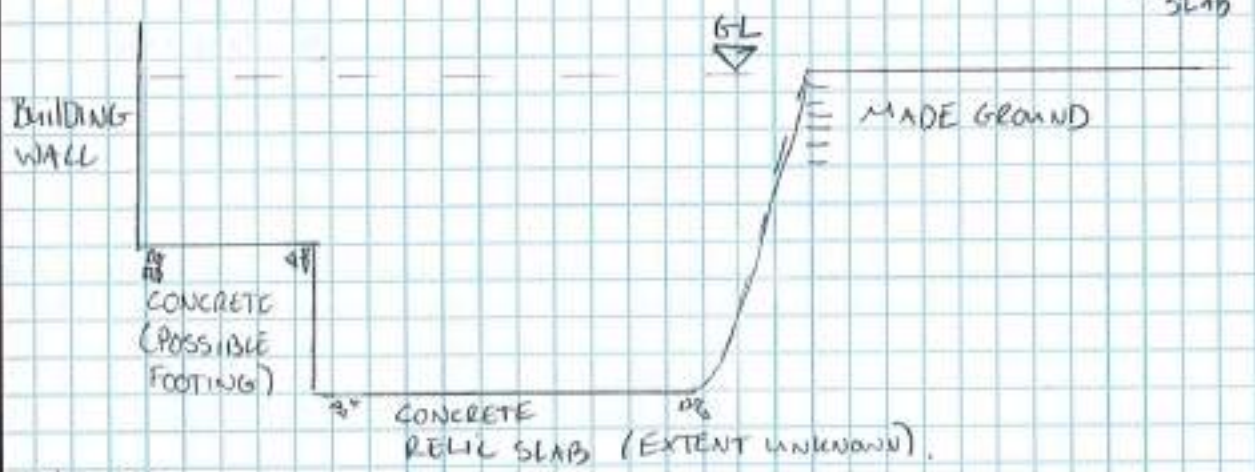

NOTES
- NOT TO SCALE.


H002 SECTION

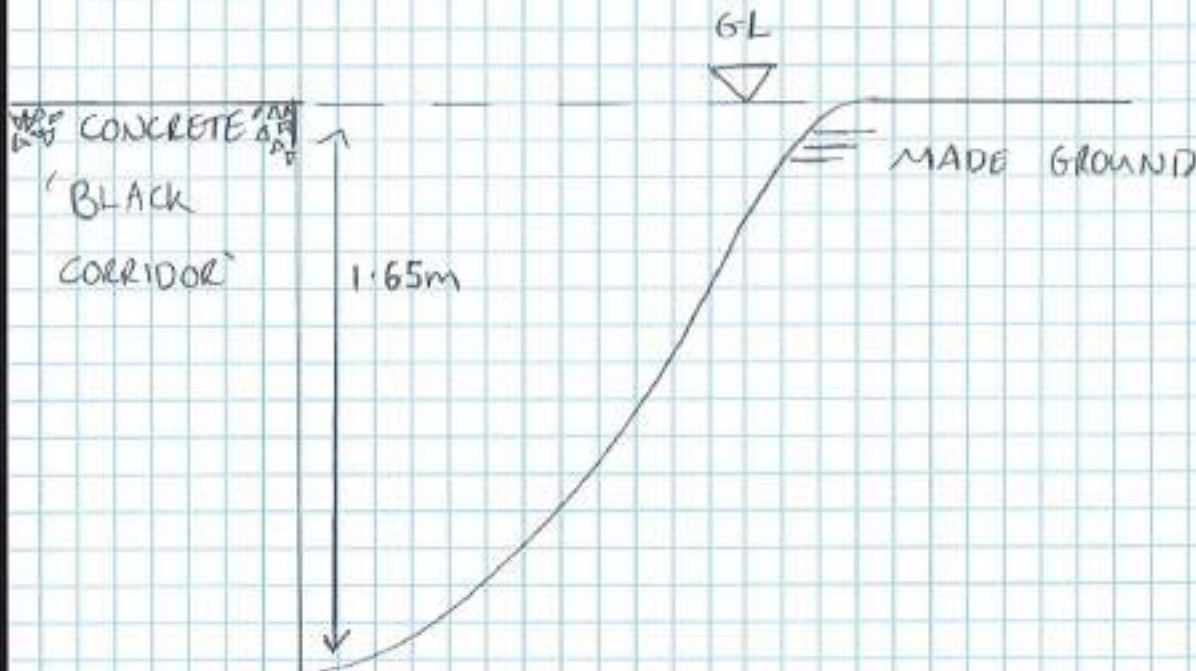

NOTES

- BASE OF CONCRETE NOT DETERMINED.
- NOT TO SCALE.


H002A SECTION

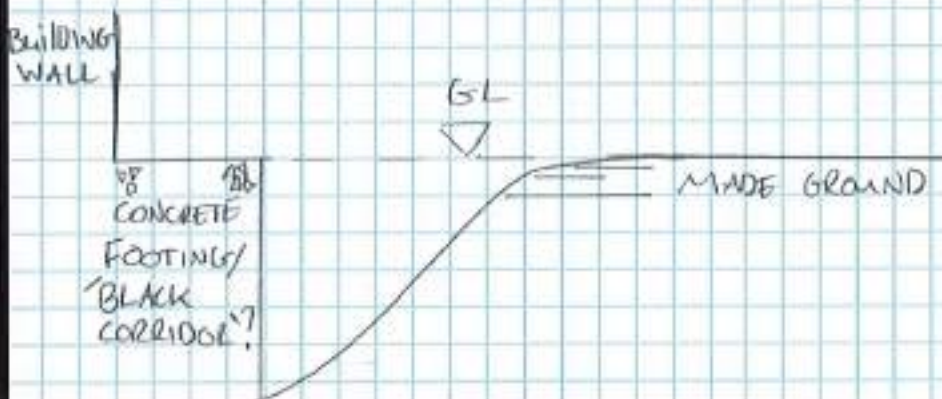

NOTES

- BASE OF CONCRETE NOT DETERMINED.
- NOT TO SCALE.


HD03 SECTION

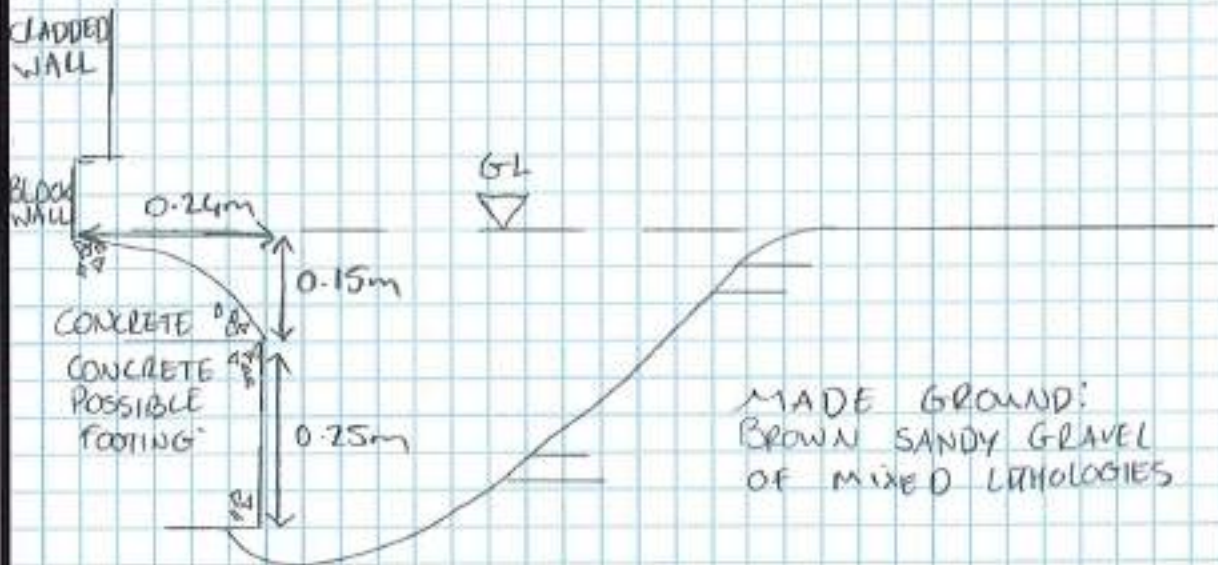

NOTES

- NOT TO SCALE

HD04 SECTION

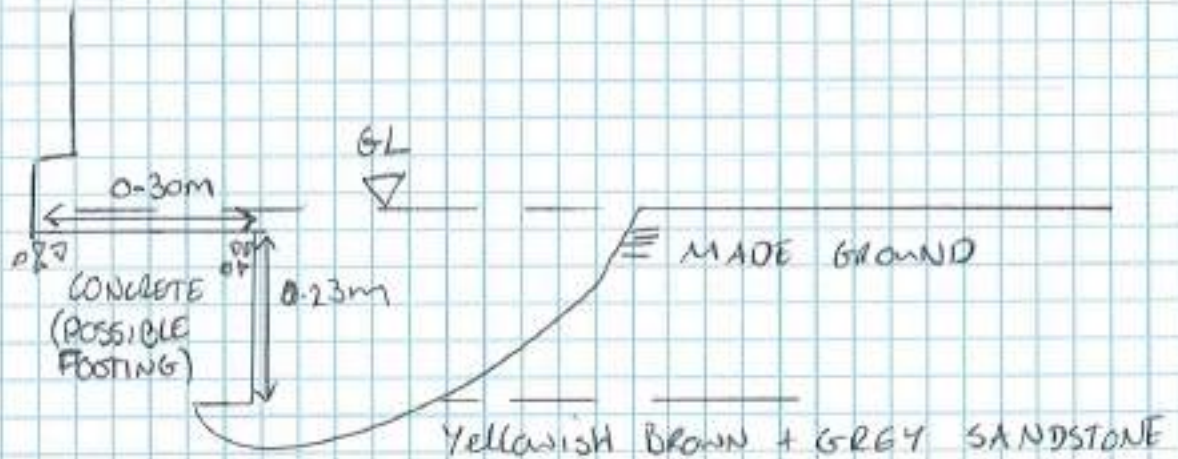

NOTES

- NOT TO SCALE

Job Title WCH

Job No: 073096


Made By: NF Checked By:

Date: 05/01/21

Sheet No: 4 of 4



H005 SECTION

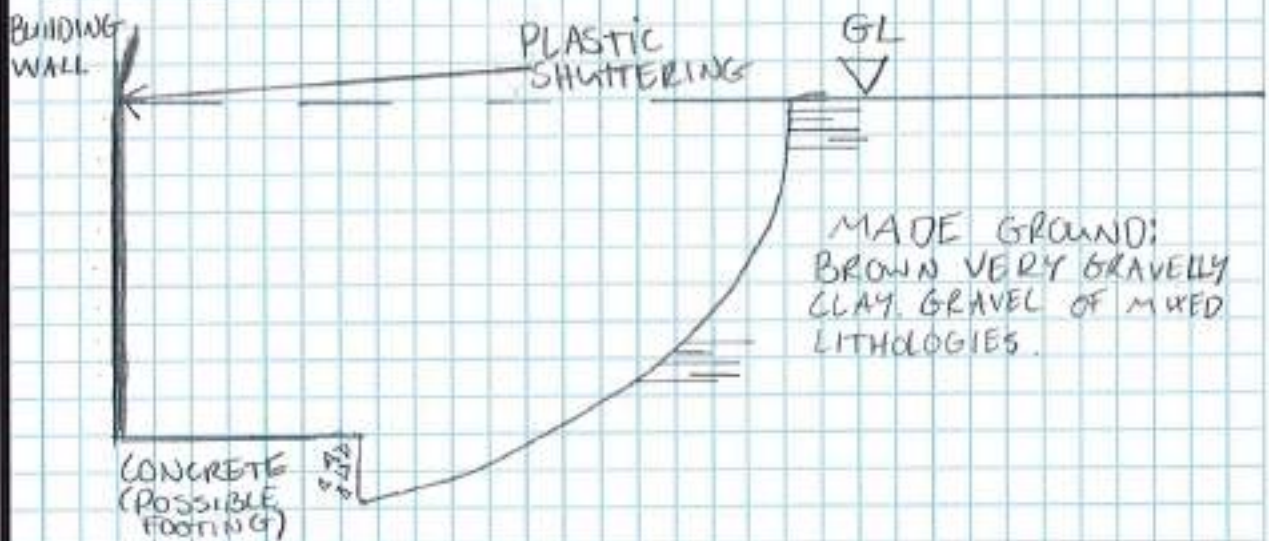

NOTES

- NOT TO SCALE
- THICKNESS OF CONCRETE NOT PROVEN.
- FORMATION STRATA NOT PROVEN.



Borehole Log

Borehole No.

BH21

Sheet 1 of 1

Project Name: West Cumberland Hospital
Additional InvestigationProject No.
073036.005

Co-ords: -

Hole Type
WS

Location: Whitehaven

Level:

Scale
1:20

Client: Graham Construction

Dates: 03/08/2021 -

Logged By
NF

Well	Water Strikes	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
		Depth (m)	Type	Results				
		0.50 - 1.00	B				MADE GROUND: Brown very gravelly fine to coarse SAND with high cobble content. Gravel is fine to coarse angular to sub-rounded of mixed lithologies including brick, concrete, cernaics, occaisional ash.Cobbles include brick, concrete. (Demo Rubble).	
		1.20 1.20 - 1.50	D	N=7 (1,1/1,1,2,3)	1.20		No core recovery.	
					1.50		MADE GROUND: Dark brown silty slightly gravelly CLAY. Gravel fine to coarse, angular to sub-rounded of coal and limestone.	
					1.70		Light brown slightly sandy, slightly gravelly CLAY. Gravel includes sandstone and limestone.	
		2.00		50 (25 for 80mm/50 for 95mm)	1.95 2.00		Grey and brown medium to coarse grained crystalline SANDSTONE (Presumed Bedrock). End of borehole at 2.00 m	

1
2
3
4

Remarks

Hand excavated service clearance pit excavated to 1.20m bgl. No groundwater recorded.





Borehole Log

Borehole No.

BH22

Sheet 1 of 1

Project Name: West Cumberland Hospital
Additional InvestigationProject No.
073036.005

Co-ords: -

Hole Type
WS

Location: Whitehaven

Level:

Scale
1:20

Client: Graham Construction

Dates: 03/08/2021 -

Logged By
NF

Well	Water Strikes	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
		Depth (m)	Type	Results				
		0.50 - 0.70	D				MADE GROUND: Brown very gravelly fine to coarse SAND with medium cobble content. Gravel is fine to coarse angular to sub-rounded of mixed lithologies including brick, concrete, cermaics, occaisional ash. Cobbles include brick, concrete. (Demo Rubble).	
		1.20		N=6 (1,2/2,2,1,1)	1.50		MADE GROUND: Purplish brown sandy gravelly CLAY with medium cobble content. Gravel includes fine to coarse angular to sub-rounded mudstone, concrete, ash. Cobbles include concrete.	
		2.00		N=30 (2,2/3,4,6,17)	2.40		Grey and brown medium to coarse grained crystalline SANDSTONE (Presumed Bedrock).	
		2.45		N=50 (25 for 95mm/50 for 280mm)	2.90		End of borehole at 2.90 m	

Remarks

Hand excavated service clearance pit excavated to 1.20m bgl. No groundwater recorded.





Borehole Log

Borehole No.

BH23

Sheet 1 of 1

Project Name: West Cumberland Hospital
Additional Investigation

Project No.
073036.005

Co-ords: -

Hole Type
WS

Location: Whitehaven

Level:

Scale
1:20

Client: Graham Construction

Dates: 03/08/2021 -

Logged By
NF

Well	Water Strikes	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
		Depth (m)	Type	Results				
					0.18 0.20		MADE GROUND: Brown slightly gravelly SAND. Gravel is fine to medium angular to sub-rounded of mixed lithologies including brick and concrete. Brown medium to coarse grained SANDSTONE (Presumed Bedrock). End of borehole at 0.20 m	



Remarks
Hand excavated service clearance pit excavated to 1.20m bgl. No groundwater recorded.





Borehole Log

Borehole No.

BH24

Sheet 1 of 1

Project Name: West Cumberland Hospital
Additional InvestigationProject No.
073036.005

Co-ords: -

Hole Type
WS

Location: Whitehaven

Level:

Scale
1:20

Client: Graham Construction

Dates: 03/08/2021 -

Logged By
NF

Well	Water Strikes	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
		Depth (m)	Type	Results				
		1.10 - 1.50 1.20	D	N=7 (1,1/1,1,2,3)			MADE GROUND: Brown gravelly slightly sandy CLAY with medium cobble content. Gravel is fine to coarse angular to sub-rounded of mixed lithologies including sandstone, brick, concrete, rare timber. Frequent Grey sandstone cobbles at 2-3m bgl.	
		2.00		N=5 (2,2/1,2,1,1)				
		3.00		N=22 (10,7/7,5,3,7)	3.00			End of borehole at 3.00 m

Remarks

Hand excavated service clearance pit excavated to rockhead. No groundwater recorded. Refusal at 3.0m bgl, possible sandstone but no recovery to confirm or otherwise.





Trial Pit Log

Trialpit No

SA01

Sheet 1 of 1

Project Name: West Cumberland Hospital Additional Investigation

Project No. 073036.005

Co-ords: -
Level:

Date 03/08/2021

Location: Whitehaven

Dimensions (m):

2.5



Scale 1:20

Client: Graham Construction

Depth 0.95

0.9

Logged NF

Water Strike	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
	Depth	Type	Results				
				0.20			MADE GROUND: Brownish grey gravelly SAND with high cobble content. Gravel is fine to coarse angular to sub-rounded of mixed lithologies including brick, concrete, sandstone, occasional re-bar. Cobbles include brick, concrete, sandstone. (Demo Rubble) Grey medium to coarse grained crystalline SANDSTONE, closely spaced fractures.
				0.95			
							End of pit at 0.95 m

1
2
3
4

Remarks: No groundwater recorded. Soakaway test (SA01) undertaken in bedrock deposits, results reported separately.

Stability: Stable.





Trial Pit Log

Trialpit No

SA02

Sheet 1 of 1

Project Name: West Cumberland Hospital Additional Investigation

Project No. 073036.005

Co-ords: -
Level:

Date 03/08/2021

Location: Whitehaven

Dimensions (m):

2.2



Scale 1:20

Client: Graham Construction

Depth 1.65

0.9

Logged NF

Water Strike	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
	Depth	Type	Results				
				0.90			MADE GROUND: Light brown sandy GRAVEL with high cobble content. Gravel is fine to coarse angular to sub-rounded of mixed lithologies including brick, concrete, sandstone, cermaics. Cobbles include brick, concrete, sandstone. (Demo Rubble).
				1.65			Light brown and grey weathered SANDSTONE. Reccovered as a sandy slightly clayey gravel of sub-rounded to angular sandstone.
							End of pit at 1.65 m

Remarks: No groundwater recorded. Soakaway test (SA02)undertaken in bedrock deposits, results reported seperately.

Stability: Stable.





Trial Pit Log

Trialpit No
TWTP01
Sheet 1 of 1

Project Name: West Cumberland Hospital Additional Investigation

Project No.
073036.005

Co-ords: -
Level:

Date
04/08/2021

Location: Whitehaven

Dimensions (m):

2.8

Client: Graham Construction

Depth
1.40



Scale
1:20
Logged
NF

Water Strike	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
	Depth	Type	Results				
	0.50 - 0.60	D					MADE GROUND: Brown and grey very sandy GRAVEL with high cobble content, occasional boulders. Gravel is fine to coarse angular to sub-rounded of mixed lithologies including brick, concrete, sandstone, cermaics, re-bar, wiring. Cobbles include brick, concrete, sandstone. (Demo Rubble). Concrete obstruction at 0.60m across part of pit, pit extended to the west where concrete wasnt present.
				0.90			Grey and brown SANDSTONE, slightly weathered, with clayey infill between fractures.
				1.40			End of pit at 1.40 m

Remarks: No groundwater recorded. Soakaway test (SA03) undertaken in bedrock deposits, results reported seperately.

Stability: Stable





Trial Pit Log

Trialpit No
TWTP02
Sheet 1 of 1

Project Name: West Cumberland Hospital Additional Investigation

Project No.
073036.005

Co-ords: -
Level:

Date
04/08/2021

Location: Whitehaven

Dimensions (m):

2.5

Scale
1:20

Client: Graham Construction

Depth
1.05



Logged
NF

Water Strike	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
	Depth	Type	Results				
	0.30 - 0.40	D					MADE GROUND: Brown very sandy GRAVEL with high cobble content, occasional boulders. Gravel is fine to coarse angular to sub-rounded of mixed lithologies including brick, concrete, sandstone, cermaics, re-bar, wiring. Cobbles include brick, concrete, sandstone. (Demo Rubble).
				0.90			Grey medium to coarse grained crystalline SANDSTONE, light brown laminations.
				1.05			End of pit at 1.05 m

Remarks: No groundwater recorded.

Stability: Some side wall instability in fill.





Trial Pit Log

Trialpit No
TWTP03
Sheet 1 of 1

Project Name: West Cumberland Hospital Additional Investigation

Project No.
073036.005

Co-ords: -
Level:

Date
04/08/2021

Location: Whitehaven

Dimensions (m):

2.5


Client: Graham Construction

Depth
1.90



Scale
1:20
Logged
NF

Water Strike	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
	Depth	Type	Results				
	0.90 - 1.00	D		1.90			MADE GROUND: Brown very sandy GRAVEL with high cobble content, occasional boulders. Gravel is fine to coarse angular to sub-rounded of mixed lithologies including brick, concrete, sandstone, occasional wiring, timber pieces and copper pipe fragments. Cobbles include brick, concrete, sandstone. (Demo Rubble).



End of pit at 1.90 m

Remarks: No groundwater recorded.

Stability: Some side wall instability in fill.





Trial Pit Log

Trialpit No
TWTP04
Sheet 1 of 1


Project Name: West Cumberland Hospital Additional Investigation

Project No.
073036.005

Co-ords: -
Level:

Date
04/08/2021

Location: Whitehaven



Scale
1:20
Logged
NF

Client: Graham Construction

Water Strike	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
	Depth	Type	Results				
				0.70			MADE GROUND: Grey brown very sandy GRAVEL with high cobble content, occasional boulders. Gravel is fine to coarse angular to sub-rounded of mixed lithologies including brick, concrete, sandstone, glass. Cobbles include brick, breeze block, concrete, sandstone. (Demo Rubble).
	1.40 - 1.50	D		1.80			MADE GROUND: Brown very gravelly slightly clayey SAND with medium cobble content. Gravel is fine to coarse angular to sub-rounded of mixed lithologies including brick, concrete, sandstone, cermaics, re-bar, wiring. Cobbles include brick, concrete, sandstone. Occasional clayey nodules (Demo Rubble).
							End of pit at 1.80 m

Remarks: No groundwater recorded.

Stability: Some side wall instability in fill.





Appendix C – Chemical Laboratory Testing Results


FINAL ANALYTICAL TEST REPORT

Envirolab Job Number: 20/10811
Issue Number: 1
Date: 18 January, 2021

Client: Curtins Consulting (Manchester)
Merchant Exchange
17-19 Whitworth Street
Manchester
UK
M1 5WG

Project Manager: Joe James/Matthew Holroyd
Project Name: WC. Hospital
Project Ref: B073096
Order No: EBED60
Date Samples Received: 14/12/20
Date Instructions Received: 14/12/20
Date Analysis Completed: 18/01/21

Prepared by:



Melanie Marshall
Laboratory Coordinator

Approved by:



Sophie France
Client Service Manager

Envirolab Job Number: 20/10811

Client Project Name: WC. Hospital

Client Project Ref: B073096

Lab Sample ID	20/10811/1	20/10811/2	20/10811/3	20/10811/4	20/10811/5	20/10811/6	20/10811/7	Units	Limit of Detection	Method ref
Client Sample No	1	1	1	1	1	1	1			
Client Sample ID	BH01	WS05	WS01	WS07	BH04	BH02A	BH03			
Depth to Top	0.35	0.50	0.40	0.50	0.40	0.40	0.70			
Depth To Bottom										
Date Sampled	08-Dec-20	08-Dec-20	09-Dec-20	09-Dec-20	08-Dec-20	07-Dec-20	08-Dec-20			
Sample Type	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES			
Sample Matrix Code	5A	6A	5A	4A	4A	4AE	4AE			
% Stones >10mm _A	15.9	23.1	1.3	38.6	21.4	20.8	13.6			
pH _D ^{M#}	10.43	9.72	8.32	10.77	10.40	9.19	9.42	pH	0.01	A-T-031s
Sulphate (water sol 2:1) _D ^{M#}	0.57	0.55	0.19	1.04	0.64	0.27	0.48	g/l	0.01	A-T-026s
Cyanide (total) _A ^{M#}	<1	<1	<1	<1	<1	<1	<1	mg/kg	1	A-T-042sTCN
Phenols - Total by HPLC _A	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	mg/kg	0.2	A-T-050s
Organic matter _D ^{M#}	1.0	0.8	2.6	2.9	1.2	2.5	0.9	% w/w	0.1	A-T-032 OM
Arsenic _D ^{M#}	5	6	8	2	5	7	10	mg/kg	1	A-T-024s
Boron (water soluble) _D	2.3	1.8	<1.0	1.4	1.7	<1.0	1.0	mg/kg	1	A-T-027s
Cadmium _D ^{M#}	0.6	0.5	1.2	0.6	<0.5	<0.5	0.6	mg/kg	0.5	A-T-024s
Copper _D ^{M#}	16	18	16	14	14	11	15	mg/kg	1	A-T-024s
Chromium _D ^{M#}	18	12	20	17	13	10	10	mg/kg	1	A-T-024s
Chromium (hexavalent) _D	<1	<1	<1	<1	<1	<1	<1	mg/kg	1	A-T-040s
Lead _D ^{M#}	43	47	21	64	39	21	27	mg/kg	1	A-T-024s
Mercury _D	0.98	0.68	<0.17	1.34	0.62	0.23	0.22	mg/kg	0.17	A-T-024s
Nickel _D ^{M#}	12	9	12	12	12	8	15	mg/kg	1	A-T-024s
Selenium _D ^{M#}	<1	<1	2	1	<1	<1	<1	mg/kg	1	A-T-024s
Zinc _D ^{M#}	52	46	22	64	41	17	21	mg/kg	5	A-T-024s

Envirolab Job Number: 20/10811

Client Project Name: WC. Hospital

Client Project Ref: B073096

Lab Sample ID	20/10811/1	20/10811/2	20/10811/3	20/10811/4	20/10811/5	20/10811/6	20/10811/7	Units	Limit of Detection	Method ref			
Client Sample No	1	1	1	1	1	1	1						
Client Sample ID	BH01	WS05	WS01	WS07	BH04	BH02A	BH03						
Depth to Top	0.35	0.50	0.40	0.50	0.40	0.40	0.70						
Depth To Bottom													
Date Sampled	08-Dec-20	08-Dec-20	09-Dec-20	09-Dec-20	08-Dec-20	07-Dec-20	08-Dec-20						
Sample Type	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES						
Sample Matrix Code	5A	6A	5A	4A	4A	4AE	4AE						
Asbestos in Soil (inc. matrix)													
Asbestos in soil [#]	NAD	NAD	NAD	NAD	NAD	NAD	NAD			A-T-045			
Asbestos ACM - Suitable for Water Absorption Test? _D	N/A	N/A	N/A	N/A	N/A	N/A	N/A			A-T-045			

Envirolab Job Number: 20/10811

Client Project Name: WC. Hospital

Client Project Ref: B073096

Lab Sample ID	20/10811/1	20/10811/2	20/10811/3	20/10811/4	20/10811/5	20/10811/6	20/10811/7	Units	Limit of Detection	Method ref
Client Sample No	1	1	1	1	1	1	1			
Client Sample ID	BH01	WS05	WS01	WS07	BH04	BH02A	BH03			
Depth to Top	0.35	0.50	0.40	0.50	0.40	0.40	0.70			
Depth To Bottom										
Date Sampled	08-Dec-20	08-Dec-20	09-Dec-20	09-Dec-20	08-Dec-20	07-Dec-20	08-Dec-20			
Sample Type	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES			
Sample Matrix Code	5A	6A	5A	4A	4A	4AE	4AE			
PAH-16MS (MSD order)										
Naphthalene _A ^{M#}	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03	mg/kg	0.03	A-T-019s
Acenaphthylene _A ^{M#}	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-019s
Acenaphthene _A ^{M#}	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-019s
Fluorene _A ^{M#}	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-019s
Phenanthrene _A ^{M#}	<0.03	<0.03	<0.03	0.03	0.08	0.20	<0.03	mg/kg	0.03	A-T-019s
Anthracene _A ^{M#}	<0.02	<0.02	<0.02	<0.02	<0.02	0.03	<0.02	mg/kg	0.02	A-T-019s
Fluoranthene _A ^{M#}	<0.08	<0.08	<0.08	<0.08	<0.08	0.16	<0.08	mg/kg	0.08	A-T-019s
Pyrene _A ^{M#}	<0.07	<0.07	<0.07	<0.07	<0.07	0.11	<0.07	mg/kg	0.07	A-T-019s
Benzo(a)anthracene _A ^{M#}	<0.04	<0.04	<0.04	<0.04	<0.04	<0.04	<0.04	mg/kg	0.04	A-T-019s
Chrysene _A ^{M#}	<0.06	<0.06	<0.06	<0.06	<0.06	<0.06	<0.06	mg/kg	0.06	A-T-019s
Benzo(b)fluoranthene _A ^{M#}	<0.05	<0.05	<0.05	<0.05	<0.05	<0.05	<0.05	mg/kg	0.05	A-T-019s
Benzo(k)fluoranthene _A ^{M#}	<0.07	<0.07	<0.07	<0.07	<0.07	<0.07	<0.07	mg/kg	0.07	A-T-019s
Benzo(a)pyrene _A ^{M#}	<0.04	<0.04	<0.04	<0.04	<0.04	<0.04	<0.04	mg/kg	0.04	A-T-019s
Indeno(123-cd)pyrene _A ^{M#}	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03	<0.03	mg/kg	0.03	A-T-019s
Dibenzo(ah)anthracene _A ^{M#}	<0.04	<0.04	<0.04	<0.04	<0.04	<0.04	<0.04	mg/kg	0.04	A-T-019s
Benzo(ghi)perylene _A ^{M#}	<0.05	<0.05	<0.05	<0.05	<0.05	<0.05	<0.05	mg/kg	0.05	A-T-019s
Total PAH-16MS (MSD order) _A ^{M#}	<0.08	<0.08	<0.08	<0.08	0.08	0.50	<0.08	mg/kg	0.03	A-T-019s

Envirolab Job Number: 20/10811

Client Project Name: WC. Hospital

Client Project Ref: B073096

Lab Sample ID	20/10811/1	20/10811/2	20/10811/3	20/10811/4	20/10811/5	20/10811/6	20/10811/7	Units	Limit of Detection	Method ref
Client Sample No	1	1	1	1	1	1	1			
Client Sample ID	BH01	WS05	WS01	WS07	BH04	BH02A	BH03			
Depth to Top	0.35	0.50	0.40	0.50	0.40	0.40	0.70			
Depth To Bottom										
Date Sampled	08-Dec-20	08-Dec-20	09-Dec-20	09-Dec-20	08-Dec-20	07-Dec-20	08-Dec-20			
Sample Type	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES			
Sample Matrix Code	5A	6A	5A	4A	4A	4AE	4AE			
TPH CWG										
Ali >C5-C6 _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
Ali >C6-C8 _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
Ali >C8-C10 _A	<1	<1	<1	<1	<1	<1	<1	mg/kg	1	A-T-055s
Ali >C10-C12 _A ^{M#}	<1	<1	<1	<1	<1	<1	<1	mg/kg	1	A-T-055s
Ali >C12-C16 _A ^{M#}	2	<1	<1	<1	<1	<1	<1	mg/kg	1	A-T-055s
Ali >C16-C21 _A ^{M#}	4	<1	<1	2	2	<1	<1	mg/kg	1	A-T-055s
Ali >C21-C35 _A ^{M#}	36	11	<1	39	35	6	4	mg/kg	1	A-T-055s
Total Aliphatics _A	42	12	<1	42	38	6	4	mg/kg	1	A-T-055s
Aro >C5-C7 _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
Aro >C7-C8 _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
Aro >C8-C10 _A	3	<1	<1	15	7	<1	<1	mg/kg	1	A-T-055s
Aro >C10-C12 _A	<1	<1	<1	<1	<1	<1	<1	mg/kg	1	A-T-055s
Aro >C12-C16 _A	2	<1	<1	1	2	<1	<1	mg/kg	1	A-T-055s
Aro >C16-C21 _A ^{M#}	4	2	<1	6	5	<1	<1	mg/kg	1	A-T-055s
Aro >C21-C35 _A ^{M#}	18	7	<1	21	24	6	2	mg/kg	1	A-T-055s
Total Aromatics _A	27	9	<1	44	40	7	2	mg/kg	1	A-T-055s
TPH (Ali & Aro >C5-C35) _A	69	21	<1	86	78	13	6	mg/kg	1	A-T-055s
BTEX - Benzene _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
BTEX - Toluene _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
BTEX - Ethyl Benzene _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
BTEX - m & p Xylene _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
BTEX - o Xylene _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s
MTBE _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	mg/kg	0.01	A-T-022s

Envirolab Job Number: 20/10811

Client Project Name: WC. Hospital

Client Project Ref: B073096

Lab Sample ID	20/10811/8	20/10811/9	20/10811/10	20/10811/11	20/10811/12	20/10811/13		Units	Limit of Detection	Method ref
Client Sample No	1	1	1	1	1	1				
Client Sample ID	WS03	WS06	HP01	WS04	BH05	WS01				
Depth to Top	0.40	0.45	0.50	0.40	1.20	1.70				
Depth To Bottom					1.40	3.00				
Date Sampled	07-Dec-20	08-Dec-20	08-Dec-20	07-Dec-20	08-Dec-20	09-Dec-20				
Sample Type	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Solid				
Sample Matrix Code	4AE	4A	4AE	4A	4A	7				
% Stones >10mm _A	21.6	10.6	18.8	18.7	16.5	<0.1				
pH _D ^{M#}	10.84	11.22	10.68	10.04	10.73	8.63		pH	0.01	A-T-031s
Sulphate (water sol 2:1) _D ^{M#}	0.86	0.57	0.75	0.63	0.28	0.03		g/l	0.01	A-T-026s
Cyanide (total) _A ^{M#}	<1	<1	<1	<1	<1	-		mg/kg	1	A-T-042sTCN
Phenols - Total by HPLC _A	<0.2	<0.2	<0.2	<0.2	<0.2	-		mg/kg	0.2	A-T-050s
Organic matter _D ^{M#}	1.2	1.8	0.9	1.1	0.2	-		% w/w	0.1	A-T-032 OM
Arsenic _D ^{M#}	3	5	4	9	6	-		mg/kg	1	A-T-024s
Boron (water soluble) _D	2.4	2.8	2.7	2.2	1.4	-		mg/kg	1	A-T-027s
Cadmium _D ^{M#}	0.8	0.7	0.7	0.7	<0.5	-		mg/kg	0.5	A-T-024s
Copper _D ^{M#}	17	22	19	24	8	-		mg/kg	1	A-T-024s
Chromium _D ^{M#}	17	21	17	15	7	-		mg/kg	1	A-T-024s
Chromium (hexavalent) _D	<1	<1	<1	<1	<1	-		mg/kg	1	A-T-040s
Lead _D ^{M#}	71	106	54	50	19	-		mg/kg	1	A-T-024s
Mercury _D	1.73	1.98	1.76	0.75	0.33	-		mg/kg	0.17	A-T-024s
Nickel _D ^{M#}	14	14	11	11	4	-		mg/kg	1	A-T-024s
Selenium _D ^{M#}	<1	<1	<1	<1	<1	-		mg/kg	1	A-T-024s
Zinc _D ^{M#}	77	272	169	37	15	-		mg/kg	5	A-T-024s
1.10a PSD (Grading/63um/sand fraction/wet sieve) BS1377 pt 2 1990 cl 9.2 _A [#]	-	-	-	-	-	Appended		%	0.1	Subcon SS

Envirolab Job Number: 20/10811

Client Project Name: WC. Hospital

Client Project Ref: B073096

Lab Sample ID	20/10811/8	20/10811/9	20/10811/10	20/10811/11	20/10811/12	20/10811/13		Units	Limit of Detection	Method ref
Client Sample No	1	1	1	1	1	1				
Client Sample ID	WS03	WS06	HP01	WS04	BH05	WS01				
Depth to Top	0.40	0.45	0.50	0.40	1.20	1.70				
Depth To Bottom					1.40	3.00				
Date Sampled	07-Dec-20	08-Dec-20	08-Dec-20	07-Dec-20	08-Dec-20	09-Dec-20				
Sample Type	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Solid				
Sample Matrix Code	4AE	4A	4AE	4A	4A	7				
Asbestos in Soil (inc. matrix)										
Asbestos in soil [#]	NAD	NAD	NAD	NAD	NAD	-				A-T-045
Asbestos ACM - Suitable for Water Absorption Test? _D	N/A	N/A	N/A	N/A	N/A	-				A-T-045

Envirolab Job Number: 20/10811

Client Project Name: WC. Hospital

Client Project Ref: B073096

Lab Sample ID	20/10811/8	20/10811/9	20/10811/10	20/10811/11	20/10811/12	20/10811/13		Units	Limit of Detection	Method ref
Client Sample No	1	1	1	1	1	1				
Client Sample ID	WS03	WS06	HP01	WS04	BH05	WS01				
Depth to Top	0.40	0.45	0.50	0.40	1.20	1.70				
Depth To Bottom					1.40	3.00				
Date Sampled	07-Dec-20	08-Dec-20	08-Dec-20	07-Dec-20	08-Dec-20	09-Dec-20				
Sample Type	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Solid				
Sample Matrix Code	4AE	4A	4AE	4A	4A	7				
PAH-16MS (MSD order)										
Naphthalene _A ^{M#}	<0.03	<0.03	<0.03	<0.03	<0.03	-	mg/kg	0.03	A-T-019s	
Acenaphthylene _A ^{M#}	<0.01	<0.01	<0.01	<0.01	<0.01	-	mg/kg	0.01	A-T-019s	
Acenaphthene _A ^{M#}	<0.01	0.01	<0.01	<0.01	<0.01	-	mg/kg	0.01	A-T-019s	
Fluorene _A ^{M#}	0.02	0.01	0.02	<0.01	<0.01	-	mg/kg	0.01	A-T-019s	
Phenanthrene _A ^{M#}	0.08	0.14	0.19	0.06	<0.03	-	mg/kg	0.03	A-T-019s	
Anthracene _A ^{M#}	<0.02	<0.02	0.03	<0.02	<0.02	-	mg/kg	0.02	A-T-019s	
Fluoranthene _A ^{M#}	0.08	0.16	0.32	<0.08	<0.08	-	mg/kg	0.08	A-T-019s	
Pyrene _A ^{M#}	0.08	0.14	0.28	<0.07	<0.07	-	mg/kg	0.07	A-T-019s	
Benzo(a)anthracene _A ^{M#}	<0.04	0.06	0.14	<0.04	<0.04	-	mg/kg	0.04	A-T-019s	
Chrysene _A ^{M#}	0.07	0.11	0.18	<0.06	<0.06	-	mg/kg	0.06	A-T-019s	
Benzo(b)fluoranthene _A ^{M#}	<0.05	0.05	0.10	<0.05	<0.05	-	mg/kg	0.05	A-T-019s	
Benzo(k)fluoranthene _A ^{M#}	<0.07	<0.07	<0.07	<0.07	<0.07	-	mg/kg	0.07	A-T-019s	
Benzo(a)pyrene _A ^{M#}	<0.04	<0.04	0.06	<0.04	<0.04	-	mg/kg	0.04	A-T-019s	
Indeno(123-cd)pyrene _A ^{M#}	<0.03	<0.03	0.04	<0.03	<0.03	-	mg/kg	0.03	A-T-019s	
Dibenzo(ah)anthracene _A ^{M#}	<0.04	<0.04	<0.04	<0.04	<0.04	-	mg/kg	0.04	A-T-019s	
Benzo(ghi)perylene _A ^{M#}	<0.05	<0.05	<0.05	<0.05	<0.05	-	mg/kg	0.05	A-T-019s	
Total PAH-16MS (MSD order) _A ^{M#}	0.33	0.68	1.36	<0.08	<0.08	-	mg/kg	0.03	A-T-019s	

Envirolab Job Number: 20/10811

Client Project Name: WC. Hospital

Client Project Ref: B073096

Lab Sample ID	20/10811/8	20/10811/9	20/10811/10	20/10811/11	20/10811/12	20/10811/13		Units	Limit of Detection	Method ref
Client Sample No	1	1	1	1	1	1				
Client Sample ID	WS03	WS06	HP01	WS04	BH05	WS01				
Depth to Top	0.40	0.45	0.50	0.40	1.20	1.70				
Depth To Bottom					1.40	3.00				
Date Sampled	07-Dec-20	08-Dec-20	08-Dec-20	07-Dec-20	08-Dec-20	09-Dec-20				
Sample Type	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Soil - ES	Solid				
Sample Matrix Code	4AE	4A	4AE	4A	4A	7				
TPH CWG										
Ali >C5-C6 _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	-	mg/kg	0.01	A-T-022s	
Ali >C6-C8 _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	-	mg/kg	0.01	A-T-022s	
Ali >C8-C10 _A	<1	<1	<1	<1	<1	-	mg/kg	1	A-T-055s	
Ali >C10-C12 _A ^{M#}	3	<1	<1	<1	<1	-	mg/kg	1	A-T-055s	
Ali >C12-C16 _A ^{M#}	13	2	5	2	<1	-	mg/kg	1	A-T-055s	
Ali >C16-C21 _A ^{M#}	15	4	10	2	<1	-	mg/kg	1	A-T-055s	
Ali >C21-C35 _A ^{M#}	67	48	117	11	2	-	mg/kg	1	A-T-055s	
Total Aliphatics _A	99	54	131	15	2	-	mg/kg	1	A-T-055s	
Aro >C5-C7 _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	-	mg/kg	0.01	A-T-022s	
Aro >C7-C8 _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	-	mg/kg	0.01	A-T-022s	
Aro >C8-C10 _A	14	15	6	3	<1	-	mg/kg	1	A-T-055s	
Aro >C10-C12 _A	2	<1	<1	<1	<1	-	mg/kg	1	A-T-055s	
Aro >C12-C16 _A	8	2	4	2	<1	-	mg/kg	1	A-T-055s	
Aro >C16-C21 _A ^{M#}	8	5	8	3	<1	-	mg/kg	1	A-T-055s	
Aro >C21-C35 _A ^{M#}	30	25	34	9	<1	-	mg/kg	1	A-T-055s	
Total Aromatics _A	62	47	51	16	<1	-	mg/kg	1	A-T-055s	
TPH (Ali & Aro >C5-C35) _A	161	101	183	31	3	-	mg/kg	1	A-T-055s	
BTEX - Benzene _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	-	mg/kg	0.01	A-T-022s	
BTEX - Toluene _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	-	mg/kg	0.01	A-T-022s	
BTEX - Ethyl Benzene _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	-	mg/kg	0.01	A-T-022s	
BTEX - m & p Xylene _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	-	mg/kg	0.01	A-T-022s	
BTEX - o Xylene _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	-	mg/kg	0.01	A-T-022s	
MTBE _A [#]	<0.01	<0.01	<0.01	<0.01	<0.01	-	mg/kg	0.01	A-T-022s	

REPORT NOTES

General

This report shall not be reproduced, except in full, without written approval from Envirolab.

The results reported herein relate only to the material supplied to the laboratory.

The residue of any samples contained within this report, and any received with the same delivery, will be disposed of six weeks after initial scheduling. For samples tested for Asbestos we will retain a portion of the dried sample for a minimum of six months after the initial Asbestos testing is completed.

Analytical results reflect the quality of the sample at the time of analysis only.

Opinions and interpretations expressed are outside the scope of our accreditation.

If results are in italic font they are associated with an AQC failure, these are not accredited and are unreliable.

A deviating samples report is appended and will indicate if samples or tests have been found to be deviating. Any test results affected may not be an accurate record of the concentration at the time of sampling and, as a result, may be invalid.

The Client Sample No, Client Sample ID, Depth to Top, Depth to Bottom and Date Sampled were all provided by the client.

Soil chemical analysis:

All results are reported as dry weight (<40°C).

For samples with Matrix Codes 1 - 6 natural stones, brick and concrete fragments >10mm and any extraneous material (visible glass, metal or twigs) are removed and excluded from the sample prior to analysis and reported results corrected to a whole sample basis. This is reported as '% stones >10mm'.

For samples with Matrix Code 7 the whole sample is dried and crushed prior to analysis and this supersedes any "A" subscripts

All analysis is performed on the sample as received for soil samples which are positive for asbestos or the client has informed asbestos may be present and/or if they are from outside the European Union and this supersedes any "D" subscripts.

TPH analysis of water by method A-T-007:

Free and visible oils are excluded from the sample used for analysis so that the reported result represents the dissolved phase only.

Electrical Conductivity of water by Method A-T-037:

Results greater than 12900µS/cm @ 25°C / 1155µS/cm @ 20°C fall outside the calibration range and as such are unaccredited.

Asbestos:

Asbestos in soil analysis is performed on a dried aliquot of the submitted sample and cannot guarantee to identify asbestos if only present in small numbers as discrete fibres/fragments in the original sample.

Stones etc. are not removed from the sample prior to analysis.

Quantification of asbestos is a 3 stage process including visual identification, hand picking and weighing and fibre counting by sedimentation/phase contrast optical microscopy if required. If asbestos is identified as being present but is not in a form that is suitable for analysis by hand picking and weighing (normally if the asbestos is present as free fibres) quantification by sedimentation is performed. Where ACMs are found a percentage asbestos is assigned to each with reference to 'HSG264, Asbestos: The survey guide' and the calculated asbestos content is expressed as a percentage of the dried soil sample aliquot used.

Predominant Matrix Codes:

1 = SAND, 2 = LOAM, 3 = CLAY, 4 = LOAM/SAND, 5 = SAND/CLAY, 6 = CLAY/LOAM, 7 = OTHER, 8 = Asbestos bulk ID sample.

Samples with Matrix Code 7 & 8 are not predominantly a SAND/LOAM/CLAY mix and are not covered by our BSEN 17025 or MCERTS accreditations, with the exception of bulk asbestos which are BSEN 17025 accredited.

Secondary Matrix Codes:

A = contains stones, B = contains construction rubble, C = contains visible hydrocarbons, D = contains glass/metal,

E = contains roots/twigs.

Key:

IS indicates Insufficient Sample for analysis.

US indicates Unsuitable Sample for analysis.

NDP indicates No Determination Possible.

NAD indicates No Asbestos Detected.

N/A indicates Not Applicable.

Superscript # indicates method accredited to ISO 17025.

Superscript "M" indicates method accredited to MCERTS.

Subscript "A" indicates analysis performed on the sample as received.

Subscript "D" indicates analysis performed on the dried sample, crushed to pass a 2mm sieve

Please contact us if you need any further information.

Envirolab Deviating Samples Report

Units 7&8 Sandpits Business Park, Mottram Road, Hyde, SK14 3AR
Tel. 0161 368 4921 email. ask@envlab.co.uk

Client:	Curtins Consulting (Manchester), Merchant Exchange, 17-19 Whitworth Street , Manchester, UK, M1 5WG	Project No:	20/10811
Project:	WC. Hospital	Date Received:	14/12/2020 (am)
Clients Project No:	B073096	Cool Box Temperatures (°C):	7.9

NO DEVIATIONS IDENTIFIED

If, at any point before reaching the laboratory, the temperature of the samples has breached those set in published standards, e.g. BS-EN 5667-3, ISO 18400-102:2017, then the concentration of any affected analytes may differ from that at the time of sampling.

FINAL ANALYTICAL TEST REPORT

Envirolab Job Number: 21/00605
Issue Number: 1 **Date:** 28 January, 2021

Client: Curtins Consulting (Manchester)
Merchant Exchange
17-19 Whitworth Street
Manchester
UK
M1 5WG

Project Manager: Joe James
Project Name: West Cumberland Hospital
Project Ref: 73096
Order No: EBMA2667
Date Samples Received: 21/01/21
Date Instructions Received: 21/01/21
Date Analysis Completed: 28/01/21

Prepared by:



Melanie Marshall
Laboratory Coordinator

Approved by:



Danielle Brierley
Client Manager

Envirolab Job Number: 21/00605

Client Project Name: West Cumberland Hospital

Client Project Ref: 73096

Lab Sample ID	21/00605/1	21/00605/2	21/00605/3					Units	Limit of Detection	Method ref
Client Sample No	1	2	3							
Client Sample ID	BH01	BH06	BH03							
Depth to Top	0.50	0.50	1.50							
Depth To Bottom										
Date Sampled	20-Jan-21	20-Jan-21	20-Jan-21							
Sample Type	Water - EW	Water - EW	Water - EW							
Sample Matrix Code	N/A	N/A	N/A							
pH (w) _A [#]	11.65	11.37	11.25							
Hardness Total _A [#]	276	137	250					mg/l Ca CO ₃	2	A-T-049w
Sulphate (w) _A [#]	52	124	250					mg/l	1	A-T-026w
Cyanide (total) (w) _A [#]	<0.005	<0.005	<0.005					mg/l	0.005	A-T-042wTCN
Phenols - Total by HPLC (w) _A	<0.01	0.17	<0.01					mg/l	0.01	A-T-050w
Sulphide (w) _A	<0.1	5.8	<0.1					mg/l	0.1	A-T-S2-w
DOC (w) _A [#]	4.5	17.0	8.3					mg/l	0.2	A-T-032w
Arsenic (dissolved) _A [#]	4	31	5					µg/l	1	A-T-025w
Boron (dissolved) _A [#]	17	17	16					µg/l	10	A-T-025w
Cadmium (dissolved) _A [#]	<0.2	<0.2	<0.2					µg/l	0.2	A-T-025w
Calcium (dissolved) _A [#]	110	54	100					mg/l	1	A-T-049w
Copper (dissolved) _A [#]	11	3	15					µg/l	1	A-T-025w
Chromium (dissolved) _A [#]	11	9	13					µg/l	1	A-T-025w
Lead (dissolved) _A [#]	<1	<1	<1					µg/l	1	A-T-025w
Mercury (dissolved) _A [#]	<0.1	<0.1	<0.1					µg/l	0.1	A-T-025w
Nickel (dissolved) _A [#]	2	14	3					µg/l	1	A-T-025w
Selenium (dissolved) _A [#]	1	1	2					µg/l	1	A-T-025w
Zinc (dissolved) _A [#]	<1	2	20					µg/l	1	A-T-025w

Envirolab Job Number: 21/00605

Client Project Name: West Cumberland Hospital

Client Project Ref: 73096

Lab Sample ID	21/00605/1	21/00605/2	21/00605/3					Units	Limit of Detection	Method ref
Client Sample No	1	2	3							
Client Sample ID	BH01	BH06	BH03							
Depth to Top	0.50	0.50	1.50							
Depth To Bottom										
Date Sampled	20-Jan-21	20-Jan-21	20-Jan-21							
Sample Type	Water - EW	Water - EW	Water - EW							
Sample Matrix Code	N/A	N/A	N/A							
PAH 16MS (w)										
Acenaphthene (w) _A [#]	0.02	0.02	0.02					µg/l	0.01	A-T-019w
Acenaphthylene (w) _A [#]	<0.01	<0.01	<0.01					µg/l	0.01	A-T-019w
Anthracene (w) _A [#]	<0.01	<0.01	<0.01					µg/l	0.01	A-T-019w
Benzo(a)anthracene (w) _A [#]	<0.01	<0.01	<0.01					µg/l	0.01	A-T-019w
Benzo(a)pyrene (w) _A [#]	<0.01	<0.01	<0.01					µg/l	0.01	A-T-019w
Benzo(b)fluoranthene (w) _A [#]	<0.01	<0.01	<0.01					µg/l	0.01	A-T-019w
Benzo(ghi)perylene (w) _A [#]	<0.01	<0.01	<0.01					µg/l	0.01	A-T-019w
Benzo(k)fluoranthene (w) _A [#]	<0.01	<0.01	<0.01					µg/l	0.01	A-T-019w
Chrysene (w) _A [#]	<0.01	<0.01	<0.01					µg/l	0.01	A-T-019w
Dibenzo(ah)anthracene (w) _A [#]	<0.01	<0.01	<0.01					µg/l	0.01	A-T-019w
Fluoranthene (w) _A [#]	<0.01	<0.01	<0.01					µg/l	0.01	A-T-019w
Fluorene (w) _A [#]	<0.01	<0.01	<0.01					µg/l	0.01	A-T-019w
Indeno(123-cd)pyrene (w) _A [#]	<0.01	<0.01	<0.01					µg/l	0.01	A-T-019w
Naphthalene (w) _A [#]	0.04	0.03	0.06					µg/l	0.01	A-T-019w
Phenanthrene (w) _A [#]	0.04	0.02	0.03					µg/l	0.01	A-T-019w
Pyrene (w) _A [#]	<0.01	<0.01	<0.01					µg/l	0.01	A-T-019w
Total PAH 16MS (w) _A [#]	0.10	0.07	0.11					µg/l	0.01	A-T-019w

Envirolab Job Number: 21/00605

Client Project Name: West Cumberland Hospital

Client Project Ref: 73096

Lab Sample ID	21/00605/1	21/00605/2	21/00605/3					Units	Limit of Detection	Method ref
Client Sample No	1	2	3							
Client Sample ID	BH01	BH06	BH03							
Depth to Top	0.50	0.50	1.50							
Depth To Bottom										
Date Sampled	20-Jan-21	20-Jan-21	20-Jan-21							
Sample Type	Water - EW	Water - EW	Water - EW							
Sample Matrix Code	N/A	N/A	N/A							
TPH CWG (w)										
Ali >C5-C6 (w) _A [#]	<1	<1	<1					µg/l	1	A-T-022w
Ali >C6-C8 (w) _A [#]	<1	<1	<1					µg/l	1	A-T-022w
Ali >C8-C10 (w) _A [#]	<5	<5	<5					µg/l	5	A-T-055w
Ali >C10-C12 (w) _A [#]	<5	<5	<5					µg/l	5	A-T-055w
Ali >C12-C16 (w) _A [#]	<5	<5	<5					µg/l	5	A-T-055w
Ali >C16-C21 (w) _A [#]	<5	<5	<5					µg/l	5	A-T-055w
Ali >C21-C35 (w) _A [#]	<5	8	<5					µg/l	5	A-T-055w
Total Aliphatics (w) _A [#]	<5	8	<5					µg/l	5	A-T-055w
Aro >C5-C7 (w) _A [#]	<1	<1	<1					µg/l	1	A-T-022w
Aro >C7-C8 (w) _A [#]	<1	<1	<1					µg/l	1	A-T-022w
Aro >C8-C10 (w) _A	<5	6	<5					µg/l	5	A-T-055w
Aro >C10-C12 (w) _A [#]	<5	18	8					µg/l	5	A-T-055w
Aro >C12-C16 (w) _A [#]	<5	15	11					µg/l	5	A-T-055w
Aro >C16-C21 (w) _A [#]	<5	18	13					µg/l	5	A-T-055w
Aro >C21-C35 (w) _A [#]	<10	15	12					µg/l	10	A-T-055w
Total Aromatics (w) _A	<10	72	44					µg/l	10	A-T-055w
TPH (Ali & Aro >C5-C35) (w) _A	<10	80	44					µg/l	10	A-T-055w
BTEX - Benzene (w) _A [#]	<1	<1	<1					µg/l	1	A-T-022w
BTEX - Toluene (w) _A [#]	<1	<1	<1					µg/l	1	A-T-022w
BTEX - Ethyl Benzene (w) _A [#]	<1	<1	<1					µg/l	1	A-T-022w
BTEX - m & p Xylene (w) _A [#]	<1	<1	<1					µg/l	1	A-T-022w
BTEX - o Xylene (w) _A [#]	<1	<1	<1					µg/l	1	A-T-022w
MTBE (w) _A [#]	<1	<1	<1					µg/l	1	A-T-022w

REPORT NOTES

General

This report shall not be reproduced, except in full, without written approval from Envirolab.

The results reported herein relate only to the material supplied to the laboratory.

The residue of any samples contained within this report, and any received with the same delivery, will be disposed of six weeks after initial scheduling. For samples tested for Asbestos we will retain a portion of the dried sample for a minimum of six months after the initial Asbestos testing is completed.

Analytical results reflect the quality of the sample at the time of analysis only.

Opinions and interpretations expressed are outside the scope of our accreditation.

If results are in italic font they are associated with an AQC failure, these are not accredited and are unreliable.

A deviating samples report is appended and will indicate if samples or tests have been found to be deviating. Any test results affected may not be an accurate record of the concentration at the time of sampling and, as a result, may be invalid.

The Client Sample No, Client Sample ID, Depth to Top, Depth to Bottom and Date Sampled were all provided by the client.

Soil chemical analysis:

All results are reported as dry weight (<40°C).

For samples with Matrix Codes 1 - 6 natural stones, brick and concrete fragments >10mm and any extraneous material (visible glass, metal or twigs) are removed and excluded from the sample prior to analysis and reported results corrected to a whole sample basis. This is reported as '% stones >10mm'.

For samples with Matrix Code 7 the whole sample is dried and crushed prior to analysis and this supersedes any "A" subscripts

All analysis is performed on the sample as received for soil samples which are positive for asbestos or the client has informed asbestos may be present and/or if they are from outside the European Union and this supersedes any "D" subscripts.

TPH analysis of water by method A-T-007:

Free and visible oils are excluded from the sample used for analysis so that the reported result represents the dissolved phase only.

Electrical Conductivity of water by Method A-T-037:

Results greater than 12900µS/cm @ 25°C / 1155µS/cm @ 20°C fall outside the calibration range and as such are unaccredited.

Asbestos:

Asbestos in soil analysis is performed on a dried aliquot of the submitted sample and cannot guarantee to identify asbestos if only present in small numbers as discrete fibres/fragments in the original sample.

Stones etc. are not removed from the sample prior to analysis.

Quantification of asbestos is a 3 stage process including visual identification, hand picking and weighing and fibre counting by sedimentation/phase contrast optical microscopy if required. If asbestos is identified as being present but is not in a form that is suitable for analysis by hand picking and weighing (normally if the asbestos is present as free fibres) quantification by sedimentation is performed. Where ACMs are found a percentage asbestos is assigned to each with reference to 'HSG264, Asbestos: The survey guide' and the calculated asbestos content is expressed as a percentage of the dried soil sample aliquot used.

Predominant Matrix Codes:

1 = SAND, 2 = LOAM, 3 = CLAY, 4 = LOAM/SAND, 5 = SAND/CLAY, 6 = CLAY/LOAM, 7 = OTHER, 8 = Asbestos bulk ID sample.

Samples with Matrix Code 7 & 8 are not predominantly a SAND/LOAM/CLAY mix and are not covered by our BSEN 17025 or MCERTS accreditations, with the exception of bulk asbestos which are BSEN 17025 accredited.

Secondary Matrix Codes:

A = contains stones, B = contains construction rubble, C = contains visible hydrocarbons, D = contains glass/metal,

E = contains roots/twigs.

Key:

IS indicates Insufficient Sample for analysis.

US indicates Unsuitable Sample for analysis.

NDP indicates No Determination Possible.

NAD indicates No Asbestos Detected.

N/A indicates Not Applicable.

Superscript # indicates method accredited to ISO 17025.

Superscript "M" indicates method accredited to MCERTS.

Subscript "A" indicates analysis performed on the sample as received.

Subscript "D" indicates analysis performed on the dried sample, crushed to pass a 2mm sieve

Please contact us if you need any further information.

Envirolab Deviating Samples Report

Units 7&8 Sandpits Business Park, Mottram Road, Hyde, SK14 3AR
Tel. 0161 368 4921 email. ask@envlab.co.uk

Client: Curtins Consulting (Manchester), Merchant Exchange, 17-19 Whitworth Street ,
Manchester, UK, M1 5WG

Project: West Cumberland Hospital

Clients Project No: 73096

Project No: 21/00605

Date Received: 21/01/2021 (am)

Cool Box Temperatures (°C): 4.2

NO DEVIATIONS IDENTIFIED

If, at any point before reaching the laboratory, the temperature of the samples has breached those set in published standards, e.g. BS-EN 5667-3, ISO 18400-102:2017, then the concentration of any affected analytes may differ from that at the time of sampling.



Appendix D – Geotechnical Laboratory Testing Results



STRUCTURAL SOILS LTD
TEST REPORT



Report No. 584418-01 (00)

1774

Date 18-January-2021 Contract B073906

Client Envirolab
Address Units 7-8
Sandpits Business Park
Mottram Road
Hyde
SK14 3AR

For the Attention of Michael Knight

Samples submitted by client	18-December-2020	Client Reference	20/10811
Testing Started	05-January-2021	Client Order No.	P0745381
Testing Completed	18-January-2021	Instruction Type	Written

Tests marked 'Not UKAS Accredited' in this report are not included in the UKAS Accreditation Schedule for our Laboratory.

UKAS Accredited Tests
1.10 Particle Size Distribution wet sieve method BS1377:Part 2:1990,clause 9.2 (superseded)*

* This clause of BS1377 is no longer the most up to date method due to the publication of ISO17892

Please Note: Remaining samples will be retained for a period of one month from today and will then be disposed of .
Test were undertaken on samples 'as received' unless otherwise stated.
Opinions and interpretations expressed in this report are outside the scope of accreditation for this laboratory.

Structural Soils Ltd 18 Frogmore Rd Hemel Hempstead HP3 9RT Tel.01442 416661 e-mail dimitris.xirouchakis@soils.co.uk

TESTING VERIFICATION CERTIFICATE



1774

The test results included in this report are certified as:-

ISSUE STATUS: **FINAL**

In accordance with the Structural Soils Ltd Laboratory Quality Management System, results sheets and summaries of results issued by the laboratory are checked by an approved signatory. The integrity of the test data and results are ensured by control of the computer system employed by the laboratory as part of the Software Verification Program as detailed in the Laboratory Quality Manual.

This testing verification certificate covers all testing compiled on or before the following datetime: **18/01/2021 14:47:37**.

Testing reported after this date is not covered by this Verification Certificate.

Approved Signatory
Sharon Cairns (Laboratory Manager)

(Head Office)
Bristol Laboratory
Unit 1A, Princess Street
Bedminster
Bristol
BS3 4AG

Castleford Laboratory
The Potteries, Pottery Street
Castleford
West Yorkshire
WF10 1NJ

Hemel Laboratory
18 Frogmore Road
Hemel Hempstead
Hertfordshire
HP3 9RT

Tonbridge Laboratory
Anerley Court, Half Moon Lane
Hildenborough
Tonbridge
TN11 9HU



**STRUCTURAL
SOILS LTD**

Contract:

B073096

Job No:


584418



PARTICLE SIZE DISTRIBUTION TEST

In accordance with clauses 9.2 of BS1377:Part 2:1990

Window Sample: **WS01** Sample Ref: **13** Sample Type: **B** Depth (m): **1.70**

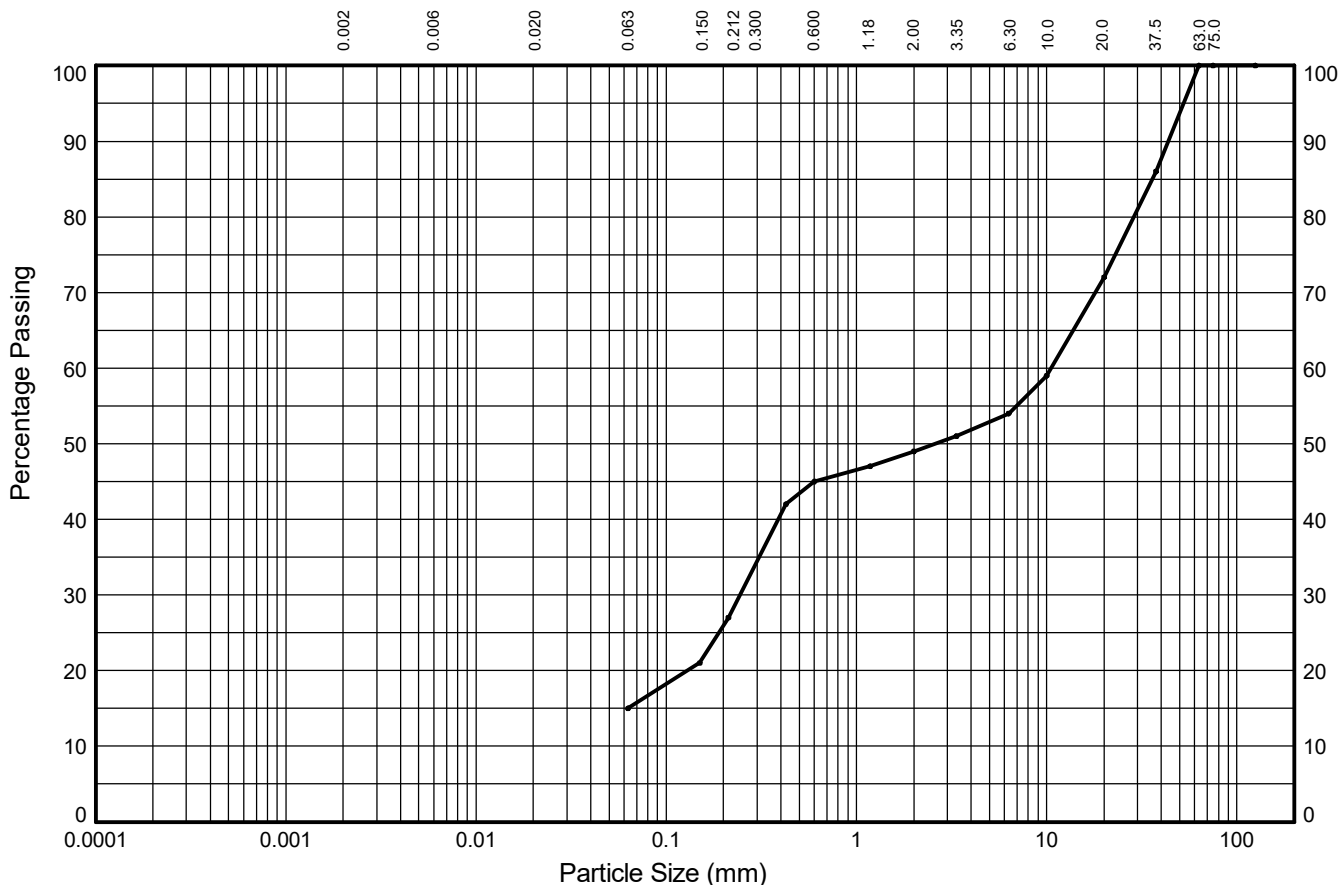

CLAY	fine	medium	coarse	fine	medium	coarse	fine	medium	coarse	COBBLES
	-	-	-	11%	19%	4%	5%	18%	28%	
SILT			SAND			GRAVEL				
15%			34%			51%			0%	


Test Sieve (mm)	Percent Passing (%)
125.0	100
75.0	100
63.0	100
37.5	86
20.0	72
10.0	59
6.30	54
3.35	51
2.00	49
1.18	47
0.600	45
0.425	42
0.212	27
0.150	21
0.063	15

Particle Diameter (mm)	Percent Passing (%)
Sedimentation sample was not pre-treated	

Coefficients	
D ₁₀ (mm)	NA
D ₁₅ (mm)	0.063
D ₃₀ (mm)	0.244
D ₅₀ (mm)	2.588
D ₆₀ (mm)	10.548
D ₈₅ (mm)	35.853
D ₉₀ (mm)	43.492
C _U	NA
C _C	NA

Soil Description:
Brown very sandy clayey GRAVEL

Key: C_U = Uniformity coefficient. C_C = Coefficient of curvature as defined in BS EN ISO 14688-2



STRUCTURAL SOILS
 18 Frogmore Road
 Hemel Hempstead
 Hertfordshire
 HP3 9RT

Compiled By		Date
<i>SC</i>		18/01/21
SHARON CAIRNS		
Contract	B073096	Contract Ref:
		584418



LABORATORY TEST CERTIFICATE

10 Queenslie Point
Queenslie Industrial Estate
120 Stepps Road
Glasgow
G33 3NQ

Certificate No : 21/073 - 01
To : Jillian Lafferty
Client : Phoenix Drilling Limited
2 Nairn Road
Deans Industrial Estate
Livingston
EH54 8AY

Tel: 0141 774 4032

email: info@mattest.org
Website: www.mattest.org

Dear Sirs,

LABORATORY TESTING OF ROCK

Introduction

We refer to samples taken from West Cumberland Hospital and delivered to our laboratory on 27th January 2021.

Material & Source

Sample Reference : See Report Plates
Sampled By : Client
Sampling Certificate : Not Supplied
Location : See Report Plates
Description : Rock Cores
Date Sampled : Not Supplied
Date Tested : 27th January 2021 Onwards
Source : 3670 - West Cumberland Hospital

Test Results;

As Detailed On Page 2 to Page 11 inclusive

Comments;

Opinions and interpretations expressed herein are outside the scope of UKAS accreditation
This report should not be reproduced except in full without the written approval of the laboratory
All remaining samples for this project will be disposed of 28 days after issue of this test certificate

Remarks;

Approved for Issue



T McLelland (Director)

Date 03/02/2021



BOREHOLE		BH01	
SAMPLE		C	
DEPTH	m	3.50	
SAMPLE DIAMETER	mm	72.34	
SAMPLE HEIGHT	mm	167.45	
TEST CONDITION		As Received	
RATE OF LOADING	kN/s	0.5	
TEST DURATION	min.sec	4.55	
DATE OF TESTING		02/02/2021	
LOAD FRAME USED		2000kN	
LOAD DIRECTION WITH RESPECT TO LITHOLOGY		Unknown	
FAILURE LOAD	kN	138.0	
UNCONFINED COMPRESSIVE STRENGTH	MPa	33.6	
WATER CONTENT (ISRM Suggested Methods)	%	4.7	
BULK DENSITY (ISRM Suggested Methods)	Mg/m ³	2.39	
DRY DENSITY (ISRM Suggested Methods)	Mg/m ³	2.28	

BOREHOLE		BH01	
SAMPLE		C	
DEPTH	m	6.50	
SAMPLE DIAMETER	mm	72.50	
SAMPLE HEIGHT	mm	160.31	
TEST CONDITION		As Received	
RATE OF LOADING	kN/s	0.5	
TEST DURATION	min.sec	6.09	
DATE OF TESTING		02/02/2021	
LOAD FRAME USED		2000kN	
LOAD DIRECTION WITH RESPECT TO LITHOLOGY		Unknown	
FAILURE LOAD	kN	171.4	
UNCONFINED COMPRESSIVE STRENGTH	MPa	41.5	
WATER CONTENT (ISRM Suggested Methods)	%	4.5	
BULK DENSITY (ISRM Suggested Methods)	Mg/m ³	2.31	
DRY DENSITY (ISRM Suggested Methods)	Mg/m ³	2.21	

BOREHOLE		BH01	
SAMPLE		C	
DEPTH	m	10.00	
SAMPLE DIAMETER	mm	72.12	
SAMPLE HEIGHT	mm	162.12	
TEST CONDITION		As Received	
RATE OF LOADING	kN/s	0.5	
TEST DURATION	min.sec	5.43	
DATE OF TESTING		02/02/2021	
LOAD FRAME USED		2000kN	
LOAD DIRECTION WITH RESPECT TO LITHOLOGY		Unknown	
FAILURE LOAD	kN	160.2	
UNCONFINED COMPRESSIVE STRENGTH	MPa	39.2	
WATER CONTENT (ISRM Suggested Methods)	%	4.3	
BULK DENSITY (ISRM Suggested Methods)	Mg/m ³	2.44	
DRY DENSITY (ISRM Suggested Methods)	Mg/m ³	2.34	

Tested in accordance with ASTM D7012 - 14

SUMMARY OF UNCONFINED COMPRESSIVE STRENGTH


BOREHOLE		BH02	<p>SAMPLE FAILURE SHAPES</p> <p>External Internal</p>
SAMPLE		C	
DEPTH	m	1.50	
SAMPLE DIAMETER	mm	72.55	
SAMPLE HEIGHT	mm	161.50	
TEST CONDITION		As Received	
RATE OF LOADING	kN/s	0.5	
TEST DURATION	min.sec	4.39	
DATE OF TESTING		02/02/2021	
LOAD FRAME USED		2000kN	
LOAD DIRECTION WITH RESPECT TO LITHOLOGY		Unknown	
FAILURE LOAD	kN	127.3	
UNCONFINED COMPRESSIVE STRENGTH	MPa	30.8	
WATER CONTENT (ISRM Suggested Methods)	%	4.4	
BULK DENSITY (ISRM Suggested Methods)	Mg/m ³	2.31	
DRY DENSITY (ISRM Suggested Methods)	Mg/m ³	2.21	


BOREHOLE		BH02	<p>SAMPLE FAILURE SHAPES</p> <p>External Internal</p>
SAMPLE		C	
DEPTH	m	5.50	
SAMPLE DIAMETER	mm	72.36	
SAMPLE HEIGHT	mm	161.13	
TEST CONDITION		As Received	
RATE OF LOADING	kN/s	0.5	
TEST DURATION	min.sec	3.55	
DATE OF TESTING		02/02/2021	
LOAD FRAME USED		2000kN	
LOAD DIRECTION WITH RESPECT TO LITHOLOGY		Unknown	
FAILURE LOAD	kN	109.3	
UNCONFINED COMPRESSIVE STRENGTH	MPa	26.6	
WATER CONTENT (ISRM Suggested Methods)	%	3.9	
BULK DENSITY (ISRM Suggested Methods)	Mg/m ³	2.34	
DRY DENSITY (ISRM Suggested Methods)	Mg/m ³	2.26	


BOREHOLE		BH02	<p>SAMPLE FAILURE SHAPES</p> <p>External Internal</p>
SAMPLE		C	
DEPTH	m	13.00	
SAMPLE DIAMETER	mm	72.33	
SAMPLE HEIGHT	mm	158.23	
TEST CONDITION		As Received	
RATE OF LOADING	kN/s	0.5	
TEST DURATION	min.sec	4.41	
DATE OF TESTING		02/02/2021	
LOAD FRAME USED		2000kN	
LOAD DIRECTION WITH RESPECT TO LITHOLOGY		Unknown	
FAILURE LOAD	kN	135.4	
UNCONFINED COMPRESSIVE STRENGTH	MPa	33.0	
WATER CONTENT (ISRM Suggested Methods)	%	0.3	
BULK DENSITY (ISRM Suggested Methods)	Mg/m ³	2.67	
DRY DENSITY (ISRM Suggested Methods)	Mg/m ³	2.66	

Tested in accordance with ASTM D7012 - 14

SUMMARY OF UNCONFINED COMPRESSIVE STRENGTH

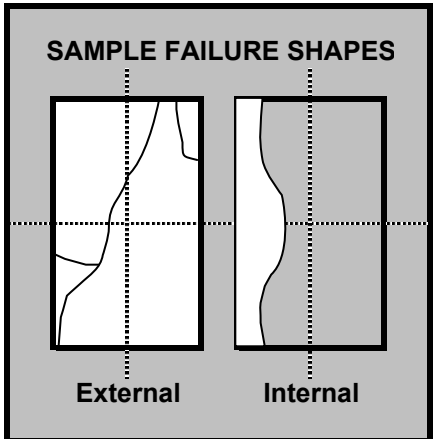
BOREHOLE		BH03	
SAMPLE		C	
DEPTH	m	4.50	
SAMPLE DIAMETER	mm	72.73	
SAMPLE HEIGHT	mm	171.70	
TEST CONDITION		As Received	
RATE OF LOADING	kN/s	0.5	
TEST DURATION	min.sec	5.59	
DATE OF TESTING		02/02/2021	
LOAD FRAME USED		2000kN	
LOAD DIRECTION WITH RESPECT TO LITHOLOGY		Unknown	
FAILURE LOAD	kN	168.3	
UNCONFINED COMPRESSIVE STRENGTH	MPa	40.5	
WATER CONTENT (ISRM Suggested Methods)	%	4.5	
BULK DENSITY (ISRM Suggested Methods)	Mg/m ³	2.31	
DRY DENSITY (ISRM Suggested Methods)	Mg/m ³	2.21	

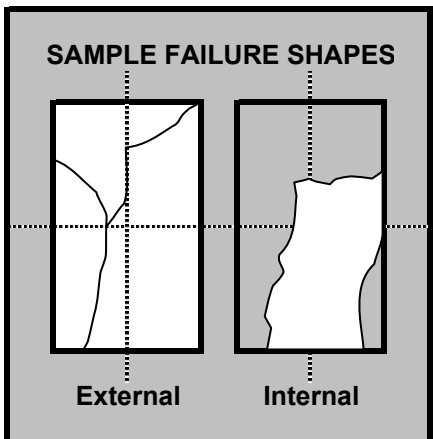
BOREHOLE		BH03	
SAMPLE		C	
DEPTH	m	8.50	
SAMPLE DIAMETER	mm	72.39	
SAMPLE HEIGHT	mm	161.76	
TEST CONDITION		As Received	
RATE OF LOADING	kN/s	0.5	
TEST DURATION	min.sec	4.54	
DATE OF TESTING		02/02/2021	
LOAD FRAME USED		2000kN	
LOAD DIRECTION WITH RESPECT TO LITHOLOGY		Unknown	
FAILURE LOAD	kN	136.6	
UNCONFINED COMPRESSIVE STRENGTH	MPa	33.2	
WATER CONTENT (ISRM Suggested Methods)	%	6.0	
BULK DENSITY (ISRM Suggested Methods)	Mg/m ³	2.37	
DRY DENSITY (ISRM Suggested Methods)	Mg/m ³	2.24	

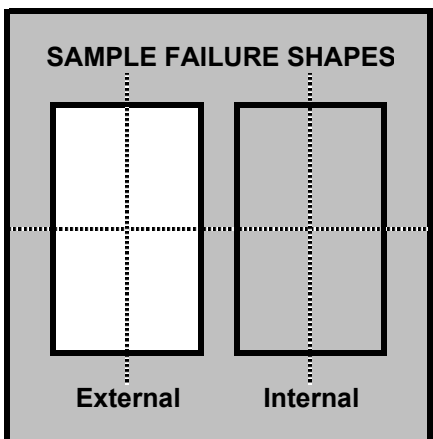
BOREHOLE			
SAMPLE			
DEPTH	m		
SAMPLE DIAMETER	mm		
SAMPLE HEIGHT	mm		
TEST CONDITION			
RATE OF LOADING	kN/s		
TEST DURATION	min.sec		
DATE OF TESTING			
LOAD FRAME USED			
LOAD DIRECTION WITH RESPECT TO LITHOLOGY			
FAILURE LOAD	kN		
UNCONFINED COMPRESSIVE STRENGTH	MPa		
WATER CONTENT (ISRM Suggested Methods)	%		
BULK DENSITY (ISRM Suggested Methods)	Mg/m ³		
DRY DENSITY (ISRM Suggested Methods)	Mg/m ³		

Tested in accordance with ASTM D7012 - 14

SUMMARY OF UNCONFINED COMPRESSIVE STRENGTH

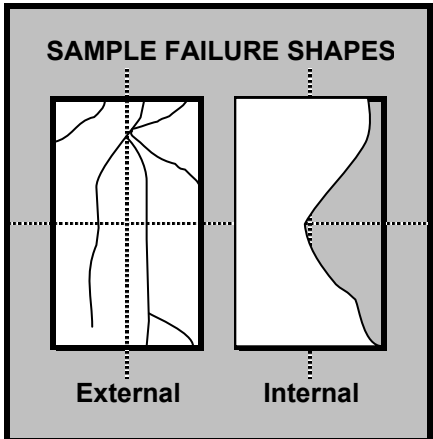
BOREHOLE		BH04	 <p>SAMPLE FAILURE SHAPES</p> <p>External Internal</p>
SAMPLE		C	
DEPTH	m	3.50	
SAMPLE DIAMETER	mm	72.44	
SAMPLE HEIGHT	mm	164.58	
TEST CONDITION		As Received	
RATE OF LOADING	kN/s	0.5	
TEST DURATION	min.sec	7.21	
DATE OF TESTING		02/02/2021	
LOAD FRAME USED		2000kN	
LOAD DIRECTION WITH RESPECT TO LITHOLOGY		Unknown	
FAILURE LOAD	kN	209.0	
UNCONFINED COMPRESSIVE STRENGTH	MPa	50.7	
WATER CONTENT (ISRM Suggested Methods)	%	3.9	
BULK DENSITY (ISRM Suggested Methods)	Mg/m ³	2.47	
DRY DENSITY (ISRM Suggested Methods)	Mg/m ³	2.38	

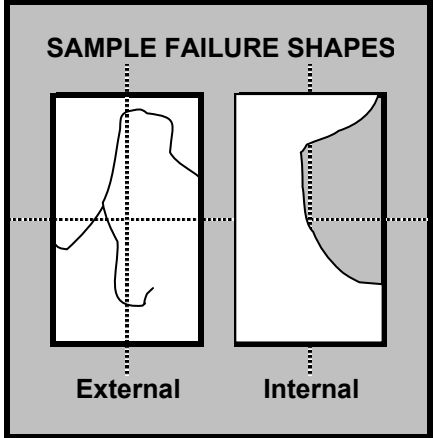
BOREHOLE		BH04	 <p>SAMPLE FAILURE SHAPES</p> <p>External Internal</p>
SAMPLE		C	
DEPTH	m	7.50	
SAMPLE DIAMETER	mm	72.28	
SAMPLE HEIGHT	mm	161.69	
TEST CONDITION		As Received	
RATE OF LOADING	kN/s	0.4	
TEST DURATION	min.sec	5.01	
DATE OF TESTING		02/02/2021	
LOAD FRAME USED		2000kN	
LOAD DIRECTION WITH RESPECT TO LITHOLOGY		Unknown	
FAILURE LOAD	kN	132.9	
UNCONFINED COMPRESSIVE STRENGTH	MPa	32.4	
WATER CONTENT (ISRM Suggested Methods)	%	3.1	
BULK DENSITY (ISRM Suggested Methods)	Mg/m ³	2.48	
DRY DENSITY (ISRM Suggested Methods)	Mg/m ³	2.41	

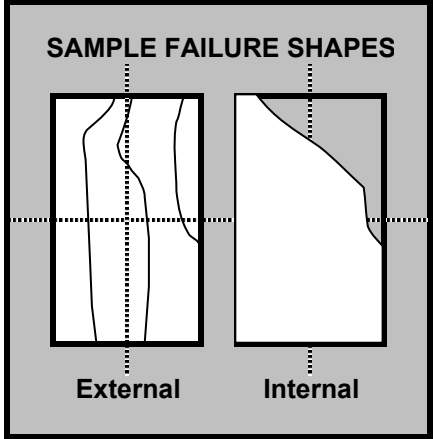
BOREHOLE		BH04	 <p>SAMPLE FAILURE SHAPES</p> <p>External Internal</p>
SAMPLE		C	
DEPTH	m	11.50	
SAMPLE DIAMETER	mm	72.44	
SAMPLE HEIGHT	mm	165.35	
TEST CONDITION		As Received	
RATE OF LOADING	kN/s	0.5	
TEST DURATION	min.sec	6.41	
DATE OF TESTING		02/02/2021	
LOAD FRAME USED		2000kN	
LOAD DIRECTION WITH RESPECT TO LITHOLOGY		Unknown	
FAILURE LOAD	kN	189.4	
UNCONFINED COMPRESSIVE STRENGTH	MPa	46.0	
WATER CONTENT (ISRM Suggested Methods)	%	0.6	
BULK DENSITY (ISRM Suggested Methods)	Mg/m ³	2.40	
DRY DENSITY (ISRM Suggested Methods)	Mg/m ³	2.39	

Tested in accordance with ASTM D7012 - 14

SUMMARY OF UNCONFINED COMPRESSIVE STRENGTH

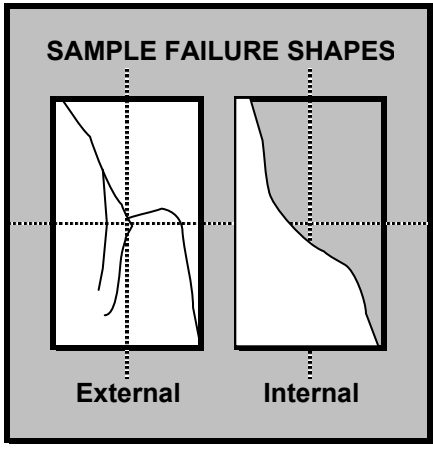BOREHOLE		BH05	
SAMPLE		C	
DEPTH	m	4.50	
SAMPLE DIAMETER	mm	72.43	
SAMPLE HEIGHT	mm	164.23	
TEST CONDITION		As Received	
RATE OF LOADING	kN/s	0.5	
TEST DURATION	min.sec	4.16	
DATE OF TESTING		02/02/2021	
LOAD FRAME USED		2000kN	
LOAD DIRECTION WITH RESPECT TO LITHOLOGY		Unknown	
FAILURE LOAD	kN	122.4	
UNCONFINED COMPRESSIVE STRENGTH	MPa	29.7	
WATER CONTENT (ISRM Suggested Methods)	%	2.4	
BULK DENSITY (ISRM Suggested Methods)	Mg/m ³	2.26	
DRY DENSITY (ISRM Suggested Methods)	Mg/m ³	2.21	

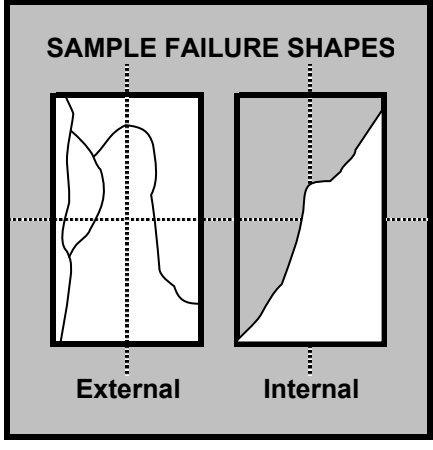BOREHOLE		BH05	
SAMPLE		C	
DEPTH	m	8.50	
SAMPLE DIAMETER	mm	72.67	
SAMPLE HEIGHT	mm	167.69	
TEST CONDITION		As Received	
RATE OF LOADING	kN/s	0.5	
TEST DURATION	min.sec	6.09	
DATE OF TESTING		02/02/2021	
LOAD FRAME USED		2000kN	
LOAD DIRECTION WITH RESPECT TO LITHOLOGY		Perpendicular	
FAILURE LOAD	kN	169.6	
UNCONFINED COMPRESSIVE STRENGTH	MPa	40.9	
WATER CONTENT (ISRM Suggested Methods)	%	3.3	
BULK DENSITY (ISRM Suggested Methods)	Mg/m ³	2.32	
DRY DENSITY (ISRM Suggested Methods)	Mg/m ³	2.24	

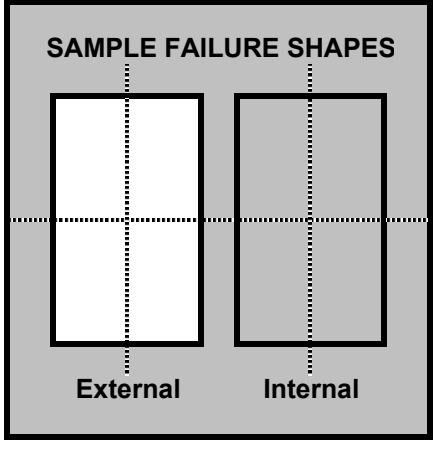BOREHOLE			
SAMPLE			
DEPTH	m		
SAMPLE DIAMETER	mm		
SAMPLE HEIGHT	mm		
TEST CONDITION			
RATE OF LOADING	kN/s		
TEST DURATION	min.sec		
DATE OF TESTING			
LOAD FRAME USED			
LOAD DIRECTION WITH RESPECT TO LITHOLOGY			
FAILURE LOAD	kN		
UNCONFINED COMPRESSIVE STRENGTH	MPa		
WATER CONTENT (ISRM Suggested Methods)	%		
BULK DENSITY (ISRM Suggested Methods)	Mg/m ³		
DRY DENSITY (ISRM Suggested Methods)	Mg/m ³		

Tested in accordance with ASTM D7012 - 14

SUMMARY OF UNCONFINED COMPRESSIVE STRENGTH

BOREHOLE	SAMPLE	DEPTH (m)	MOISTURE CONTENT (%)	TYPE OF TEST * (see below)	CORE DIAMETER (mm)	EQUIVALENT DIAMETER (mm)	PLATEN SEPARATION (mm)	FAILURE LOAD (kN)	Is (MPa)	Is(50) (MPa)
BH01	C	1.50	As Received	D	72.73	72.73	72.73	14.20	2.68	3.18
				A	72.22	72.84	57.70	12.45	2.35	2.78
				A	72.61	71.93	55.97	11.19	2.16	2.55
	C	2.50	As Received	D	72.85	72.85	72.85	9.44	1.78	2.11
				A	72.98	74.59	59.88	6.89	1.24	1.48
				A	72.83	75.11	60.84	8.56	1.52	1.82
	C	4.50	As Received	D	72.41	72.41	72.41	10.33	1.97	2.33
				A	72.13	73.07	58.13	12.55	2.35	2.79
				A	72.50	71.14	54.83	10.67	2.11	2.47
	C	5.50	As Received	D	72.42	72.42	72.42	6.66	1.27	1.50
				A	72.30	68.13	50.42	6.69	1.44	1.66
				A	72.40	73.32	58.31	7.01	1.30	1.55
	C	7.50	As Received	D	72.40	72.40	72.40	4.21	0.80	0.95
				A	72.51	86.37	80.80	21.46	2.88	3.68
				A	72.30	81.89	72.84	10.71	1.60	1.99
	C	8.50	As Received	D	72.37	72.37	72.37	11.00	2.10	2.48
				A	72.40	73.15	58.04	11.41	2.13	2.53
				A	72.35	62.34	42.19	6.78	1.74	1.93

NOTE: N/M - Not measured

NOTE: A dash (-) signifies that scale did not register a reading

* I = IRREGULAR TEST
D = DIAMETRICAL TEST
A = AXIAL TEST

Mean Is(50) - Axial tests	2.27
Mean Is(50) - Diametrical tests	2.09
Ia(50)	1.09

Tested in accordance with ISRM (2007)

SUMMARY OF POINT LOAD TEST RESULTS

BOREHOLE	SAMPLE	DEPTH (m)	MOISTURE CONTENT (%)	TYPE OF TEST * (see below)	CORE DIAMETER (mm)	EQUIVALENT DIAMETER (mm)	PLATEN SEPARATION (mm)	FAILURE LOAD (kN)	Is (MPa)	Is(50) (MPa)
BH02	C	2.50	As Received	D	72.22	72.22	72.22	5.09	0.98	1.15
				A	72.10	77.39	65.24	8.50	1.42	1.73
				A	72.09	72.17	56.75	8.96	1.72	2.03
	C	3.50	As Received	D	72.48	72.48	72.48	7.01	1.33	1.58
				A	72.50	86.06	80.23	10.26	1.39	1.77
				A	72.41	84.33	77.14	9.79	1.38	1.74
	C	4.50	As Received	D	72.47	72.47	72.47	5.76	1.10	1.29
				A	72.30	80.55	70.49	10.20	1.57	1.95
				A	72.40	67.86	49.96	9.67	2.10	2.41
	C	6.50	As Received	D	72.39	72.39	72.39	8.00	1.53	1.80
				A	72.41	84.68	77.78	2.98	0.42	0.53
				A	72.58	71.82	55.81	11.24	2.18	2.56
	C	7.50	As Received	D	72.90	72.90	72.90	16.57	3.12	3.69
				A	72.50	69.90	52.93	16.58	3.39	3.95
				A	72.52	65.54	46.52	15.92	3.71	4.19
C	10.50	As Received	D	72.36	72.36	72.36	23.83	4.55	5.37	
			A	72.28	75.09	61.26	18.46	3.27	3.93	
			A	72.21	73.28	58.41	19.01	3.54	4.20	

NOTE: N/M - Not measured

NOTE: A dash (-) signifies that scale did not register a reading

* I = IRREGULAR TEST
D = DIAMETRICAL TEST
A = AXIAL TEST

Mean Is(50) - Axial tests	2.58
Mean Is(50) - Diametrical tests	2.48
la(50)	1.04

Tested in accordance with ISRM (2007)

SUMMARY OF POINT LOAD TEST RESULTS

BOREHOLE	SAMPLE	DEPTH (m)	MOISTURE CONTENT (%)	TYPE OF TEST * (see below)	CORE DIAMETER (mm)	EQUIVALENT DIAMETER (mm)	PLATEN SEPARATION (mm)	FAILURE LOAD (kN)	Is (MPa)	Is(50) (MPa)
BH03	C	3.50	As Received	D	71.99	71.99	71.99	4.40	0.85	1.00
				A	72.14	71.96	56.37	7.71	1.49	1.76
				A	72.06	67.55	49.73	7.52	1.65	1.89
	C	5.50	As Received	D	71.78	71.78	71.38	4.54	0.88	1.04
				A	71.90	83.84	76.79	9.06	1.29	1.63
				A	71.80	84.17	77.49	6.97	0.98	1.24
	C	6.50	As Received	D	72.39	72.39	72.39	3.18	0.61	0.72
				A	72.51	78.95	67.51	8.14	1.31	1.60
				A	72.21	80.73	70.88	10.98	1.69	2.09
	C	7.50	As Received	D	72.65	72.65	72.65	5.94	1.13	1.33
				A	72.31	72.97	57.84	7.60	1.43	1.69
				A	72.78	68.39	50.47	6.71	1.44	1.65
	C	9.50	As Received	D	72.72	72.72	72.72	12.19	2.30	2.73
				A	72.10	79.66	69.12	5.03	0.79	0.98
				A	72.28	75.84	62.49	6.63	1.15	1.39

NOTE: N/M - Not measured

NOTE: A dash (-) signifies that scale did not register a reading

* I = IRREGULAR TEST
D = DIAMETRICAL TEST
A = AXIAL TEST

Mean Is(50) - Axial tests	1.59
Mean Is(50) - Diametrical tests	1.36
la(50)	1.17

Tested in accordance with ISRM (2007)

SUMMARY OF POINT LOAD TEST RESULTS

BOREHOLE	SAMPLE	DEPTH (m)	MOISTURE CONTENT (%)	TYPE OF TEST * (see below)	CORE DIAMETER (mm)	EQUIVALENT DIAMETER (mm)	PLATEN SEPARATION (mm)	FAILURE LOAD (kN)	Is (MPa)	Is(50) (MPa)
BH04	C	4.50	As Received	D	72.36	72.36	72.36	12.80	2.44	2.89
				A	72.41	75.06	61.11	9.66	1.71	2.06
				A	72.30	66.63	48.23	8.31	1.87	2.13
	C	5.50	As Received	D	72.39	72.39	72.39	5.72	1.09	1.29
				A	72.11	61.49	41.18	6.90	1.82	2.00
				A	72.40	64.86	45.63	6.51	1.55	1.74
	C	6.50	As Received	D	72.21	72.21	72.21	16.74	3.21	3.79
				A	72.39	90.48	88.81	17.87	2.18	2.85
				A	72.19	86.48	81.37	12.18	1.63	2.08
	C	8.50	As Received	D	72.73	72.73	72.73	12.64	2.39	2.83
				A	72.50	68.14	50.30	13.08	2.82	3.24
				A	72.10	64.31	45.05	17.66	4.27	4.78
	C	9.50	As Received	D	72.30	72.30	72.30	30.74	5.88	6.94
				A	72.48	82.33	73.45	28.84	4.26	5.33
				A	72.25	80.56	70.54	28.79	4.44	5.50
	C	10.50	As Received	D	72.32	72.32	72.32	25.54	4.88	5.77
				A	72.15	79.15	68.19	16.22	2.59	3.18
				A	72.23	72.81	57.65	19.69	3.71	4.40

NOTE: N/M - Not measured
NOTE: A dash (-) signifies that scale did not register a reading

* I = IRREGULAR TEST
D = DIAMETRICAL TEST
A = AXIAL TEST

Mean Is(50) - Axial tests	3.27
Mean Is(50) - Diametrical tests	3.92
la(50)	0.84

Tested in accordance with ISRM (2007)

SUMMARY OF POINT LOAD TEST RESULTS

BOREHOLE	SAMPLE	DEPTH (m)	MOISTURE CONTENT (%)	TYPE OF TEST * (see below)	CORE DIAMETER (mm)	EQUIVALENT DIAMETER (mm)	PLATEN SEPARATION (mm)	FAILURE LOAD (kN)	Is (MPa)	Is(50) (MPa)
BH05	C	3.50	As Received	D	72.49	72.49	72.49	2.18	0.42	0.49
				A	72.30	84.92	78.33	8.49	1.18	1.49
				A	72.51	73.45	58.44	6.26	1.16	1.38
	C	5.50	As Received	D	72.09	72.09	72.09	2.11	0.41	0.48
				A	72.40	80.56	70.40	9.46	1.46	1.81
				A	72.41	79.69	68.88	9.55	1.50	1.85
	C	6.50	As Received	D	72.17	72.17	72.17	3.89	0.75	0.88
				A	72.10	73.10	58.20	5.65	1.06	1.25
				A	72.20	71.08	54.96	5.01	0.99	1.16
	C	7.50	As Received	D	72.16	72.16	72.16	5.73	1.10	1.30
				A	72.30	81.32	71.83	11.00	1.66	2.07
				A	72.81	69.68	52.38	6.84	1.41	1.63
	C	9.50	As Received	D	72.26	72.26	72.26	5.49	1.05	1.24
				A	72.11	68.09	50.50	7.11	1.53	1.76
				A	72.51	60.22	39.28	8.02	2.21	2.41
	C	10.50	As Received	D	72.50	72.50	72.50	8.75	1.66	1.97
				A	72.31	71.08	54.87	13.30	2.63	3.08
				A	72.69	70.82	54.19	11.09	2.21	2.59

NOTE: N/M - Not measured

NOTE: A dash (-) signifies that scale did not register a reading

* I = IRREGULAR TEST
D = DIAMETRICAL TEST
A = AXIAL TEST

Mean Is(50) - Axial tests	1.87
Mean Is(50) - Diametrical tests	1.06
Ia(50)	1.77

Tested in accordance with ISRM (2007)

SUMMARY OF POINT LOAD TEST RESULTS



0001

TEST REPORT

Dynamic Cone Penetrometer

Documented In House Method No DIHM 302

Client: CURTINS CONSULTING ENGINEERS
 Edinburgh
 United Kingdom
 EH4 3BL

Report No: 51061689/21/03
 Job No: 51061689
 Date Tested: 09/03/2021
 Date Reported: 17/03/2021


Contact: 1a Belford Road
 Site: West Cumberland Hospital, Whitehaven

Material: Clay/ Stone

Location: Proposed Waste Compound

Reference: No 3
 Start Depth(mm) : 80

Interpretative Method : TRL Equation : $\text{Log}_{10}(\text{CBR}) = 2.480 - 1.057 \times \text{Log}_{10}(\text{mm/blow})$

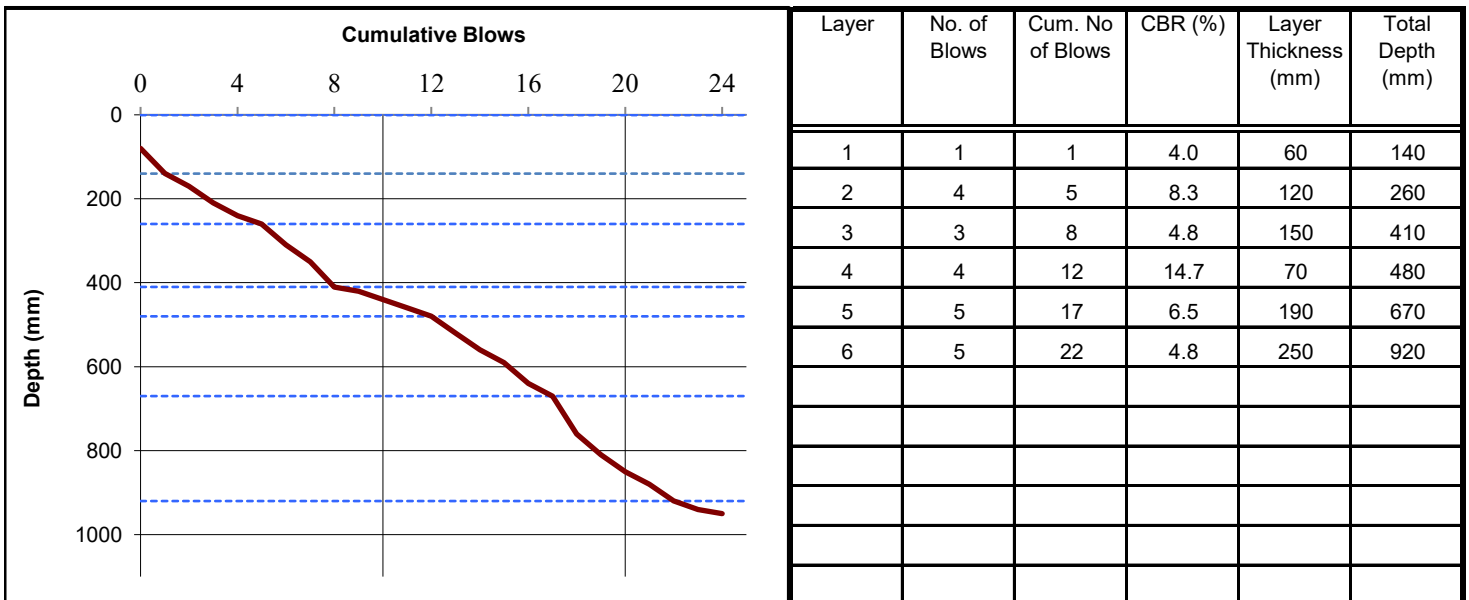

Comments :

Signed: P. Thomas

- Mark R. Dawkins - Laboratory Manager
- Paul Thomas - Section Manager

For and on behalf of SOCOTEC UK Limited



0001

TEST REPORT

Dynamic Cone Penetrometer

Documented In House Method No DIHM 302

Client: CURTINS CONSULTING ENGINEERS
 Edinburgh
 United Kingdom
 EH4 3BL

Report No: 51061689/21/05
 Job No: 51061689
 Date Tested: 09/03/2021
 Date Reported: 17/03/2021


Contact: 1a Belford Road
 Site: West Cumberland Hospital, Whitehaven

Material: Clay/ Stone

Location: Proposed Waste Compound

Reference: No 5
 Start Depth(mm) : 150

Interpretative Method : TRL Equation : $\text{Log}_{10}(\text{CBR}) = 2.480 - 1.057 \times \text{Log}_{10}(\text{mm/blow})$

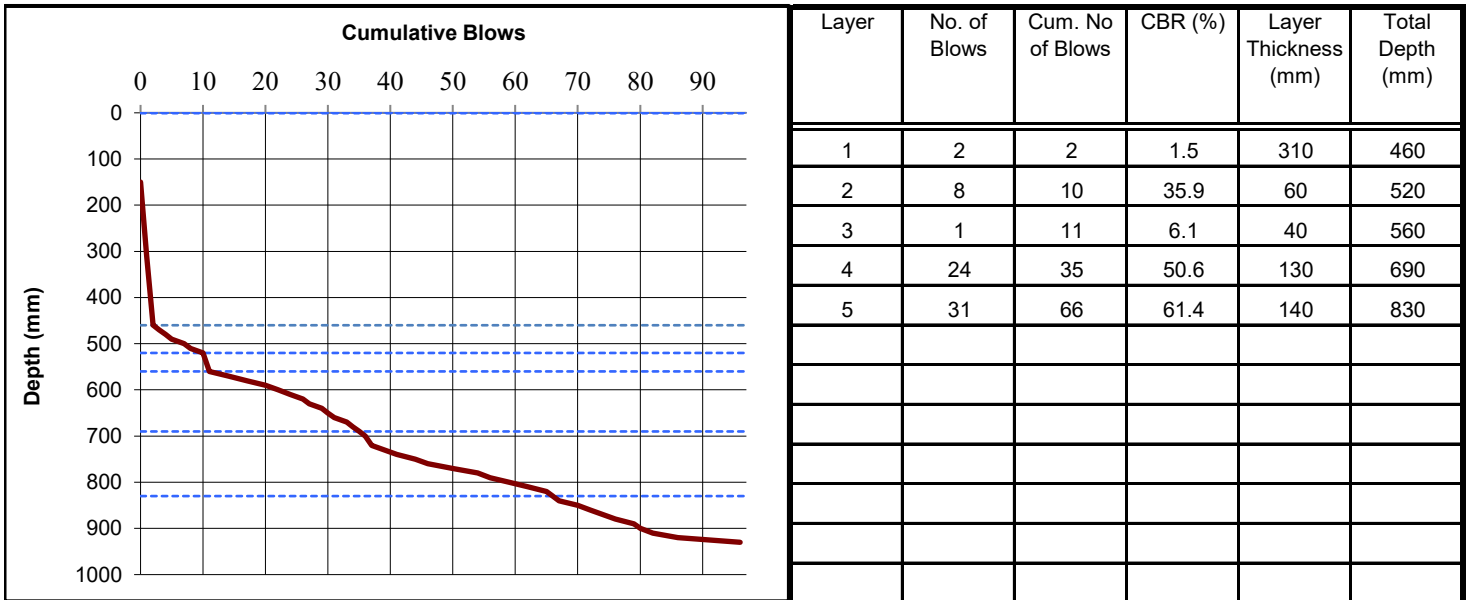

Comments :

Signed: P. Thomas

- Mark R. Dawkins - Laboratory Manager
- Paul Thomas - Section Manager

For and on behalf of SOCOTEC UK Limited

Opinions and interpretations expressed herein are outside the scope of UKAS accreditation. This test report may not be reproduced other than in full, except with prior written approval of the issuing laboratory. Results reported herein relate solely to the sample(s) tested and are not necessarily representative of a larger sample population. SOCOTEC UK Limited, Reg Office: SOCOTEC House, Bretby Business Park, Ashby Road, Burton upon Trent, DE15 0YZ. Incorporated in England: 02880501



0001

TEST REPORT

Dynamic Cone Penetrometer

Documented In House Method No DIHM 302

Client: CURTINS CONSULTING ENGINEERS
 Edinburgh
 United Kingdom
 EH4 3BL

Report No: 51061689/21/01
 Job No: 51061689
 Date Tested: 09/03/2021
 Date Reported: 17/03/2021


Contact: 1a Belford Road
 Site: West Cumberland Hospital, Whitehaven

Material: Clay & Stone

Location: Proposed Waste Compound

Reference: No 1
 Start Depth(mm) : 100

Interpretative Method : TRL Equation : $\text{Log}_{10}(\text{CBR}) = 2.480 - 1.057 \times \text{Log}_{10}(\text{mm/blow})$

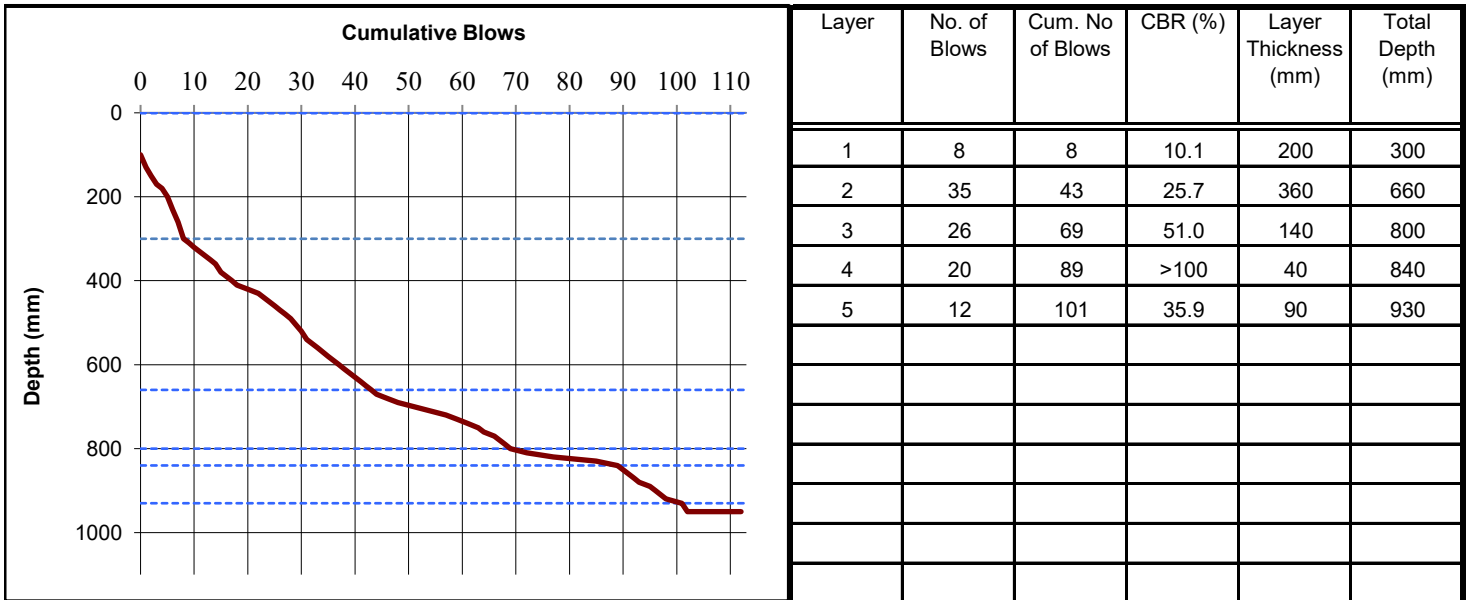

Comments :

Signed: P. Thomas

- Mark R. Dawkins - Laboratory Manager
- Paul Thomas - Section Manager

For and on behalf of SOCOTEC UK Limited

Opinions and interpretations expressed herein are outside the scope of UKAS accreditation. This test report may not be reproduced other than in full, except with prior written approval of the issuing laboratory. Results reported herein relate solely to the sample(s) tested and are not necessarily representative of a larger sample population. SOCOTEC UK Limited, Reg Office: SOCOTEC House, Bretby Business Park, Ashby Road, Burton upon Trent, DE15 0YZ. Incorporated in England: 02880501



TEST CERTIFICATE

Particle Size Distribution

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EB



Tested in Accordance with: BS 1377-2: 1990

Client: CURTINS
Client Address: Rose Wharf, Ground Floor,
78-80 East Street, Leeds,
LS9 8EE

Contact: Joe James
Site Address: West Cumberland Hospital (WCH)


Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Client Reference: 73096
Job Number: 21-93976
Date Sampled: 03/08/2021
Date Received: 10/08/2021
Date Tested: 26/08/2021
Sampled By: Not Given

Test Results:

Laboratory Reference: 1979022
Hole No.: BH21
Sample Reference: Not Given
Sample Description: Brown slightly clayey sandy GRAVEL with cobbles
Sample Preparation: Sample was whole tested, oven dried at 106.0 °C and broken down by hand.

Depth Top [m]: 0.50
Depth Base [m]: 1.00
Sample Type: D

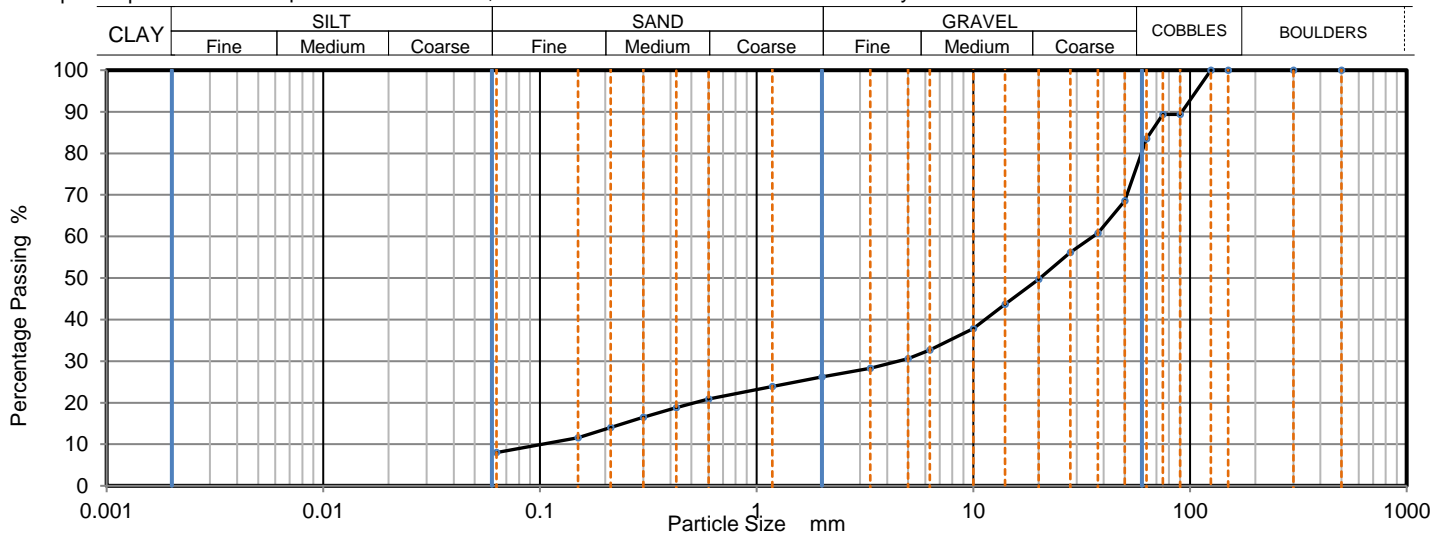

Sieving		Sedimentation	
Particle Size mm	% Passing	Particle Size mm	% Passing
500	100		
300	100		
150	100		
125	100		
90	89		
75	89		
63	84		
50	69		
37.5	61		
28	56		
20	50		
14	44		
10	38		
6.3	33		
5	31		
3.35	28		
2	26		
1.18	24		
0.6	21		
0.425	19		
0.3	17		
0.212	14		
0.15	12		
0.063	8		

Sample Proportions	% dry mass
Very coarse	16
Gravel	57
Sand	18
Fines <0.063mm	8

Grading Analysis		
D100	mm	125
D60	mm	35.6
D30	mm	4.49
D10	mm	0.101
Uniformity Coefficient		350
Curvature Coefficient		5.6

Uniformity Coefficient and Coefficient of Curvature calculated in accordance with BS EN ISO 14688-2: 2004 + A1: 2013

Note: Tested in Accordance with BS1377:Part 2:1990, clause 9.2

Remarks: The material submitted - fails to meet the minimum mass requirements as stated in BS1377 Part 2 Table 3
Preliminary report 3

Signed:

Szczepan Bielatowicz
PL Deputy Head of Geotechnical Section
for and on behalf of i2 Analytical Ltd

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.



TEST CERTIFICATE

Particle Size Distribution

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EB



Tested in Accordance with: BS 1377-2: 1990

Client: CURTINS
Client Address: Rose Wharf, Ground Floor,
78-80 East Street, Leeds,
LS9 8EE
Contact: Joe James
Site Address: West Cumberland Hospital (WCH)


Client Reference: 73096
Job Number: 21-93976
Date Sampled: 04/08/2021
Date Received: 10/08/2021
Date Tested: 28/08/2021
Sampled By: Not Given

Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Test Results:

Laboratory Reference: 1979023
Hole No.: TP02 TW
Sample Reference: Not Given
Sample Description: Brown clayey sandy GRAVEL
Sample Preparation: Sample was quartered, oven dried at 106.1 °C and broken down by hand.

Depth Top [m]: 0.30
Depth Base [m]: 0.40
Sample Type: B

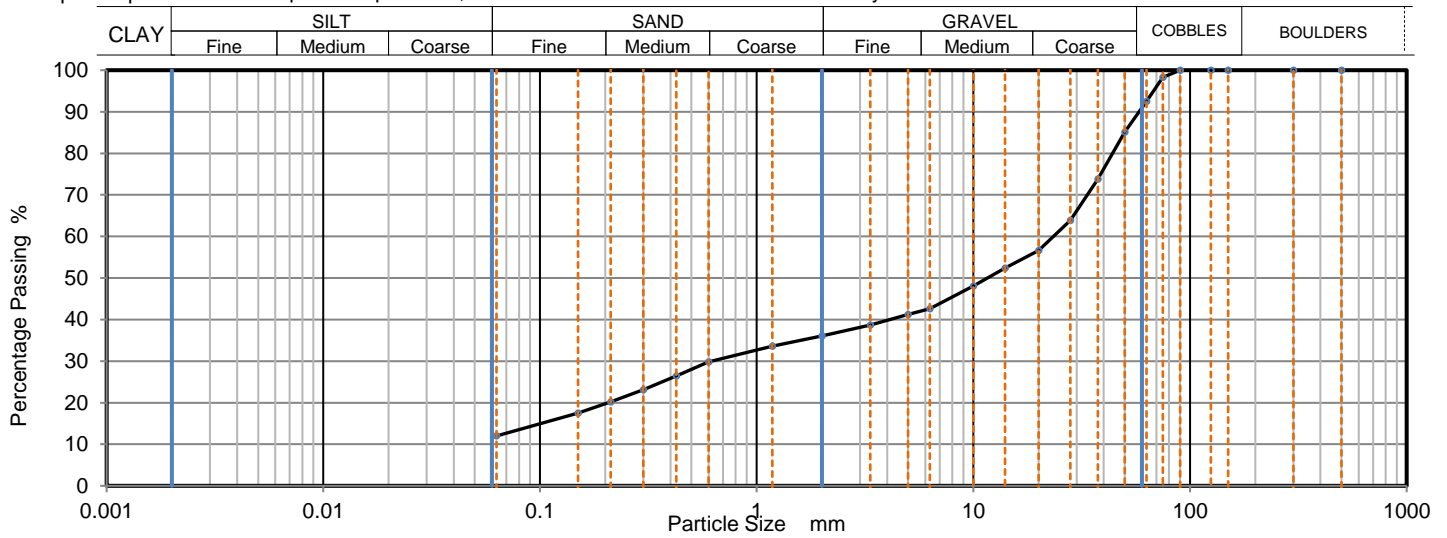

Sieving		Sedimentation	
Particle Size mm	% Passing	Particle Size mm	% Passing
500	100		
300	100		
150	100		
125	100		
90	100		
75	98		
63	93		
50	85		
37.5	74		
28	64		
20	57		
14	52		
10	48		
6.3	43		
5	41		
3.35	39		
2	36		
1.18	34		
0.6	30		
0.425	26		
0.3	23		
0.212	20		
0.15	18		
0.063	13		

Sample Proportions	% dry mass
Very coarse	7
Gravel	56
Sand	23
Fines <0.063mm	13

Grading Analysis		
D100	mm	90
D60	mm	23.4
D30	mm	0.626
D10	mm	
Uniformity Coefficient		> 370
Curvature Coefficient		

Uniformity Coefficient and Coefficient of Curvature calculated in accordance with BS EN ISO 14688-2: 2004 + A1: 2013

Note: Tested in Accordance with BS1377:Part 2:1990, clause 9.2

Remarks: Preliminary report 3

Signed:

Szczepan Bielatowicz
PL Deputy Head of Geotechnical Section
for and on behalf of i2 Analytical Ltd

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.



TEST CERTIFICATE

Particle Size Distribution

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EB



Tested in Accordance with: BS 1377-2: 1990

Client: CURTINS
Client Address: Rose Wharf, Ground Floor,
78-80 East Street, Leeds,
LS9 8EE

Contact: Joe James
Site Address: West Cumberland Hospital (WCH)


Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Client Reference: 73096
Job Number: 21-93976
Date Sampled: 04/08/2021
Date Received: 10/08/2021
Date Tested: 26/08/2021
Sampled By: Not Given

Test Results:

Laboratory Reference: 1979024
Hole No.: TW TP04
Sample Reference: Not Given
Sample Description: Brown clayey very sandy GRAVEL
Sample Preparation: Sample was quartered, oven dried at 106.1 °C and broken down by hand.

Depth Top [m]: 1.40
Depth Base [m]: 1.50
Sample Type: B

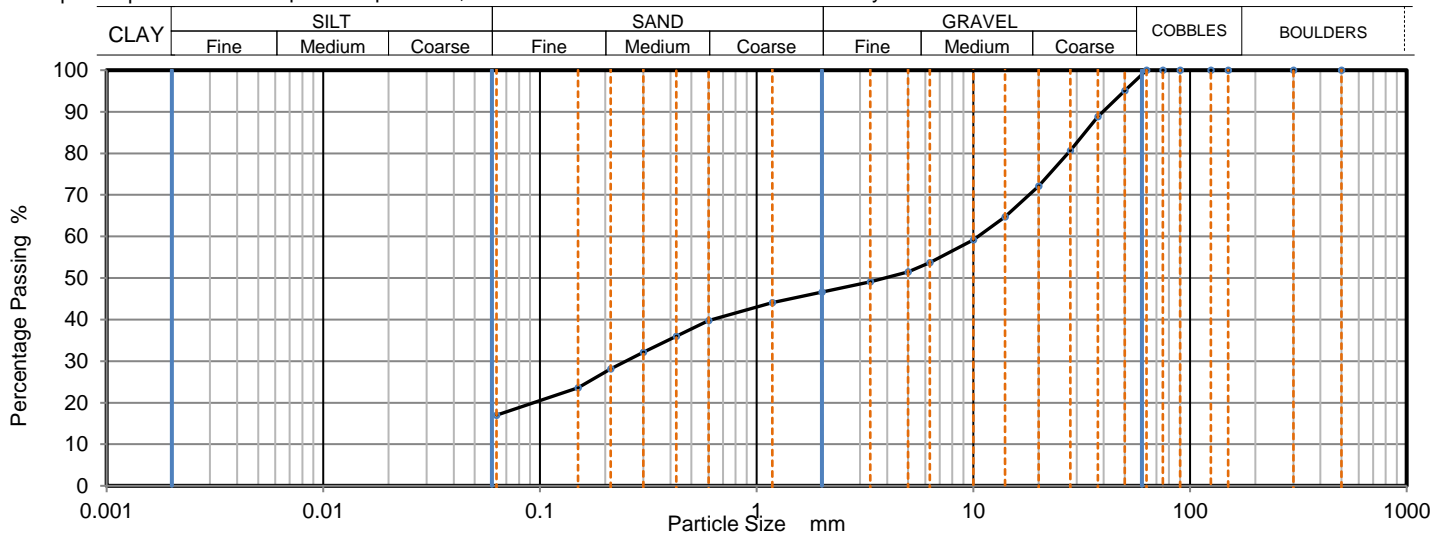

Sieving		Sedimentation	
Particle Size mm	% Passing	Particle Size mm	% Passing
500	100		
300	100		
150	100		
125	100		
90	100		
75	100		
63	100		
50	95		
37.5	89		
28	81		
20	72		
14	65		
10	59		
6.3	54		
5	52		
3.35	49		
2	47		
1.18	44		
0.6	40		
0.425	36		
0.3	32		
0.212	28		
0.15	24		
0.063	17		

Sample Proportions	% dry mass
Very coarse	0
Gravel	53
Sand	29
Fines <0.063mm	17

Grading Analysis		
D100	mm	63
D60	mm	10.5
D30	mm	0.249
D10	mm	
Uniformity Coefficient		> 170
Curvature Coefficient		

Uniformity Coefficient and Coefficient of Curvature calculated in accordance with BS EN ISO 14688-2: 2004 + A1: 2013

Note: Tested in Accordance with BS1377:Part 2:1990, clause 9.2

Remarks: Preliminary report 3

Signed:

Szczepan Bielatowicz
PL Deputy Head of Geotechnical Section
for and on behalf of i2 Analytical Ltd

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.



TEST CERTIFICATE

Particle Size Distribution

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EB



Tested in Accordance with: BS 1377-2: 1990

Client: CURTINS
Client Address: Rose Wharf, Ground Floor,
78-80 East Street, Leeds,
LS9 8EE

Client Reference: 73096
Job Number: 21-93976
Date Sampled: 04/08/2021
Date Received: 10/08/2021
Date Tested: 28/08/2021
Sampled By: Not Given

Contact: Joe James
Site Address: West Cumberland Hospital (WCH)

Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Test Results:

Laboratory Reference: 1979025

Depth Top [m]: 0.50

Hole No.: TW TP01


Depth Base [m]: 0.60

Sample Reference: Not Given

Sample Type: B

Sample Description: Brown clayey sandy GRAVEL

Sample Preparation: Sample was quartered, oven dried at 106.3 °C and broken down by hand.

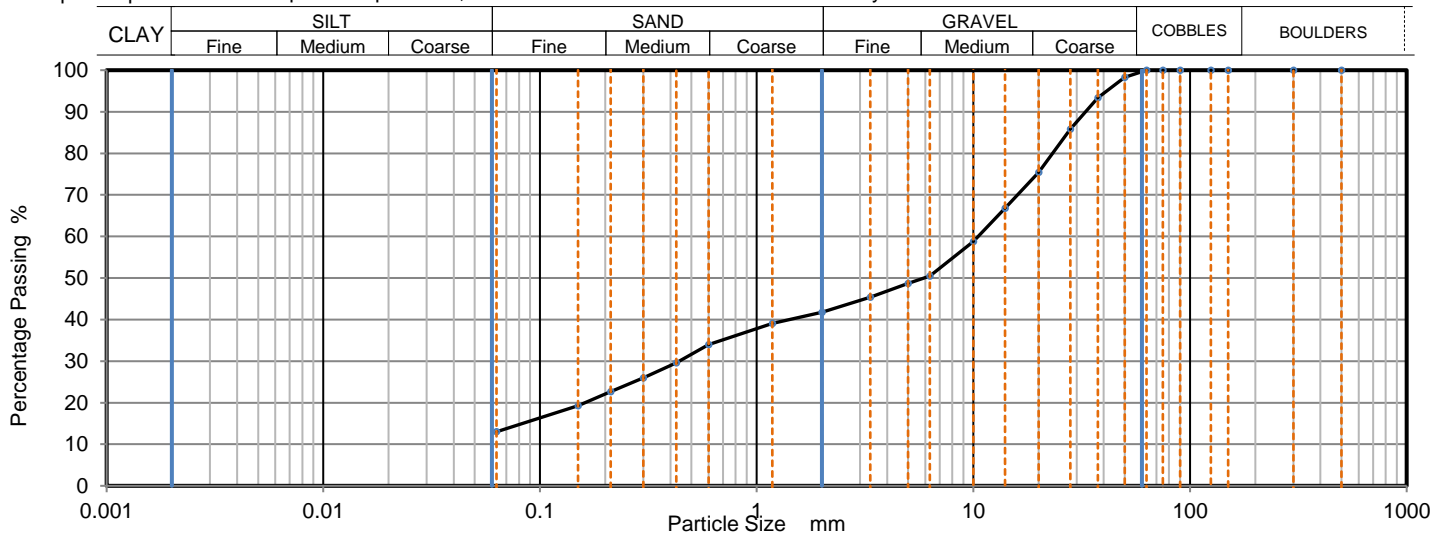

Sieving		Sedimentation	
Particle Size mm	% Passing	Particle Size mm	% Passing
500	100		
300	100		
150	100		
125	100		
90	100		
75	100		
63	100		
50	98		
37.5	93		
28	86		
20	75		
14	67		
10	59		
6.3	51		
5	49		
3.35	45		
2	42		
1.18	39		
0.6	34		
0.425	30		
0.3	26		
0.212	23		
0.15	19		
0.063	14		

Sample Proportions	% dry mass
Very coarse	0
Gravel	58
Sand	28
Fines <0.063mm	14

Grading Analysis	
D100	mm 63
D60	mm 10.5
D30	mm 0.439
D10	mm
Uniformity Coefficient	> 170
Curvature Coefficient	

Uniformity Coefficient and Coefficient of Curvature calculated in accordance with BS EN ISO 14688-2: 2004 + A1: 2013

Note: Tested in Accordance with BS1377:Part 2:1990, clause 9.2

Remarks: Preliminary report 3

Signed:

Szczepan Białatowicz
PL Deputy Head of Geotechnical Section
for and on behalf of i2 Analytical Ltd

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.



TEST CERTIFICATE

Particle Size Distribution

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EB



Tested in Accordance with: BS 1377-2: 1990

Client: CURTINS
Client Address: Rose Wharf, Ground Floor,
78-80 East Street, Leeds,
LS9 8EE

Contact: Joe James
Site Address: West Cumberland Hospital (WCH)


Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Client Reference: 73096
Job Number: 21-93976
Date Sampled: 05/08/2021
Date Received: 10/08/2021
Date Tested: 28/08/2021
Sampled By: Not Given

Test Results:

Laboratory Reference: 1979026
Hole No.: TW TP03
Sample Reference: Not Given
Sample Description: Brown clayey sandy GRAVEL
Sample Preparation: Sample was quartered, oven dried at 107.7 °C and broken down by hand.

Depth Top [m]: 0.90
Depth Base [m]: 1.00
Sample Type: B

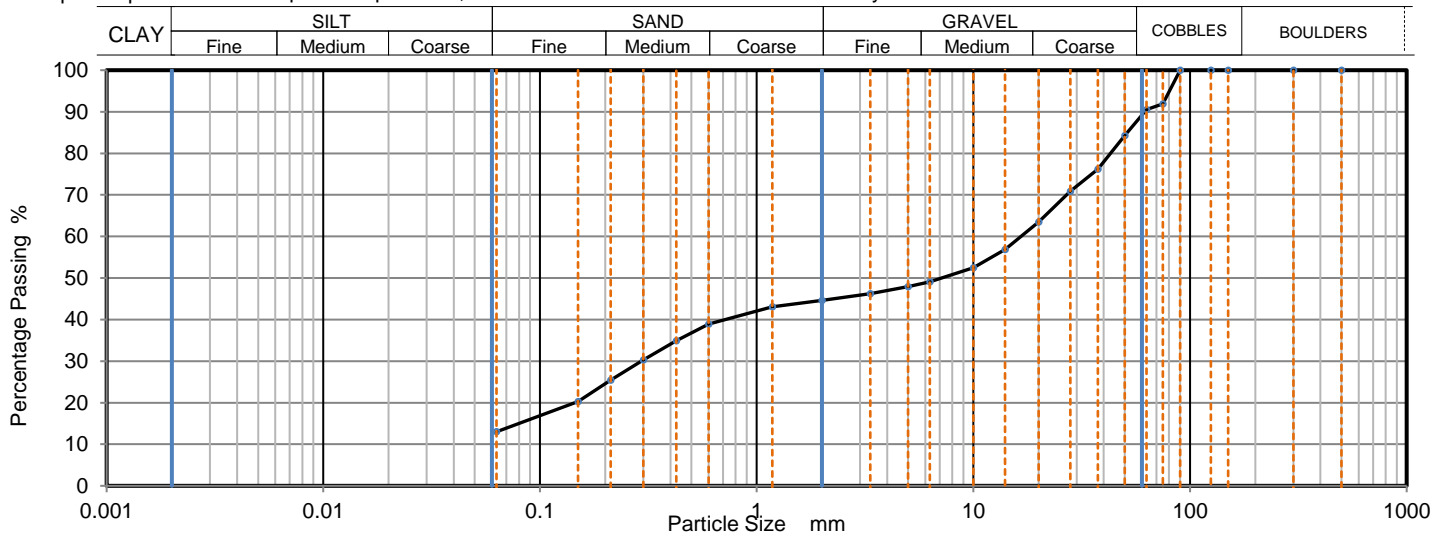

Sieving		Sedimentation	
Particle Size mm	% Passing	Particle Size mm	% Passing
500	100		
300	100		
150	100		
125	100		
90	100		
75	92		
63	91		
50	84		
37.5	76		
28	71		
20	64		
14	57		
10	53		
6.3	49		
5	48		
3.35	46		
2	45		
1.18	43		
0.6	39		
0.425	35		
0.3	30		
0.212	25		
0.15	20		
0.063	14		

Sample Proportions	% dry mass
Very coarse	10
Gravel	46
Sand	31
Fines <0.063mm	14

Grading Analysis	
D100	mm 90
D60	mm 16.5
D30	mm 0.293
D10	mm
Uniformity Coefficient	> 260
Curvature Coefficient	

Uniformity Coefficient and Coefficient of Curvature calculated in accordance with BS EN ISO 14688-2: 2004 + A1: 2013

Note: Tested in Accordance with BS1377:Part 2:1990, clause 9.2

Remarks: Preliminary report 3

Signed:

Szczepan Bielatowicz
PL Deputy Head of Geotechnical Section
for and on behalf of i2 Analytical Ltd

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.



TEST CERTIFICATE

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EB



Determination of resistance to fragmentation by the Los Angeles test method

Tested in Accordance with: BS EN 1097-2:2020

Client: CURTINS
Client Address: Rose Wharf, Ground Floor,
78-80 East Street, Leeds,
LS9 8EE
Contact: Joe James
Site Address: West Cumberland Hospital (WCH)

Client Reference: 73096
Job Number: 21-93976
Date Sampled: 04/08/2021
Date Received: 10/08/2021
Date Tested: 01/09/2021
Sampled By: Not Given

Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Test Results:

Laboratory Reference: 1979023
Hole No.: TP02 TW
Sample Reference: Not Given
Sample Description: Brown clayey sandy GRAVEL

Depth Top [m]: 0.30
Depth Base [m]: 0.40
Sample Type: B

Size Fraction which test portion obtained		Specification %
Sieve Size	Percent Passing	
14.0 mm	100	100
11.2 mm	35	30-40
10.0 mm	0	Zero
Los Angeles Coefficient	59	

Remarks: Coarse fragments were crushed to obtain sufficient mass of size fraction suitable to carry out the test. Results obtained by laboratory may vary from real aggregate parameters due to different crushing method. Preliminary report 3

Signed:

Szczepan Bielatowicz
PL Deputy Head of Geotechnical Section
for and on behalf of i2 Analytical Ltd

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.



TEST CERTIFICATE

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EB



Determination of resistance to fragmentation by the Los Angeles test method

Tested in Accordance with: BS EN 1097-2:2020

Client: CURTINS
Client Address: Rose Wharf, Ground Floor,
78-80 East Street, Leeds,
LS9 8EE
Contact: Joe James
Site Address: West Cumberland Hospital (WCH)

Client Reference: 73096
Job Number: 21-93976
Date Sampled: 04/08/2021
Date Received: 10/08/2021
Date Tested: 01/09/2021
Sampled By: Not Given

Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Test Results:

Laboratory Reference: 1979024
Hole No.: TW TP04
Sample Reference: Not Given
Sample Description: Brown clayey very sandy GRAVEL

Depth Top [m]: 1.40
Depth Base [m]: 1.50
Sample Type: B

Size Fraction which test portion obtained		Specification %
Sieve Size	Percent Passing	
14.0 mm	100	100
11.2 mm	35	30-40
10.0 mm	0	Zero
Los Angeles Coefficient	64	

Remarks: Coarse fragments were crushed to obtain sufficient mass of size fraction suitable to carry out the test. Results obtained by laboratory may vary from real aggregate parameters due to different crushing method. Preliminary report 3

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.

Signed:

Szczepan Bielatowicz
PL Deputy Head of Geotechnical Section
for and on behalf of i2 Analytical Ltd



TEST CERTIFICATE

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EB



Determination of resistance to fragmentation by the Los Angeles test method

Tested in Accordance with: BS EN 1097-2:2020

Client: CURTINS
Client Address: Rose Wharf, Ground Floor,
78-80 East Street, Leeds,
LS9 8EE
Contact: Joe James
Site Address: West Cumberland Hospital (WCH)

Client Reference: 73096
Job Number: 21-93976
Date Sampled: 04/08/2021
Date Received: 10/08/2021
Date Tested: 01/09/2021
Sampled By: Not Given

Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Test Results:

Laboratory Reference: 1979025
Hole No.: TW TP01
Sample Reference: Not Given
Sample Description: Brown clayey sandy GRAVEL

Depth Top [m]: 0.50
Depth Base [m]: 0.60
Sample Type: B

Size Fraction which test portion obtained		Specification %
Sieve Size	Percent Passing	
14.0 mm	100	100
11.2 mm	35	30-40
10.0 mm	0	Zero
Los Angeles Coefficient	57	

Remarks: Coarse fragments were crushed to obtain sufficient mass of size fraction suitable to carry out the test. Results obtained by laboratory may vary from real aggregate parameters due to different crushing method. Preliminary report 3

Signed:

Szczepan Bielatowicz
PL Deputy Head of Geotechnical Section
for and on behalf of i2 Analytical Ltd

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.



TEST CERTIFICATE

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EB



Determination of resistance to fragmentation by the Los Angeles test method

Tested in Accordance with: BS EN 1097-2:2020

Client: CURTINS
Client Address: Rose Wharf, Ground Floor,
78-80 East Street, Leeds,
LS9 8EE
Contact: Joe James
Site Address: West Cumberland Hospital (WCH)

Client Reference: 73096
Job Number: 21-93976
Date Sampled: 05/08/2021
Date Received: 10/08/2021
Date Tested: 01/09/2021
Sampled By: Not Given

Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Test Results:

Laboratory Reference: 1979026
Hole No.: TW TP03
Sample Reference: Not Given
Sample Description: Brown clayey sandy GRAVEL

Depth Top [m]: 0.90
Depth Base [m]: 1.00
Sample Type: B

Size Fraction which test portion obtained		Specification %
Sieve Size	Percent Passing	
14.0 mm	100	100
11.2 mm	35	30-40
10.0 mm	0	Zero
Los Angeles Coefficient	82	

Remarks: Coarse fragments were crushed to obtain sufficient mass of size fraction suitable to carry out the test. Results obtained by laboratory may vary from real aggregate parameters due to different crushing method. Preliminary report 3

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.

Signed:

Szczepan Bielatowicz
PL Deputy Head of Geotechnical Section
for and on behalf of i2 Analytical Ltd



TEST CERTIFICATE

Dry Density/ Moisture Content

Relationship Vib. Hammer Compaction

Tested in Accordance with:
BS 1377-4: 1990: Clause 3.7

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EB



Client: CURTINS
Client Address: Rose Wharf, Ground Floor,
78-80 East Street, Leeds,
LS9 8EE
Contact: Joe James
Site Address: West Cumberland Hospital (WCH)


Client Reference: 73096
Job Number: 21-93976
Date Sampled: 04/08/2021
Date Received: 10/08/2021
Date Tested: 23/09/2021
Sampled By: Not Given

Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Test Results:

Laboratory Reference: 1979023
Hole No.: TP02 TW
Sample Reference: Not Given
Sample Description: Brown clayey sandy GRAVEL
Sample Preparation: Sample was quartered and broken down by hand. Material used was natural.

Depth Top [m]: 0.30
Depth Base [m]: 0.40
Sample Type: B

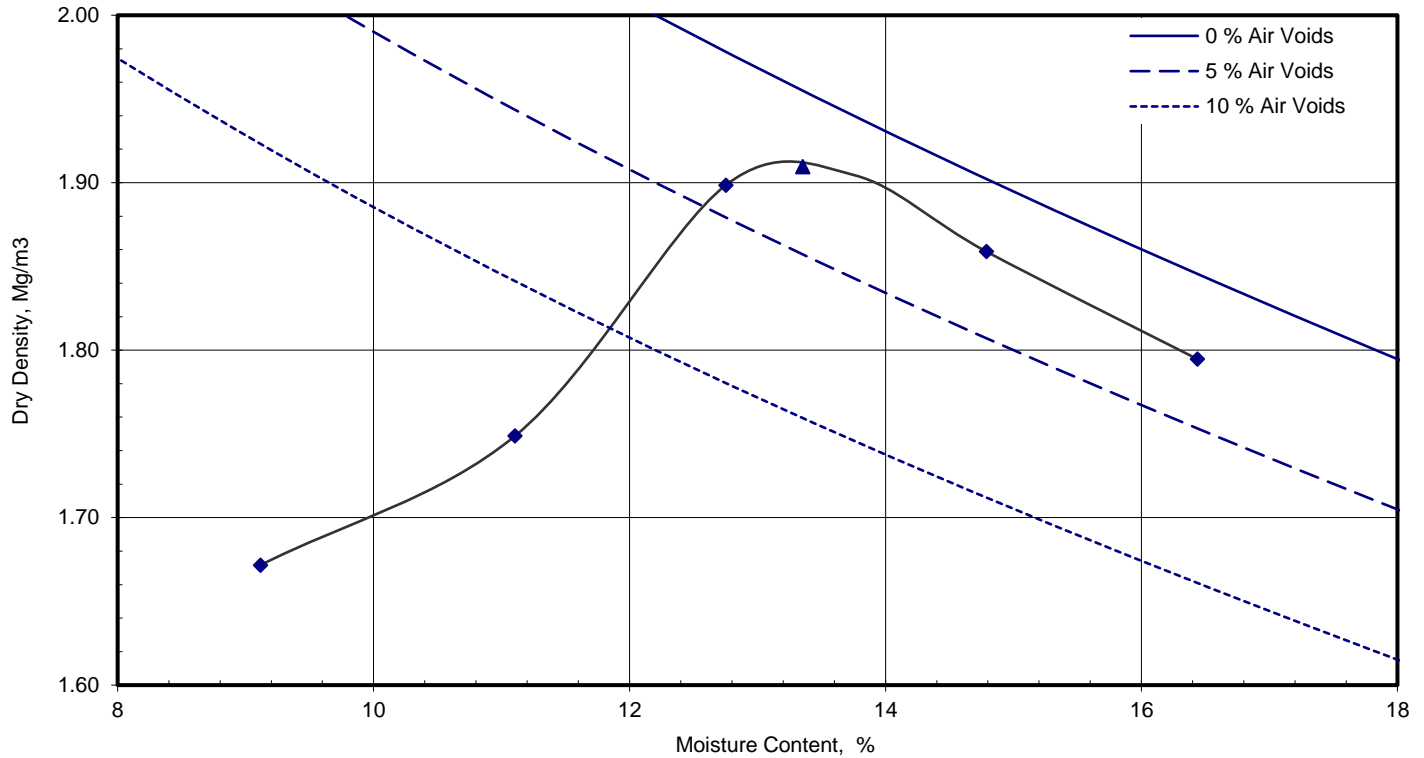

Compaction Point No.	1	2	3	4	5	
Moisture Content	%	9.1	11	13	15	16
Dry Density	Mg/m ³	1.67	1.75	1.90	1.86	1.79

Mould Type	CBR	
Samples Used	Single sample tested	
Material Retained on 37.5 mm Sieve	%	26
Material Retained on 20.0 mm Sieve	%	43
Particle Density - Assumed	Mg/m ³	2.65
As received Moisture Content	%	10
Maximum Dry Density	Mg/m ³	1.91

Optimum Moisture Content	%	13
---------------------------------	---	-----------

Remarks: Zone X - test carried out as per client request
Preliminary report 3

Signed:

Szczepan Bielatowicz
PL Deputy Head of Geotechnical Section
for and on behalf of i2 Analytical Ltd

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.



TEST CERTIFICATE

Dry Density/ Moisture Content

Relationship Vib. Hammer Compaction

Tested in Accordance with:
BS 1377-4: 1990: Clause 3.7

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EB



Client: CURTINS
Client Address: Rose Wharf, Ground Floor,
78-80 East Street, Leeds,
LS9 8EE
Contact: Joe James
Site Address: West Cumberland Hospital (WCH)


Client Reference: 73096
Job Number: 21-93976
Date Sampled: 04/08/2021
Date Received: 10/08/2021
Date Tested: 23/09/2021
Sampled By: Not Given

Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Test Results:

Laboratory Reference: 1979024
Hole No.: TW TP04
Sample Reference: Not Given
Sample Description: Brown clayey very sandy GRAVEL
Sample Preparation: Sample was quartered and broken down by hand. Material used was natural.

Depth Top [m]: 1.40
Depth Base [m]: 1.50
Sample Type: B

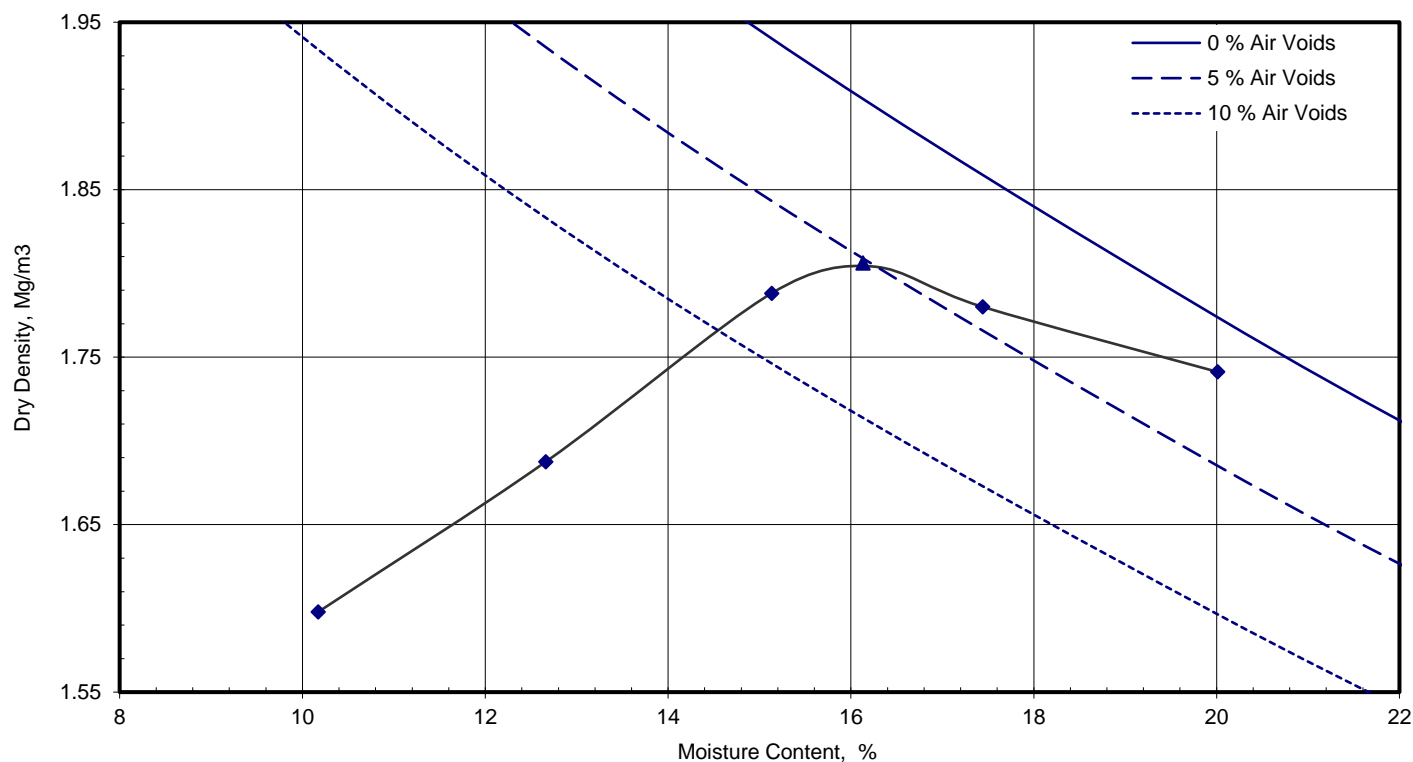

Compaction Point No.	1	2	3	4	5	
Moisture Content	%	10	13	15	17	20
Dry Density	Mg/m³	1.60	1.69	1.79	1.78	1.74

Mould Type	CBR	
Samples Used	Single sample tested	
Material Retained on 37.5 mm Sieve	%	11
Material Retained on 20.0 mm Sieve	%	26
Particle Density - Assumed	Mg/m³	2.75
As received Moisture Content	%	14
Maximum Dry Density	Mg/m³	1.81

Optimum Moisture Content	%	16
---------------------------------	---	-----------

Remarks: Zone X - test carried out as per client request
Preliminary report 3

Signed:

Szczepan Bielatowicz
PL Deputy Head of Geotechnical Section
for and on behalf of i2 Analytical Ltd

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.



TEST CERTIFICATE

Dry Density/ Moisture Content

Relationship Vib. Hammer Compaction

Tested in Accordance with:
BS 1377-4: 1990: Clause 3.7

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EB



Client: CURTINS
Client Address: Rose Wharf, Ground Floor,
78-80 East Street, Leeds,
LS9 8EE
Contact: Joe James
Site Address: West Cumberland Hospital (WCH)


Client Reference: 73096
Job Number: 21-93976
Date Sampled: 04/08/2021
Date Received: 10/08/2021
Date Tested: 23/09/2021
Sampled By: Not Given

Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Test Results:

Laboratory Reference: 1979025
Hole No.: TW TP01
Sample Reference: Not Given
Sample Description: Brown clayey sandy GRAVEL
Sample Preparation: Sample was quartered and broken down by hand. Material used was natural.

Depth Top [m]: 0.50
Depth Base [m]: 0.60
Sample Type: B

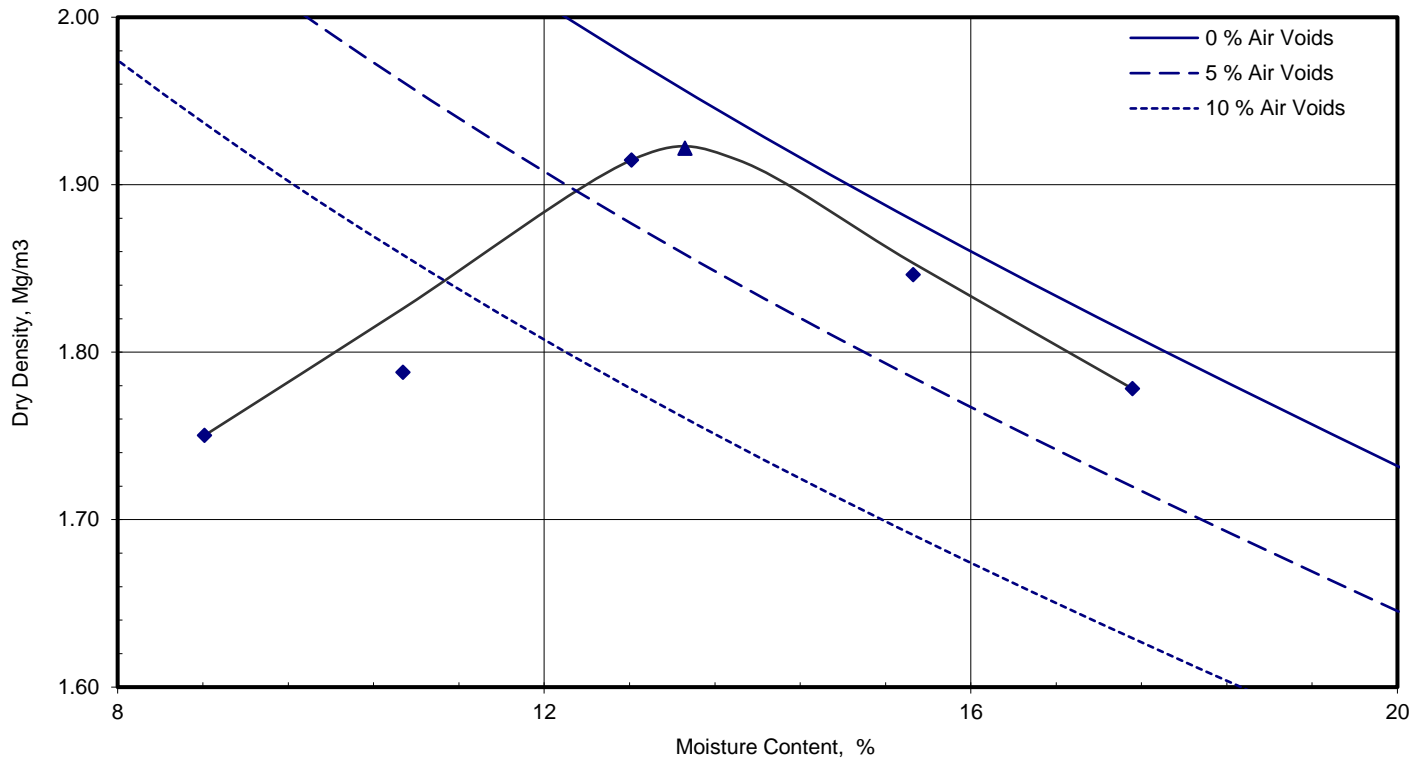

Compaction Point No.	1	2	3	4	5
Moisture Content	% 8.8	11	13	15	18
Dry Density	Mg/m³ 1.75	1.79	1.91	1.85	1.78

Mould Type	CBR
Samples Used	Single sample tested
Material Retained on 37.5 mm Sieve	% 7
Material Retained on 20.0 mm Sieve	% 25
Particle Density - Assumed	Mg/m³ 2.65
As received Moisture Content	% 10.0
Maximum Dry Density	Mg/m³ 1.92

Optimum Moisture Content	% 13
---------------------------------	-------------

Remarks: Preliminary report 3

Signed:

Szczepan Bielatowicz
PL Deputy Head of Geotechnical Section
for and on behalf of i2 Analytical Ltd

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.



4041

TEST CERTIFICATE**DETERMINATION OF SHEAR STRENGTH
BY DIRECT SHEAR
(LARGE SHEARBOX APPARATUS)**

Tested in Accordance with: BS 1377-7:1990: Clause 5.5.4

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EBClient: CURTINS
Client Address: Rose Wharf, Ground Floor,
78-80 East Street, Leeds,
LS9 8EE
Contact: Joe James
Site Address: West Cumberland Hospital (WCH)Client Reference: 73096
Job Number: 21-93976
Date Sampled: Not Given
Date Received: 10/08/2021
Date Tested: 21/10/2021
Sampled By: Not Given

Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Test Results:Laboratory Reference: 1979023
Hole No.: TP02 TW
Sample Reference: Not Given
Sample Description: Brown clayey sandy GRAVELDepth Top [m]: 0.30
Depth Base [m]: 0.40
Sample Type: B


Preparation Details

Specimen Details

		Test No.	1	2	3			
Initial	Height		140.0	140.0	140.0			mm
	Length		300.0	300.0	300.0			mm
	Breadth		300.0	300.0	300.0			mm
	Particle Density - (assumed)		2.65	2.65	2.65			Mg/m ³
	Bulk Density		1.99	1.99	1.99			Mg/m ³
	Moisture Content		13.0	13.0	13.0			%
	Dry density		1.76	1.76	1.76			Mg/m ³
	Voids ratio		0.506	0.506	0.506			
	Degree of Saturation		68	68	68			%
Consolidation	Consolidation / Normal Stress applied		50	100	200			kPa
	Change in height during consolidation		0.870	1.585	6.898			mm
	Voids ratio after consolidation		0.497	0.489	0.432			
After test	Final Moisture Content		12.6	12.7	12.5			%

Shearing stage(s)

Rate of displacement	Peak	1.00000	1.00000	1.00000				mm/min
	Residual							mm/min
Peak values, (o)	Relative horizontal displacement	44.99	44.99	44.99				mm
	Shear stress	71.7	115.6	211.1				kPa
	Vertical Movement at peak shear stress	0.29	3.28	6.86				mm
Residual values, (x)	No. of traverses (including peak run)	1	1	1				
	Relative horizontal displacement							mm
	Shear stress							kPa
	Vertical movement at residual shear stress							mm

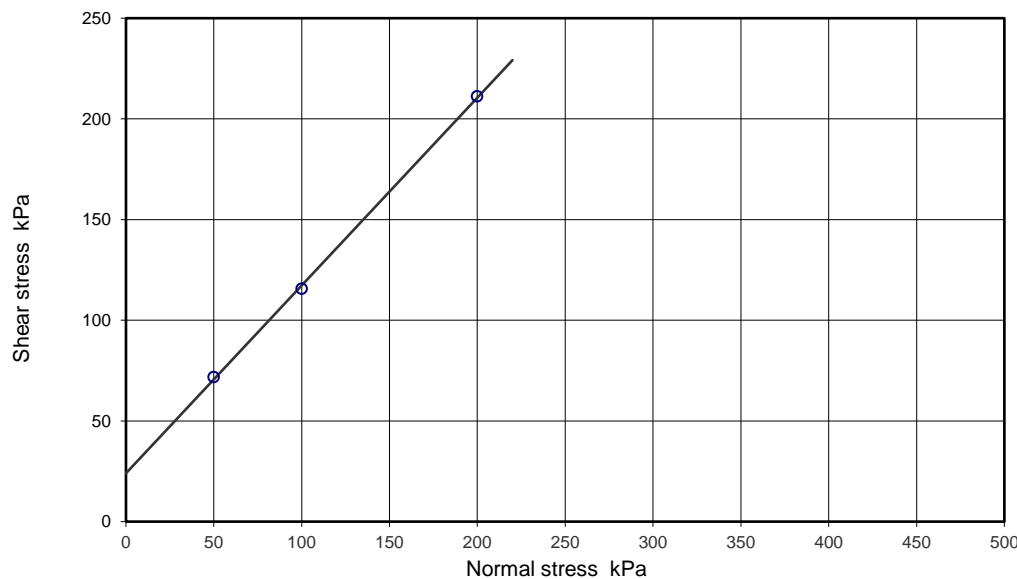

Total test time <1 days

Shear Strength Parameters

Peak strength, (o)		Regression	Manual
c'	kPa	24	-
Ø'	degrees	43.0	-

Residual strength, (x)

Residual strength, (x)		Regression	Manual
c'R	kPa	not assessed	-
Ø'R	degrees	not assessed	-

Remarks:Test carried out on material passing 20 mm; Standard pressures 50/100/200 kPa; Target Dry Density 1.72-1.80 Mg/m³; Target Moisture Content 13 %; Recompact using Vibrating Hammer; Rate of displacement 1 mm/min; Sample not immersed in water as per Specification for Highway Works Series 600 Clause 636.**Signed:**Anna Dudzinska
Deputy Head of Geo Office Section
for and on behalf of i2 Analytical Ltd

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.



4041

TEST CERTIFICATE

DETERMINATION OF SHEAR STRENGTH BY DIRECT SHEAR (LARGE SHEARBOX APPARATUS)

Tested in Accordance with: BS 1377-7:1990: Clause 5.5.4

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EB



Client: CURTINS
Client Address: Rose Wharf, Ground Floor,
78-80 East Street, Leeds,
LS9 8EE
Contact: Joe James
Site Address: West Cumberland Hospital (WCH)




Client Reference: 73096
Job Number: 21-93976
Date Sampled: Not Given
Date Received: 10/08/2021
Date Tested: 21/10/2021
Sampled By: Not Given

Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Test Results:

Laboratory Reference: 1979023
Hole No.: TP02 TW
Sample Reference: Not Given
Sample Description: Brown clayey sandy GRAVEL

Depth Top [m]: 0.30
Depth Base [m]: 0.40
Sample Type: B

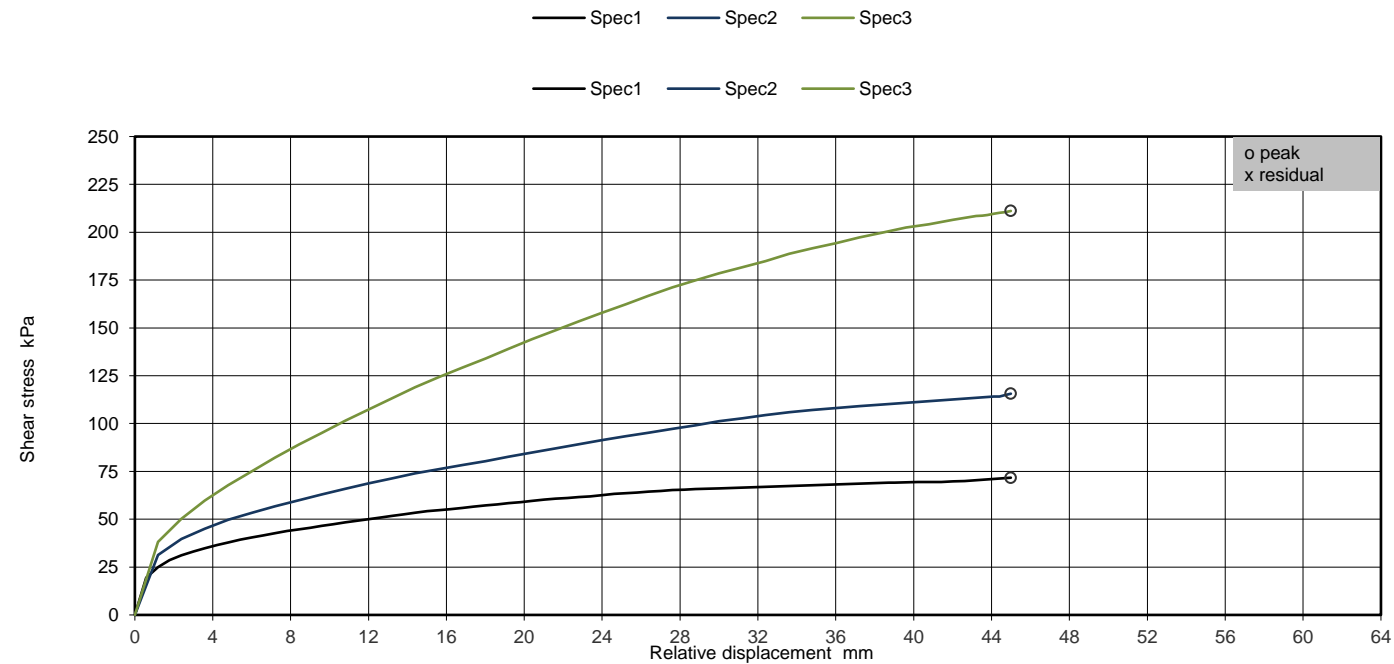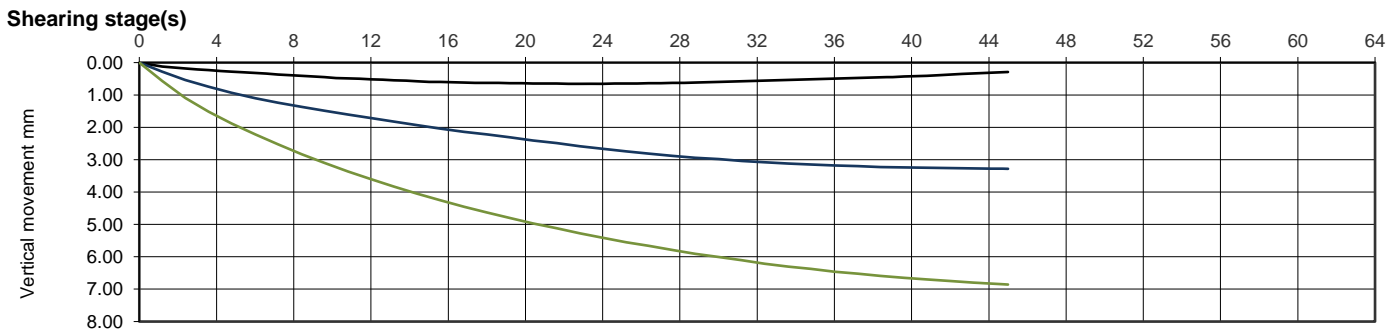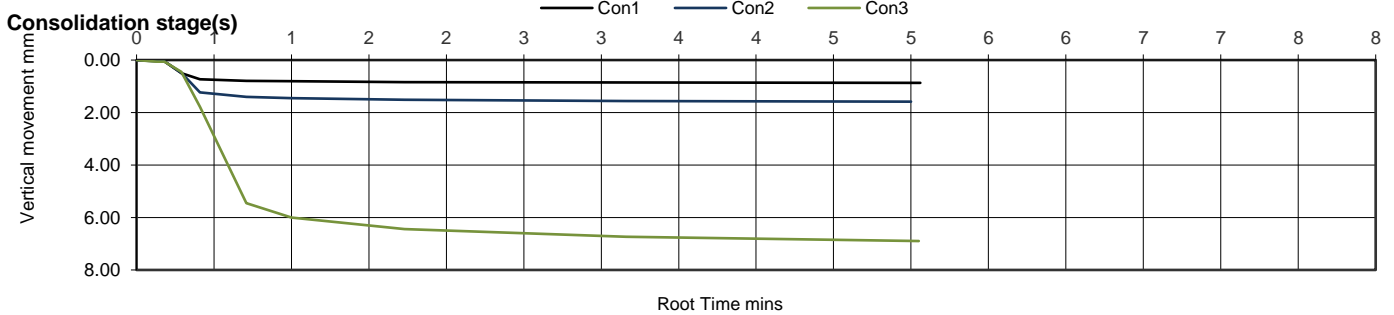

Remarks: Test carried out on material passing 20 mm; Standard pressures 50/100/200 kPa; Target Dry Density 1.72-1.80 Mg/m³; Target Moisture Content 13 %; Recompacted using Vibrating Hammer; Rate of displacement 1 mm/min; Sample not immersed in water as per Specification for Highway Works Series 600 Clause 636.

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.

Signed:
Anna Dudzinska
Deputy Head of Geo Office Section
for and on behalf of i2 Analytical Ltd



4041

TEST CERTIFICATE**DETERMINATION OF SHEAR STRENGTH
BY DIRECT SHEAR
(LARGE SHEARBOX APPARATUS)**

Tested in Accordance with: BS 1377-7:1990: Clause 5.5.4

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EB

Client: CURTINS
 Client Address: Rose Wharf, Ground Floor,
 78-80 East Street, Leeds,
 LS9 8EE
 Contact: Joe James
 Site Address: West Cumberland Hospital (WCH)

Client Reference: 73096
 Job Number: 21-93976
 Date Sampled: Not Given
 Date Received: 10/08/2021
 Date Tested: 18/10/2021
 Sampled By: Not Given

Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Test Results:

Laboratory Reference: 1979024
 Hole No.: TW TP04
 Sample Reference: Not Given
 Sample Description: Brown clayey very sandy GRAVEL

Depth Top [m]: 1.40
 Depth Base [m]: 1.50
 Sample Type: B

Preparation Details


Specimen Details

Test No.

		1	2	3			
Initial	Height	140.0	140.0	140.0			mm
	Length	300.0	300.0	300.0			mm
	Breadth	300.0	300.0	300.0			mm
	Particle Density - (assumed)	2.65	2.65	2.65			Mg/m ³
	Bulk Density	1.93	1.93	1.93			Mg/m ³
	Moisture Content	16.0	16.0	16.0			%
	Dry density	1.66	1.66	1.66			Mg/m ³
	Voids ratio	0.596	0.596	0.596			
	Degree of Saturation	71	71	71			%
Consolidation	Consolidation / Normal Stress applied	50	100	200			kPa
	Change in height during consolidation	1.105	1.677	5.650			mm
	Voids ratio after consolidation	0.583	0.577	0.532			
After test	Final Moisture Content	15.5	15.1	14.5			%

Shearing stage(s)

		1.00000	1.00000	1.00000			
Rate of displacement	Peak						mm/min
	Residual						mm/min
Peak values, (o)	Relative horizontal displacement	36.02	44.72	44.99			mm
	Shear stress	63.1	111.9	212.1			kPa
	Vertical Movement at peak shear stress	0.65	3.41	6.39			mm
Residual values, (x)	No. of traverses (including peak run)	1	1	1			
	Relative horizontal displacement						mm
	Shear stress						kPa
	Vertical movement at residual shear stress						mm

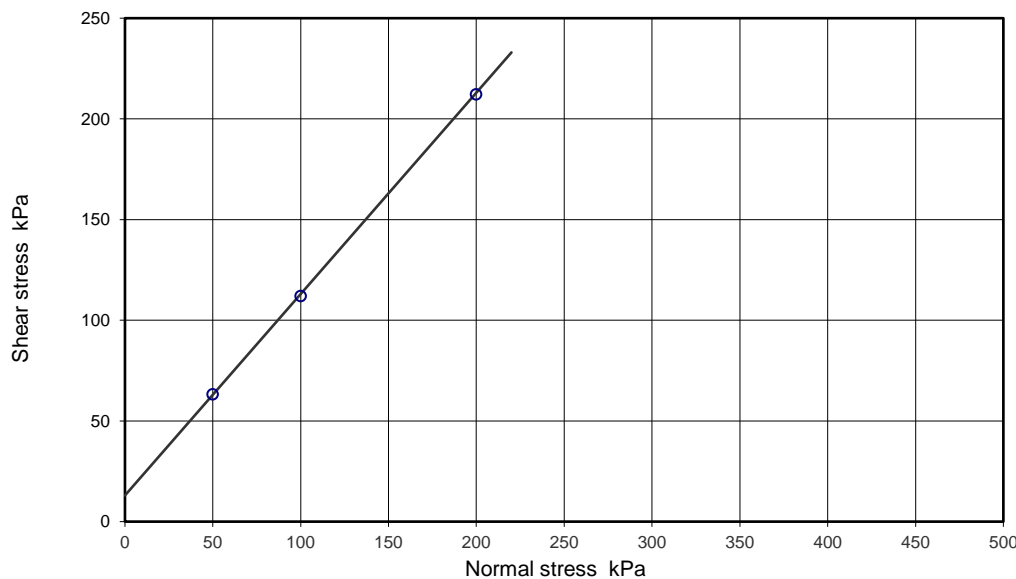

Total test time <1 days

Shear Strength Parameters

Peak strength, (o)	Regression	Manual
c' kPa	13	-
Ø' degrees	45.0	-

Residual strength, (x)

c'R	Regression	Manual
kPa	not assessed	-
Ø'R	degrees	not assessed

Remarks:

Test carried out on material passing 20 mm; Standard pressures 50/100/200 kPa; Target Dry Density 1.63-1.70 Mg/m³; Target Moisture Content 16 %; Recompact using Vibrating Hammer; Rate of displacement 1 mm/min; Sample not immersed in water as per Specification for Highway Works Series 600 Clause 636.

Signed:

Anna Dudzinska
 Deputy Head of Geo Office Section
 for and on behalf of i2 Analytical Ltd

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.



4041

TEST CERTIFICATE

DETERMINATION OF SHEAR STRENGTH BY DIRECT SHEAR (LARGE SHEARBOX APPARATUS)

Tested in Accordance with: BS 1377-7:1990: Clause 5.5.4

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EB



Client: CURTINS
Client Address: Rose Wharf, Ground Floor,
78-80 East Street, Leeds,
LS9 8EE
Contact: Joe James
Site Address: West Cumberland Hospital (WCH)




Client Reference: 73096
Job Number: 21-93976
Date Sampled: Not Given
Date Received: 10/08/2021
Date Tested: 18/10/2021
Sampled By: Not Given

Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Test Results:

Laboratory Reference: 1979024
Hole No.: TW TP04
Sample Reference: Not Given
Sample Description: Brown clayey very sandy GRAVEL

Depth Top [m]: 1.40
Depth Base [m]: 1.50
Sample Type: B

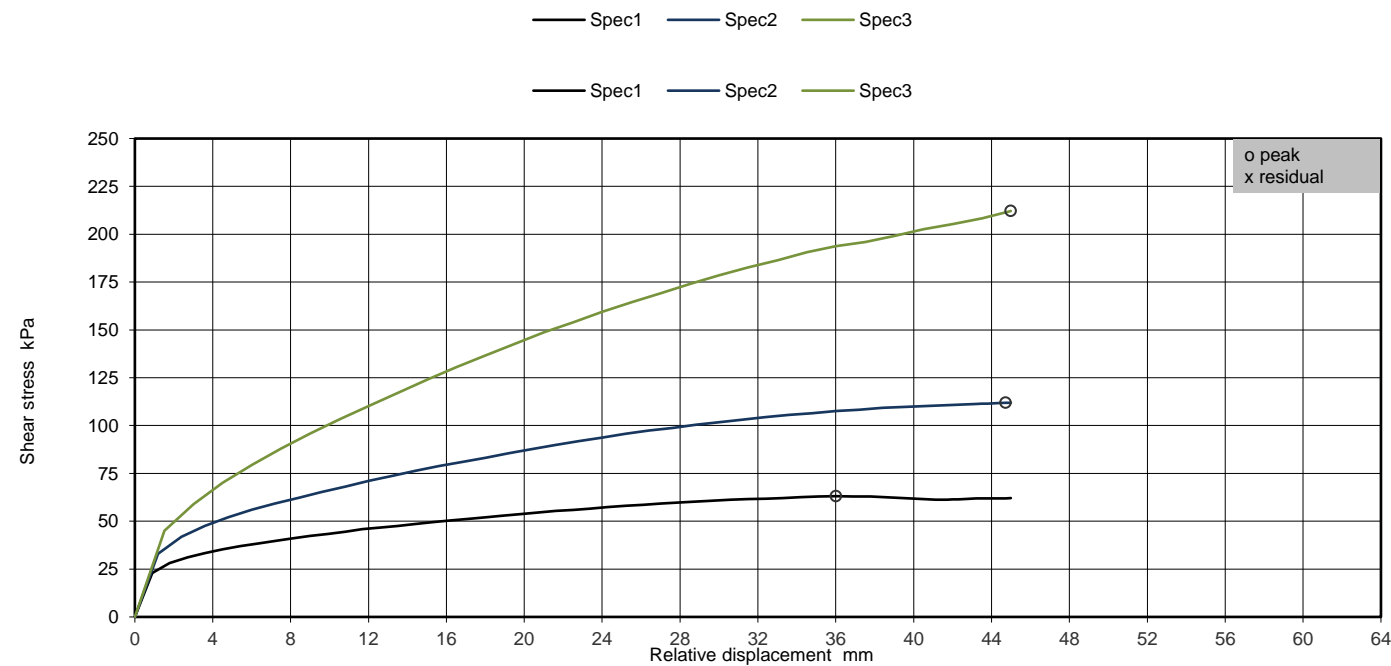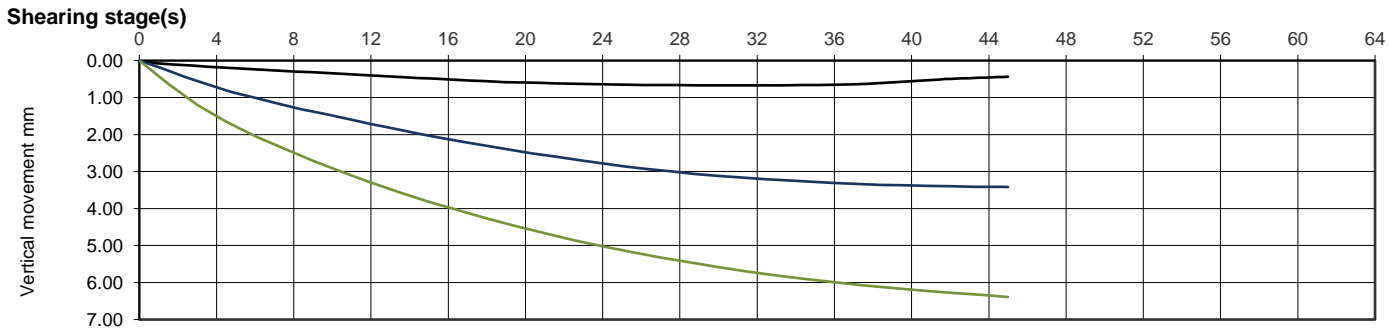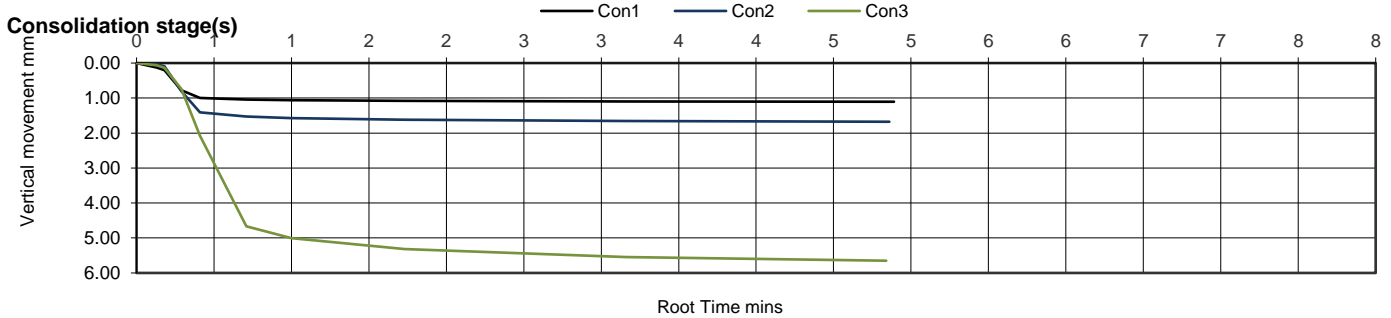

Remarks: Test carried out on material passing 20 mm; Standard pressures 50/100/200 kPa; Target Dry Density 1.63-1.70 Mg/m³; Target Moisture Content 16 %; Recompacted using Vibrating Hammer; Rate of displacement 1 mm/min; Sample not immersed in water as per Specification for Highway Works Series 600 Clause 636.

Signed:

Anna Dudzinska
Deputy Head of Geo Office Section
for and on behalf of i2 Analytical Ltd

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.



4041

TEST CERTIFICATE**DETERMINATION OF SHEAR STRENGTH
BY DIRECT SHEAR
(LARGE SHEARBOX APPARATUS)**

Tested in Accordance with: BS 1377-7:1990: Clause 5.5.4

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EBClient: CURTINS
Client Address: Rose Wharf, Ground Floor,
78-80 East Street, Leeds,
LS9 8EE
Contact: Joe James
Site Address: West Cumberland Hospital (WCH)Client Reference: 73096
Job Number: 21-93976
Date Sampled: Not Given
Date Received: 10/08/2021
Date Tested: 20/10/2021
Sampled By: Not Given

Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Test Results:Laboratory Reference: 1979025
Hole No.: TW TP01
Sample Reference: Not Given
Sample Description: Brown clayey sandy GRAVELDepth Top [m]: 0.50
Depth Base [m]: 0.60
Sample Type: B


Preparation Details

Specimen Details

		Test No.	1	2	3			
Initial	Height		140.0	140.0	140.0			mm
	Length		300.0	300.0	300.0			mm
	Breadth		300.0	300.0	300.0			mm
	Particle Density - (assumed)		2.65	2.65	2.65			Mg/m ³
	Bulk Density		2.00	2.00	2.00			Mg/m ³
	Moisture Content		13.0	13.0	13.0			%
	Dry density		1.77	1.77	1.77			Mg/m ³
	Voids ratio		0.497	0.497	0.497			
	Degree of Saturation		69	69	69			%
Consolidation	Consolidation / Normal Stress applied		50	100	200			kPa
	Change in height during consolidation		0.878	1.484	3.307			mm
	Voids ratio after consolidation		0.488	0.481	0.462			
After test	Final Moisture Content		13.0	12.8	12.3			%

Shearing stage(s)

Rate of displacement	Peak	1.00000	1.00000	1.00000				mm/min
	Residual							mm/min
Peak values, (o)	Relative horizontal displacement	30.29	42.02	44.99				mm
	Shear stress	77.6	118.9	232.4				kPa
	Vertical Movement at peak shear stress	-1.49	1.74	4.75				mm
Residual values, (x)	No. of traverses (including peak run)	1	1	1				
	Relative horizontal displacement							mm
	Shear stress							kPa
	Vertical movement at residual shear stress							mm

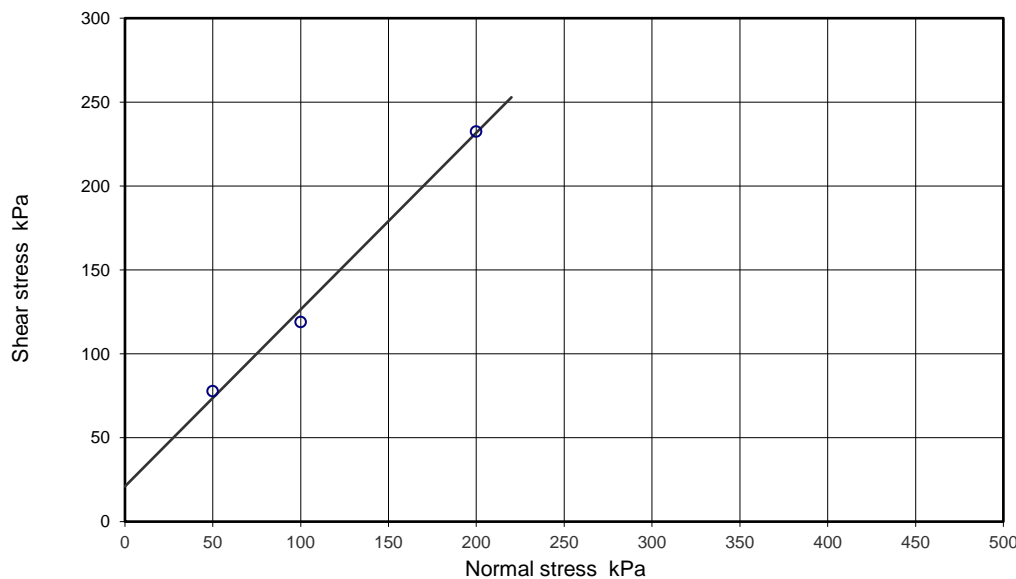

Total test time <1 days

Shear Strength Parameters

Peak strength, (o)		Regression	Manual
c'	kPa	21	-
Ø'	degrees	46.5	-

Residual strength, (x)

c'R	kPa	not assessed	-
Ø'R	degrees	not assessed	-

Remarks:Test carried out on material passing 20 mm; Standard pressures 50/100/200 kPa; Target Dry Density 1.73-1.80 Mg/m³; Target Moisture Content 13 %; Recompact using Vibrating Hammer; Rate of displacement 1 mm/min; Sample not immersed in water as per Specification for Highway Works Series 600 Clause 636.**Signed:**Anna Dudzinska
Deputy Head of Geo Office Section
for and on behalf of i2 Analytical Ltd

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.



4041

TEST CERTIFICATE

DETERMINATION OF SHEAR STRENGTH BY DIRECT SHEAR (LARGE SHEARBOX APPARATUS)

Tested in Accordance with: BS 1377-7:1990: Clause 5.5.4

i2 Analytical Ltd
Unit 8 Harrowden Road
Brackmills Industrial Estate
Northampton NN4 7EB



Client: CURTINS
Client Address: Rose Wharf, Ground Floor,
78-80 East Street, Leeds,
LS9 8EE
Contact: Joe James
Site Address: West Cumberland Hospital (WCH)




Client Reference: 73096
Job Number: 21-93976
Date Sampled: Not Given
Date Received: 10/08/2021
Date Tested: 20/10/2021
Sampled By: Not Given

Testing carried out at i2 Analytical Limited, ul. Pionierow 39, 41-711 Ruda Slaska, Poland

Test Results:

Laboratory Reference: 1979025
Hole No.: TW TP01
Sample Reference: Not Given
Sample Description: Brown clayey sandy GRAVEL

Depth Top [m]: 0.50
Depth Base [m]: 0.60
Sample Type: B

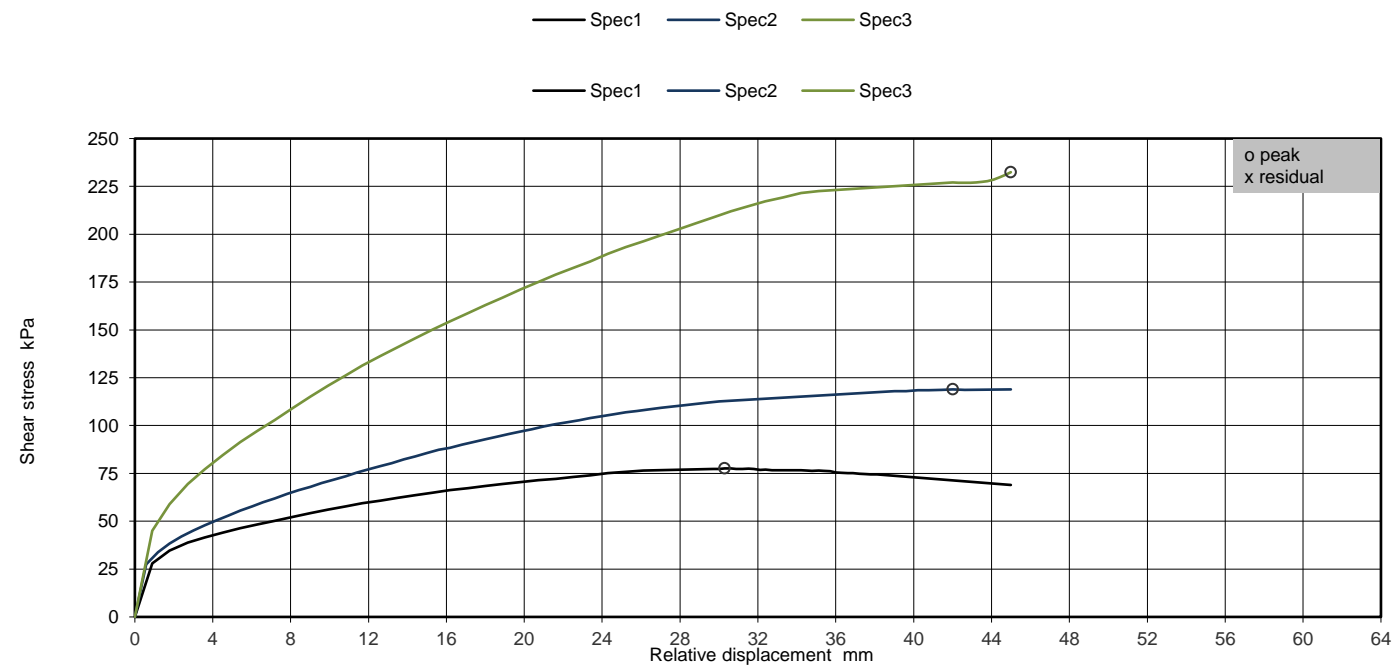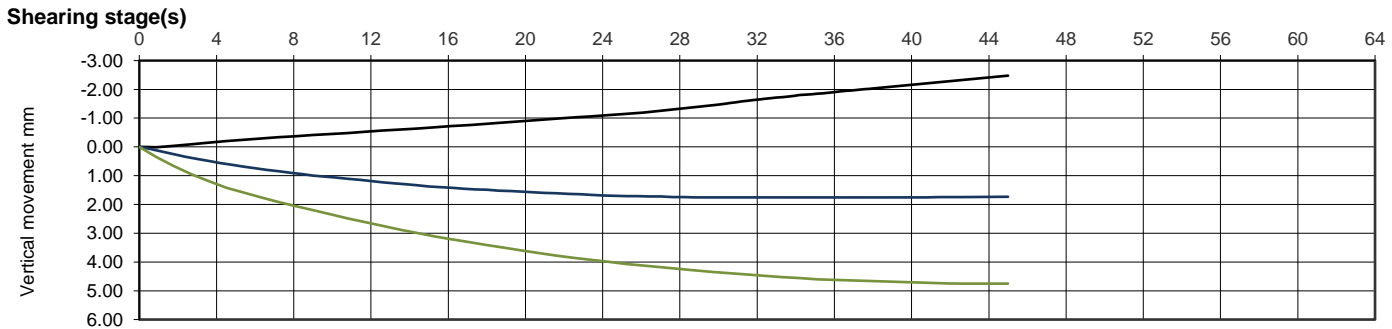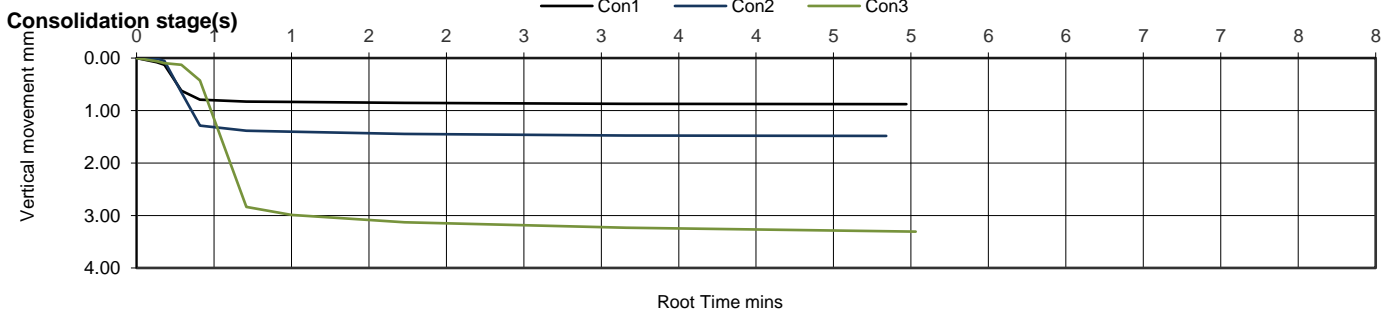

Remarks: Test carried out on material passing 20 mm; Standard pressures 50/100/200 kPa; Target Dry Density 1.73-1.80 Mg/m³; Target Moisture Content 13 %; Recompacted using Vibrating Hammer; Rate of displacement 1 mm/min; Sample not immersed in water as per Specification for Highway Works Series 600 Clause 636.

Signed:

Anna Dudzinska
Deputy Head of Geo Office Section
for and on behalf of i2 Analytical Ltd

Opinions and interpretations expressed herein are outside of the scope of the UKAS Accreditation. This report may not be reproduced other than in full without the prior written approval of the issuing laboratory. The results included within the report relate only to the sample(s) submitted for testing.



Appendix E – Ground Gas and Groundwater Monitoring Results

Curtins

Merchant Exchange, 17-19 Whitworth Street West, Manchester, M1 5WG
 Tel: 0161 236 2394
 Fax: 0161 228 7902



GAS MONITORING LOG SHEET

Project: West Cumberland Hospital **Date:** 07/01/2021
Job Number: B073096.302 **Visit:** 1
Client: CCL Solutions **Weather:** cold, cloudy
Barometric State: Falling **Ground Conditions:** wet / frozen

Borehole Reference	Barometric Pressure mb	Flow		Methane		Carbon Dioxide		Oxygen %	Hydrogen Sulphide ppm	Carbon Monoxide ppm	Water Level m bgl	Borehole Base m bgl	Note
		l/hr		%		%							
		Max	SS	Max	SS	Max	SS						
WS03	986	-22.7	-0.2	0.0	0.0		0.0	112.1	0	0	0.40	1.80	
WS05	988	0.0	0.0	0.0	0.0	0.0	0.0	15.2	0	0	2.05	2.16	
BH01	986	-0.6	0.0	0.0	0.0	0.0	0.0	19.8	0	0	0.77	11.22	
BH02A													1
BH03	987	-63.7	0.0	0.0	0.0	0.0	0.0	18.5	0	0	1.97	13.14	2
BH06	986	-63.8	0.0	0.0	0.0	0.0	0.0	20.0	0	0	0.66	11.55	2

Notes

- 1 Top of borehole frozen / flooded, could not open
- 2 Flow monitored for 5mins as it slowly reduced to 0.0

Logged by

SH

1% gas volume = 10,000 ppm

*Flow rate, methane and carbon dioxide reported as 'maximum' (max) and 'steady state' (SS) readings.
 All other gases recorded at 'steady state' unless otherwise stated*

Curtins

Merchant Exchange, 17-19 Whitworth Street West, Manchester, M1 5WG
 Tel: 0161 236 2394
 Fax: 0161 228 7902



GAS MONITORING LOG SHEET

Project: West Cumberland Hospital **Date:** 20/01/2021
Job Number: B073096.302 **Visit:** 2
Client: CCL Solutions **Weather:** Rain
Barometric State: Falling **Ground Conditions:** Water-logged

Borehole Reference	Barometric Pressure mb	Flow		Methane		Carbon Dioxide		Oxygen %	Hydrogen Sulphide ppm	Carbon Monoxide ppm	Water Level m bgl	Borehole Base m bgl	Note
		l/hr		%		%							
		Max	SS	Max	SS	Max	SS						
WS03	953										0.00	1.76	1
WS05	954	0.1	0.1	0.0	0.0	0.1	0.0	18.60	0	0	1.02	1.15	
BH01	959										0.00	11.27	1, 2, 3
BH02A	956	4.5	1.8	0.0	0.0	1.3	1.3	14.80	0	0	11.20	11.58	
BH03	956	1.8	1.8	0.0	0.0	0.0	0.0	18.20	0	0	0.98	13.12	3
BH06	959										0.00	11.63	1, 3

Notes**Logged by**

- 1 Borehole flooded
 2 Groundwater was originally measured at 0.33m bgl, but rose to ground level when being purged for sampling
 3 Borehole purged and groundwater sample collected

SH

1% gas volume = 10,000 ppm

Flow rate, methane and carbon dioxide reported as 'maximum' (max) and 'steady state' (SS) readings.

All other gases recorded at 'steady state' unless otherwise stated

Curtins

Merchant Exchange, 17-19 Whitworth Street West, Manchester, M1 5WG

Tel: 0161 236 2394

Fax: 0161 228 7902



GAS MONITORING LOG SHEET

Project:	West Cumberland Hospital	Date:	04/02/2021
Job Number:	B073096.302	Visit:	3
Client:	CCL Solutions	Weather:	Rain
Barometric State:	Steady	Ground Conditions:	Wet

Borehole Reference	Barometric Pressure mb	Flow		Methane		Carbon Dioxide		Oxygen %	Hydrogen Sulphide ppm	Carbon Monoxide ppm	Water Level m bgl	Borehole Base m bgl	Note
		l/hr		%		%							
		Max	SS	Max	SS	Max	SS						
WS03											0.00	1.77	1
WS05	993	0.0	0.0	0.0	0.0	0.0	0.0	19.3	0	2	1.63	2.10	
BH01											0.00	11.10	1
BH02A	992	0.0	0.0	0.0	0.0	1.0	1.0	17.8	1	2	10.80	11.45	2
BH03	992	-58.1	0.0	0.0	0.0	0.0	0.0	20.6	1	2	1.57	12.85	3
BH06											0.00	11.40	1

Notes

-
- 1 - Monitoring well flooded.
 - 2 - Monitoring stopped after 30 seconds due to inflow of water into monitoring pipe.
 - 3 - Steady state air flow rate recorded after 6 minutes.

Logged by

MH

1% gas volume = 10,000 ppm

*Flow rate, methane and carbon dioxide reported as 'maximum' (max) and 'steady state' (SS) readings.
All other gases recorded at 'steady state' unless otherwise stated*



GAS MONITORING LOG SHEET

Project: West Cumberland Hospital **Date:** 17/02/2021
Job Number: B073096.302 **Visit:** 4
Client: CCL Solutions **Weather:** Sunny
Barometric State: Steady **Ground Conditions:** Damp

Borehole Reference	Barometric Pressure mb	Flow		Methane		Carbon Dioxide		Oxygen %	Hydrogen Sulphide ppm	Carbon Monoxide ppm	Water Level m bgl	Borehole Base m bgl	Note
		l/hr		%		%							
		Max	SS	Max	SS	Max	SS						
WS03	1014							18.9	0	13	0.00	1.76	1
WS05		0.0	0.0	0.0	0.0	0.0	0.0				1.96	2.14	
BH01	1014							20.8	0	13	0.65	11.25	1
BH02A		0.0	0.0	0.0	0.0	0.0	0.0				11.09	11.33	
BH03		1014	-43.0	0.0	0.0	0.0	0.0				0.0	20.2	
BH06											0.04	10.50	1

Notes

- 1 - Not gas monitored due to historic high water levels. Bung removed to check water levels on arrival, releasing any gas within the well. Monitoring would provide non-representative results.
- 2 - Steady state air flow rate achieved after 4 minutes.

Logged by

MH

*1% gas volume = 10,000 ppm
 Flow rate, methane and carbon dioxide reported as 'maximum' (max) and 'steady state' (SS) readings.
 All other gases recorded at 'steady state' unless otherwise stated*

Curtins

Merchant Exchange, 17-19 Whitworth Street West, Manchester, M1 5WG
 Tel: 0161 236 2394
 Fax: 0161 228 7902



GAS MONITORING LOG SHEET

Project: West Cumberland Hospital **Date:** 08/03/2021
Job Number: B073096.302 **Visit:** 5
Client: CCL Solutions **Weather:** Overcast, showers
Barometric State: Steady **Ground Conditions:** damp

Borehole Reference	Barometric Pressure mb	Flow		Methane		Carbon Dioxide		Oxygen %	Hydrogen Sulphide ppm	Carbon Monoxide ppm	Water Level m bgl	Borehole Base m bgl	Note
		l/hr		%		%							
		Max	SS	Max	SS	Max	SS						
WS03													1
WS05	1013	0.4	0.4	0.0	0.0	0.0	0.0	17.0	0	2	1.95	2.17	
BH01	1012	-23.7	-0.1	0.0	0.0	0.0	0.0	20.8	1	6	0.99	11.32	2
BH02A	1013	-0.4	0.0	0.0	0.0	0.0	0.0	21.9	0	0	11.00	11.40	
BH03	1013	0.7	0.4	0.0	0.0	0.0	0.0	19.5	0	8	1.91	13.00	
BH06	1014	-55.6	0.0	0.0	0.0	0.0	0.0	19.3	1	6	0.75	10.60	3

Notes

- 1 Could not locate
 2 Fell to steady state flow rate after circa 4mins.
 3 Fell to steady state flow rate after circa 3 mins.

Logged by

NF

1% gas volume = 10,000 ppm

*Flow rate, methane and carbon dioxide reported as 'maximum' (max) and 'steady state' (SS) readings.
 All other gases recorded at 'steady state' unless otherwise stated*

Curtins

Merchant Exchange, 17-19 Whitworth Street West, Manchester, M1 5WG

Tel: 0161 236 2394

Fax: 0161 228 7902



GAS MONITORING LOG SHEET

Project:	West Cumberland Hospital	Date:	18/03/2021
Job Number:	B073096.302	Visit:	6
Client:	CCL Solutions	Weather:	Sunny
Barometric State:	Falling	Ground Conditions:	Dry

Borehole Reference	Barometric Pressure mb	Flow		Methane		Carbon Dioxide		Oxygen %	Hydrogen Sulphide ppm	Carbon Monoxide ppm	Water Level m bgl	Borehole Base m bgl	Note
		l/hr		%		%							
		Max	SS	Max	SS	Max	SS						
WS03	1018							20.4	0	0	0.00	1.76	1
WS05		0.0	0.0	0.0	0.0	0.0	0.0				1.80	2.15	
BH01											0.36	11.30	
BH02A	1019							20.8	0	0	1.74	13.10	2
BH03		17.3	0.0	0.0	0.0	0.0	0.0				0.10	10.65	
BH06													

Notes

- | | |
|---|--|
| 1 | Borehole flooded and not gas monitored |
| 2 | Could not locate |

Logged by

SH

1% gas volume = 10,000 ppm

Flow rate, methane and carbon dioxide reported as 'maximum' (max) and 'steady state' (SS) readings.

All other gases recorded at 'steady state' unless otherwise stated



Appendix F – GAC Screening Thresholds

Adopted Soil Generic Assessment Criteria
Sandy loam with 6% SOM



Contaminants	Residential <u>with</u> home grown produce	Residential <u>without</u> home grown produce	Allotments	Commercial	Public open space near residential housing POS _{resi}	Public park POS _{park}
Metals						
Beryllium	1.7	1.7	35	12	2.2	63
Boron	290	11,000	45	240,000	21,000	46,000
Cadmium	10⁽¹³⁾ 22	85⁽¹³⁾ 150	1.8 3.9	230 410	120 <u>220</u>	560 880
Chromium III	910	910	18,000	8,600	1,500	33,000
Chromium VI	6 <u>21</u>	6 <u>21</u>	1.8 <u>170</u>	33 <u>49</u>	7.7 <u>21</u>	220 <u>250</u>
Lead	<u>200</u>	<u>310</u>	<u>80</u>	<u>2,300</u>	<u>630</u>	<u>1,300</u>
Mercury (elemental)	1	1	26	26	16	26⁽⁸⁾ [30]
Mercury (inorganic)	170	240	80	3600	120	240
Nickel	130 ⁽¹⁰⁾	180 ⁽¹⁰⁾	53 ⁽¹¹⁾	980 ⁽¹⁰⁾	230	800
Vanadium	410	1200	91	9000	2000	5000
Copper	2400	7100	520	68000	12000	44000
Zinc	3700	40000	620	730000	81000	170000
Semi-Metals and non-metals						
Arsenic	32⁽¹²⁾ 37	35⁽¹²⁾ 40	43⁽¹²⁾ 49	640⁽¹²⁾ 640	79 <u>79</u>	170 <u>170</u>
Antimony		550		7500	1500	3300
Selenium	350	600	120	13000	1100	1800
Inorganic chemicals						
Cyanide	34	34	34	34	34	34
Organic contaminants						
<i>Aliphatic risk banded hydrocarbons - TPHCWG method</i>						
EC _{>5} - EC ₆	160	160	3900	12000	600000	180000
EC _{>6} - EC ₈	530	530	13000	40000	620000	320000
EC _{>8} - EC ₁₀	150	150	1700	11000	13000	21000
EC ₁₀ -EC ₁₂	760	770	7300	47000	13000	24000
EC ₁₂ -EC ₁₆	4300	4400	13000	90000	13000	26000
EC _{>16} - EC ₃₅	110000	110000	270000	1800000	250000	490000
EC _{>35} - EC ₄₄	110000	110000	270000	1800000	250000	490000
<i>Aromatic risk banded hydrocarbons - TPHCWG method</i>						
EC _{>5} - EC ₇	300	1400	57	86000	56000	92000
EC _{>7} - EC ₈	660	3900	120	180000	56000	100000
EC _{>8} - EC ₁₀	190	270	51	17000	5000	9300
EC ₁₀ - EC ₁₂	380	1200	74	34000	5000	10000
EC ₁₂ - EC ₁₆	660	2500	130	38000	5000	10000
EC _{>16} - EC ₂₁	930	1900	260	28000	3800	7800
EC _{>21} - EC ₃₅	1700	1900	1600	28000	3800	7900
EC _{>35} - EC ₄₄	1700	1900	1600	28000	3800	7900
Aliph + Arom EC >44-70	1900	1900	3000	28000	3800	7900
Aromatic						
Benzene	0.33 0.87	1.0 3.3	0.07 0.18	95 98	73 <u>140</u>	110 <u>230</u>
Ethyl benzene	350	840	90	2800⁽⁸⁾ [66000]	2800⁽⁸⁾ [250000]	2800⁽⁸⁾ [27000]
Toluene	610	2700	120	4400⁽⁸⁾ [190000]	4400⁽⁸⁾ [56000]	4400⁽⁸⁾ [100000]
Xylene ⁽⁹⁾	230	290	160	2600⁽⁸⁾ [32000]	2600⁽⁸⁾ [43000]	2600⁽⁸⁾ [31000]
Phenol	420	520	280	3200⁽¹⁴⁾ (38000)	3200⁽¹⁴⁾ (10000)	3200⁽¹⁴⁾ (9300)
Polycyclic Aromatic Hydrocarbons (PAH)						
Naphthalene	13	13	24	1100	4900	3000
Acenaphthylene	920	6000	160	100000	15000	30000
Acenaphthene	1100	6000	200	100000	15000	30000
Fluorene	860	4500	160	71000	9900	20000
Phenanthrene	440	1500	90	23000	3100	6300
Anthracene	11000	37000	2200	540000	74000	150000
Fluoranthene	890	1600	290	23000	3100	6400
Pyrene	2000	3800	620	54000	7400	15000
Benz(a)anthracene	13	15	13	180	29	62
Chrysene	27	32	19	350	57	120
Benzo(b)fluoranthene	3.7	4.0	3.9	45	7.2	16.0
Benzo(k)fluoranthene	100	110	130	1200	190	440
Benzo(a)pyrene	3.0 5.0	3.2 5.3	3.5 5.7	36 77	5.7 10	13 21
Indeno(123cd)pyrene	41	46	39	510	82	180
Dibenzo(ah)anthracene	0.3	0.32	0.43	3.6	0.58	1.4
Benzo(ghi)perylene	350	360	640	4000	640	1600
Chlorinated Aliphatic Hydrocarbons						
Vinyl chloride	0.0014	0.0015	0.0018	0.12	3.5	5.4
Trichloroethene (TCE)	0.075	0.08	0.21	5.7	120	120
1,1,1,2 Tetrachlorethane	6.4	8.2	4.4	560	1400	2100
Tetrachlorethane (PCE)	0.90	0.92	3.6	95	1400	1500
1,1,1 Trichlorethane	39	40	240	3000	140000	100000

Notes

- All values above are in mg/kg
- Numbers in bold are SGVs or GAC that are derived based on SGV report input parameters, numbers in italics are S4ULs, numbers in bold-italics are based on EIC/AGS/CL:AIRE numbers & input parameters and underlined numbers are C4SLs
- Soil organic matter (SOM) is assumed to be 6% - DEFAULT VALUE
- Soil type is assumed to be sandy loam - DEFAULT SOIL TYPE
- For residential, the building type is conservatively assumed to be a small terrace house where the development includes bungalows change to more conservative bungalow setting in computer model
- For commercial, the building type is conservatively assumed to be a pre 1970s office building, where the proposed development comprises houses, flat with living spaces changes setting in model accordingly
- For classrooms consider increasing the dust loading factor in the 'Soil and Building Data' of the CLEA 1.04 model from 50 to 100µg m⁻³
- Based on vapour saturation limit as suggested by EA / [] model value
- Lowest of o-, m- and p-xylene
- Based on comparison of inhalation exposure with inhalation TDI
- Based on comparison of oral, dermal, and inhalation exposure with the oral TDI
- Based on a comparison of oral and dermal soil exposure with oral Index Dose only
- Averaged over and based on lifetime exposure
- Based on critical concentration for skin irritation in humans arising from contact with phenol in aqueous solution (number in brackets based on health effects following long term exposure for illustration)
- NA: Not applicable

Adopted Soil Generic Assessment Criteria
Sandy loam with 2.5% SOM



Contaminants	Residential with home grown produce	Residential without home grown produce	Allotments	Commercial	Public open space near residential housing POS _{resi}	Public park POS _{park}
Metals						
Beryllium	1.7	1.7	35	12	2.2	63
Boron	290	11,000	45	240,000	21,000	46,000
Cadmium	10⁽¹³⁾ 22	85⁽¹³⁾ 150	1.8 3.9	230 410	120 220	560 880
Chromium III	910	910	18,000	8,600	1,500	33,000
Chromium VI	6 21	6 21	1.8 170	33 49	7.7 21	220 250
Lead	200	310	80	2,300	630	1,300
Mercury (elemental)	1	1	26	26	16	26⁽⁸⁾ [30]
Mercury (inorganic)	170	240	80	3600	120	240
Nickel	130 ⁽¹⁰⁾	180 ⁽¹⁰⁾	53 ⁽¹¹⁾	980 ⁽¹⁰⁾	230	800
Vanadium	410	1200	91	9000	2000	5000
Copper	2400	7100	520	68000	12000	44000
Zinc	3700	40000	620	730000	81000	170000
Semi-Metals and non-metals						
Arsenic	32⁽¹²⁾ 37	35⁽¹²⁾ 40	43⁽¹²⁾ 49	640⁽¹²⁾ 640	79 79	170 170
Antimony		550		7500	1500	3300
Selenium	350	600	120	13000	1100	1800
Inorganic chemicals						
Cyanide	34	34	34	34	34	34
Organic contaminants						
<i>Aliphatic risk banded hydrocarbons - TPHCWG method</i>						
EC ₅ - EC ₆	78	78	1700	5900	590000	130000
EC ₅₋₆ - EC ₈	230	230	5600	17000	610000	220000
EC ₅₋₈ - EC ₁₀	65	65	770	4800	13000	18000
EC ₁₀ - EC ₁₂	330	330	4400	23000	13000	23000
EC ₁₂ - EC ₁₆	2400	2400	13000	82000	13000	25000
EC _{>16} - EC ₃₅	92000	92000	270000	1700000	250000	480000
EC _{>35} - EC ₄₄	92000	92000	270000	1700000	250000	480000
<i>Aromatic risk banded hydrocarbons - TPHCWG method</i>						
EC _{>5} - EC ₇	140	690	27	46000	56000	84000
EC _{>7} - EC ₈	290	1800	51	110000	56000	95000
EC ₅₋₈ - EC ₁₀	83	110	21	8100	5000	8500
EC ₁₀ - EC ₁₂	180	590	31	28000	5000	9700
EC ₁₂ - EC ₁₆	330	2300	57	37000	5100	10000
EC ₁₆ - EC ₂₁	540	1900	110	28000	3800	7700
EC _{>21} - EC ₃₅	1500	1900	820	28000	3800	7800
EC _{>35} - EC ₄₄	1500	1900	820	28000	3800	7800
Aliph + Arom EC >44-70	1800	1900	2100	28000	3800	7800
<i>Aromatic</i>						
Benzene	0.16	0.49	0.035	50	72	100
Ethyl benzene	150	380	39	1200⁽⁸⁾ [35000]	1200⁽⁸⁾ [24000]	1200⁽⁸⁾ [22000]
Toluene	270	1300	51	1900⁽⁸⁾ [110000]	1900⁽⁸⁾ [56000]	1900⁽⁸⁾ [95000]
Xylene ⁽⁹⁾	98	120	70	1200⁽⁸⁾ [14000]	1200⁽⁸⁾ [42000]	1200⁽⁸⁾ [23000]
Phenol	290	420	140	1500⁽¹⁴⁾ (35000)	1500⁽¹⁴⁾ (10000)	1500⁽¹⁴⁾ (8300)
<i>Polycyclic Aromatic Hydrocarbons (PAH)</i>						
Naphthalene	5.6	5.6	10	460	4900	1900
Acenaphthylene	420	4600	69	97000	15000	30000
Acenaphthene	510	4700	85	97000	15000	30000
Fluorene	400	3800	67	68000	9900	20000
Phenanthrene	220	1500	38	22000	3100	6200
Anthracene	5400	35000	950	540000	74000	150000
Fluoranthene	560	1600	130	23000	3100	6300
Pyrene	1200	3800	270	54000	7400	15000
Benz(a)anthracene	11	14	6.5	170	29	56
Chrysene	22	31	9.4	350	57	110
Benzo(b)fluoranthene	3.3	4.0	2.1	44	7.2	15
Benzo(k)fluoranthene	93	110	75	1200	190	410
Benzo(a)pyrene	2.7	3.2	2	35	5.7	12
Indeno(123cd)pyrene	36	46	21	510	82	170
Dibenzo(ah)anthracene	0.28	0.32	0.27	3.6	0.57	1.3
Benzo(ghi)perylene	340	360	470	4000	640	1500
Chlorinated Aliphatic Hydrocarbons						
Vinyl chloride	0.00087	0.001	0.001	0.077	3.5	5
Trichloroethene (TCE)	0.034	0.036	0.091	2.6	120	91
1,1,1,2 Tetrachlorethane	2.8	3.5	1.9	250	1400	1800
Tetrachlorethane (PCE)	0.39	0.4	1.5	42	1400	1100
1,1,1 Trichlorethane	18	18	110	1300	140000	76000

Notes

- All values above are in mg/kg
- Numbers in bold are SGVs or GAC that are derived based on SGV report input parameters, numbers in italics are S4ULs, numbers in bold-italics are based on EIC/AGS/CL-AIRE numbers & input parameters and underlined numbers are C4SLs
- Soil organic matter (SOM) is assumed to be 2.5% - DEFAULT VALUE
- Soil type is assumed to be sandy loam - DEFAULT SOIL TYPE
- For residential, the building type is conservatively assumed to be a small terrace house where the development includes bungalows change to more conservative bungalow setting in computer model
- For commercial, the building type is conservatively assumed to be a pre 1970s office building, where the proposed development comprises houses, flat with living spaces changes setting in model accordingly
- For classrooms consider increasing the dust loading factor in the 'Soil and Building Data' of the CLEA 1.04 model from 50 to 100µg m⁻³
- Based on vapour saturation limit as suggested by EA [] model value
- Lowest of o-, m- and p-xylene
- Based on comparison of inhalation exposure with inhalation TDI
- Based on comparison of oral, dermal, and inhalation exposure with the oral TDI
- Based on a comparison of oral and dermal soil exposure with oral Index Dose only
- Averaged over and based on lifetime exposure
- Based on critical concentration for skin irritation in humans arising from contact with phenol in aqueous solution (number in brackets based on health effects following long term exposure for illustration)
- NA: Not applicable

**Adopted Soil Generic Assessment Criteria
Sandy loam with 1% SOM**



Contaminants	Residential <u>with</u> home grown produce	Residential <u>without</u> home grown produce	Allotments	Commercial	Public open space near residential housing POS _{resi}	Public park POS _{park}
Metals						
Beryllium	1.7	1.7	35	12	2.2	63
Boron	290	11,000	45	240,000	21,000	46,000
Cadmium	10⁽¹³⁾ 22	85⁽¹³⁾ 150	1.8 3.9	230 410	120 220	560 880
Chromium III	910	910	18,000	8,600	1,500	33,000
Chromium VI	<u>6 21</u>	<u>6 21</u>	<u>1.8 170</u>	<u>33 49</u>	<u>7.7 21</u>	<u>220 250</u>
Lead	<u>200</u>	<u>310</u>	<u>80</u>	<u>2,300</u>	<u>630</u>	<u>1,300</u>
Mercury (<i>elemental</i>)	1	1	26	26	16	26⁽⁸⁾ [30]
Mercury (<i>inorganic</i>)	170	240	80	3600	120	240
Nickel	130 ⁽¹⁰⁾	180 ⁽¹⁰⁾	53 ⁽¹¹⁾	980 ⁽¹⁰⁾	230	800
Vanadium	410	1200	91	9000	2000	5000
Copper	2400	7100	520	68000	12000	44000
Zinc	3700	40000	620	730000	81000	170000
Semi-Metals and non-metals						
Arsenic	32⁽¹²⁾ 37	35⁽¹²⁾ 40	43⁽¹²⁾ 49	640⁽¹²⁾ 640	79 79	170 170
Antimony		550		7500	1500	3300
Selenium	350	600	120	13000	1100	1800
Inorganic chemicals						
Cyanide	34	34	34	34	34	34
Organic contaminants						
Aliphatic risk banded hydrocarbons - TPHCWG method						
EC ₅ - EC ₆	42	42	730	3200	570000	95000
EC ₆ - EC ₈	100	100	2300	7800	600000	150000
EC ₈ - EC ₁₀	27	27	320	2000	13000	14000
EC ₁₀ - EC ₁₂	130	130	2200	9700	13000	21000
EC ₁₂ - EC ₁₆	1100	1100	11000	59000	13000	25000
EC ₁₆ - EC ₃₅	65000	65000	260000	1600000	250000	450000
EC ₃₅ - EC ₄₄	65000	65000	260000	1600000	250000	450000
Aromatic risk banded hydrocarbons - TPHCWG method						
EC ₅ - EC ₇	70	370	13	26000	56000	76000
EC ₇ - EC ₈	130	860	22	56000	56000	87000
EC ₈ - EC ₁₀	34	47	8.6	3500	5000	7200
EC ₁₀ - EC ₁₂	74	250	13	16000	5000	9200
EC ₁₂ - EC ₁₆	140	1800	23	36000	5100	10000
EC ₁₆ - EC ₂₁	260	1900	46	28000	3800	7600
EC ₂₁ - EC ₃₅	1100	1900	370	28000	3800	7800
EC ₃₅ - EC ₄₄	1100	1900	370	28000	3800	7800
Aliph + Arom EC >44-70	1600	1900	1200	28000	3800	7800
Aromatic						
Benzene	0.08	0.3	0.017	28	72	90
Ethyl benzene	65	170	16	520⁽⁸⁾ [17000]	520⁽⁸⁾ [24000]	520⁽⁸⁾ [17000]
Toluene	120	610	22	860⁽⁸⁾ [59000]	860⁽⁸⁾ [56000]	860⁽⁸⁾ [87000]
Xylene ⁽⁹⁾	41	53	28	480⁽⁸⁾ [69000]	480⁽⁸⁾ [41000]	480⁽⁸⁾ [17000]
Phenol	180	310	66	760⁽¹⁴⁾ (31000)	760⁽¹⁴⁾ (10000)	760⁽¹⁴⁾ (7600)
Polycyclic Aromatic Hydrocarbons (PAH)						
Naphthalene	2.3	2.3	4.1	190	4900	1200
Acenaphthylene	170	2900	28	83000	15000	29000
Acenaphthene	210	3000	34	84000	15000	29000
Fluorene	170	2800	27	63000	9900	20000
Phenanthrene	95	1300	15	22000	3100	6200
Anthracene	2400	31000	380	520000	74000	150000
Fluoranthene	280	1500	52	23000	3100	6300
Pyrene	620	3700	110	54000	7400	15000
Benz(a)anthracene	7.2	11	2.9	170	29	49
Chrysene	15	30	4.1	350	57	93
Benzo(b)fluoranthene	2.6	3.9	0.99	44	7.1	13
Benzo(k)fluoranthene	77	110	37	1200	190	370
Benzo(a)pyrene	2.2	3.2	0.97	35	5.7	11
Indeno(123cd)pyrene	27	45	9.5	500	82	150
Dibenzo(ah)anthracene	0.24	0.31	0.14	3.5	0.57	1.1
Benzo(ghi)perylene	320	360	290	3900	640	1400
Chlorinated Aliphatic Hydrocarbons						
Vinyl chloride	0.00064	0.00077	0.00055	0.059	3.5	4.8
Trichloroethene (TCE)	0.016	0.017	0.041	1.2	120	70
1,1,1,2 Tetrachlorethane	1.2	1.5	0.79	110	1400	1500
Tetrachlorethane (PCE)	0.18	0.18	0.65	19	1400	810
1,1,1 Trichlorethane	8.8	9	48	660	140000	57000

Notes

- All values above are in mg/kg
- Numbers in bold are SGVs or GAC that are derived based on SGV report input parameters, numbers in italics are S4ULs, numbers in bold-italics are based on EIC/AGS/CL:AIRE numbers & input parameters and underlined numbers are C4SLs
- Soil organic matter (SOM) is assumed to be 1% - DEFAULT VALUE
- Soil type is assumed to be sandy loam - DEFAULT SOIL TYPE
- For residential, the building type is conservatively assumed to be a small terrace house where the development includes bungalows change to more conservative bungalow setting in computer model
- For commercial, the building type is conservatively assumed to be a pre 1970s office building, where the proposed development comprises houses, flat with living spaces changes setting in model accordingly
- For classrooms consider increasing the dust loading factor in the 'Soil and Building Data' of the CLEA 1.04 model from 50 to 100µg m⁻³
- Based on vapour saturation limit as suggested by EA / [] model value
- Lowest of o-, m- and p-xylene
- Based on comparison of inhalation exposure with inhalation TDI
- Based on comparison of oral, dermal, and inhalation exposure with the oral TDI
- Based on a comparison of oral and dermal soil exposure with oral Index Dose only
- Averaged over and based on lifetime exposure
- Based on critical concentration for skin irritation in humans arising from contact with phenol in aqueous solution (number in brackets based on health effects following long term exposure for illustration)
- NA: Not applicable



Appendix G – Soakaway Infiltration Results

CALCULATION SHEET - SOIL INFILTRATION RATE

Project: West Cumberland Hospital
Job Number: 73039
Author: ZH

Hole Ref.: SA01
Test Date: 03/08/2021
Test No.: 1 of 3

2.50 m	Length of trial pit
0.90 m	Width of trial pit
0.95 m	Depth (total) of trial pit
2.25 m ²	Area of trial pit base
0.53 m bgl	Water level at start of test (approximate invert level)
0.95 m bgl	Water level at end of test
0.420 m	Effective storage depth
0.635 m bgl	Effective storage depth (75% full)
0.845 m bgl	Effective storage depth (25% full)
0.473 m³	Effective storage volume (V_{75-25})
3.678 m²	Internal surface area (50% effective depth) (a_{50})
605 s	Time for head to fall from 75% to 25% effective depth (t_{75-25})


2.12E-04 m/s **Soil infiltration rate (f)**

RAW DATA

Project: West Cumberland Hospital
Job Number: 73039
Author: ZH

Hole Ref.: SA01
Test Date: 03/08/2021
Test No.: 1 of 3

C	Time (min)	ui	Time (s)	Depth (mm bgl)	Stratum
	0		0	0.53	Grey and brown slightly weathered SANDSTONE with clay infill between fractures.
	1		60	0.56	
	2		120	0.57	
	3		180	0.59	
	4		240	0.61	
	5		300	0.62	
	6		360	0.63	
	7		420	0.64	
	8		480	0.65	
	9		540	0.67	
	10		600	0.68	
	11		660	0.71	
	12		720	0.74	
	13		780	0.77	
	14		840	0.78	
	16		960	0.83	
	18		1080	0.89	
	20		1200	0.92	
	22		1320	0.95	

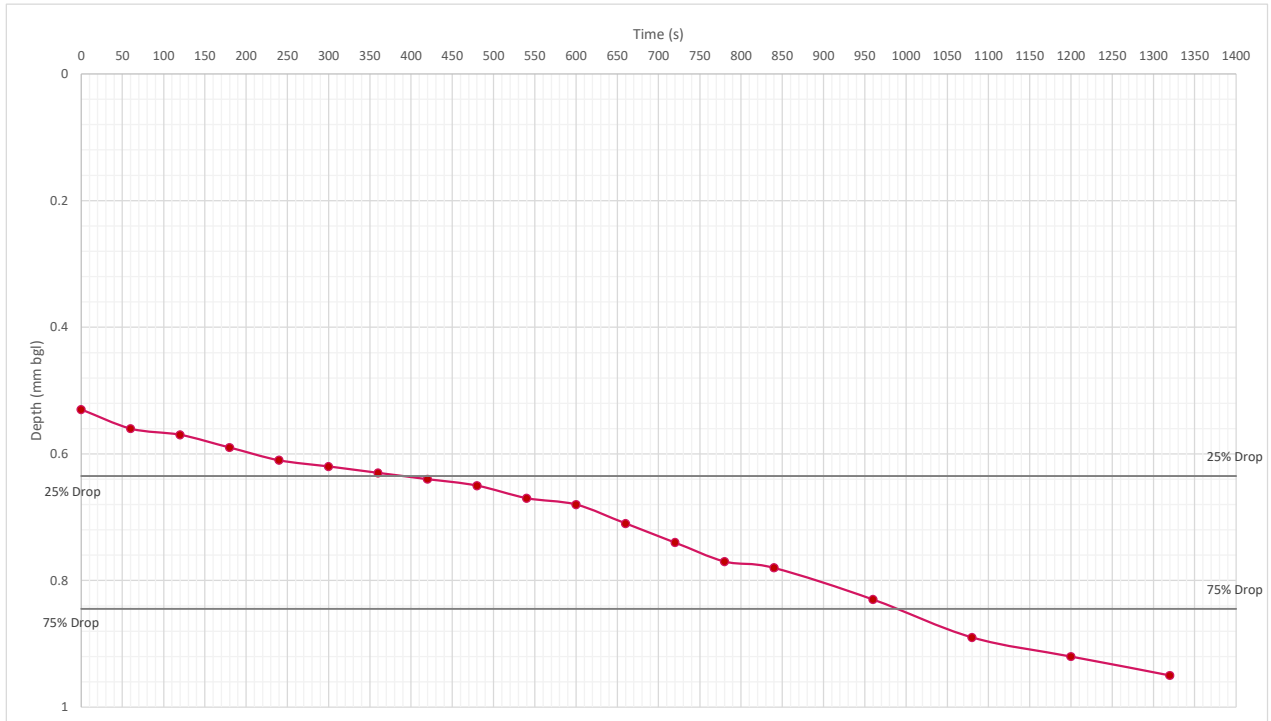

Note 1: Pit backfilled with arisings.

CALCULATION SHEET - SOIL INFILTRATION RATE

Project: West Cumberland Hospital
Job Number: 73039
Author: ZH

Hole Ref.: SA01
Test Date: 03/08/2021
Test No.: 2 of 3

2.50 m	Length of trial pit
0.90 m	Width of trial pit
0.95 m	Depth (total) of trial pit
2.25 m ²	Area of trial pit base
0.53 m bgl	Water level at start of test (approximate invert level)
0.90 m bgl	Water level at end of test
0.420 m	Effective storage depth
0.635 m bgl	Effective storage depth (75% full)
0.845 m bgl	Effective storage depth (25% full)
0.473 m ³	Effective storage volume (V_{75-25})
3.678 m ²	Internal surface area (50% effective depth) (a_{50})
1250 s	Time for head to fall from 75% to 25% effective depth (t_{75-25})


1.03E-04 m/s **Soil infiltration rate (f)**

RAW DATA

Project: West Cumberland Hospital
Job Number: 73039
Author: ZH

Hole Ref.: SA01
Test Date: 03/08/2021
Test No.: 2 of 3

c	Time (min)	u	Time (s)	Depth (mm bgl)	Stratum
	0		0	0.53	Grey medium to coarse grained crystalline SANDSTONE
	1		60	0.55	
	2		120	0.56	
	3		180	0.575	
	4		240	0.59	
	5		300	0.6	
	6		360	0.61	
	7		420	0.62	
	8		480	0.63	
	9		540	0.64	
	10		600	0.64	
	11		660	0.66	
	12		720	0.67	
	13		780	0.68	
	14		840	0.69	
	16		960	0.7	
	18		1080	0.73	
	20		1200	0.75	
	22		1320	0.77	
	24		1440	0.79	
	26		1560	0.81	
	28		1680	0.83	
	30		1800	0.85	
	32		1920	0.86	
	34		2040	0.87	
	36		2160	0.89	
	38		2280	0.9	

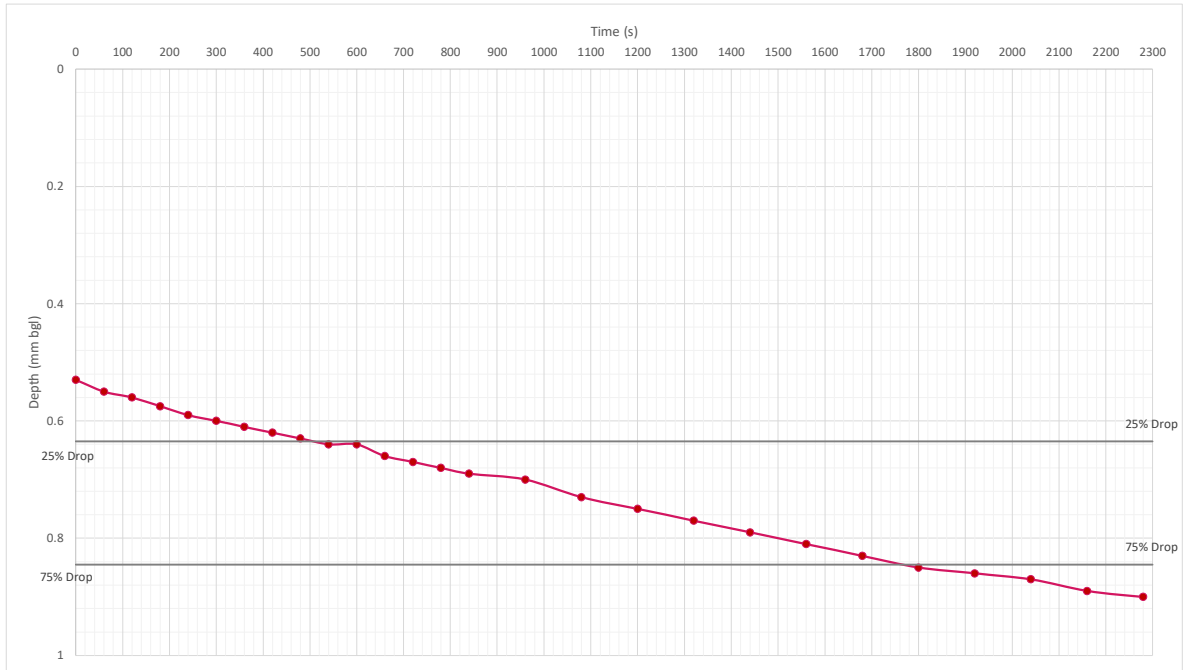

Note 1: Pit backfilled with arisings.

CALCULATION SHEET - SOIL INFILTRATION RATE

Project: West Cumberland Hospital
Job Number: 73039
Author: ZH

Hole Ref.: SA01
Test Date: 03/08/2021
Test No.: 3 of 3

2.50 m	Length of trial pit
0.90 m	Width of trial pit
0.95 m	Depth (total) of trial pit
2.25 m ²	Area of trial pit base
0.50 m bgl	Water level at start of test (approximate invert level)
0.90 m bgl	Water level at end of test
0.450 m	Effective storage depth
0.613 m bgl	Effective storage depth (75% full)
0.838 m bgl	Effective storage depth (25% full)
0.506 m³	Effective storage volume (V_{75-25})
3.780 m²	Internal surface area (50% effective depth) (a_{50})
1900 s	Time for head to fall from 75% to 25% effective depth (t_{75-25})


7.05E-05 m/s **Soil infiltration rate (f)**

RAW DATA

Project: West Cumberland Hospital
Job Number: 73039
Author: ZH

Hole Ref.: SA01
Test Date: 03/08/2021
Test No.: 3 of 3

c	Time (min)	u _i	Time (s)	Depth (mm bgl)	Stratum
	0		0	0.5	Grey medium to coarse grain crystalline SANDSTONE
	1		60	0.51	
	2		120	0.52	
	3		180	0.52	
	4		240	0.52	
	5		300	0.53	
	6		360	0.54	
	7		420	0.55	
	8		480	0.56	
	9		540	0.57	
	10		600	0.58	
	11		660	0.59	
	12		720	0.6	
	13		780	0.61	
	14		840	0.61	
	16		960	0.63	
	18		1080	0.64	
	20		1200	0.66	
	22		1320	0.67	
	24		1440	0.69	
	26		1560	0.7	
	28		1680	0.72	
	30		1800	0.72	
	32		1920	0.74	
	34		2040	0.76	
	36		2160	0.77	
	38		2280	0.78	
	40		2400	0.79	
	42		2520	0.81	
	44		2640	0.82	
	46		2760	0.84	
	48		2880	0.85	
	50		3000	0.87	
	52		3120	0.88	
	54		3240	0.89	
	56		3360	0.9	

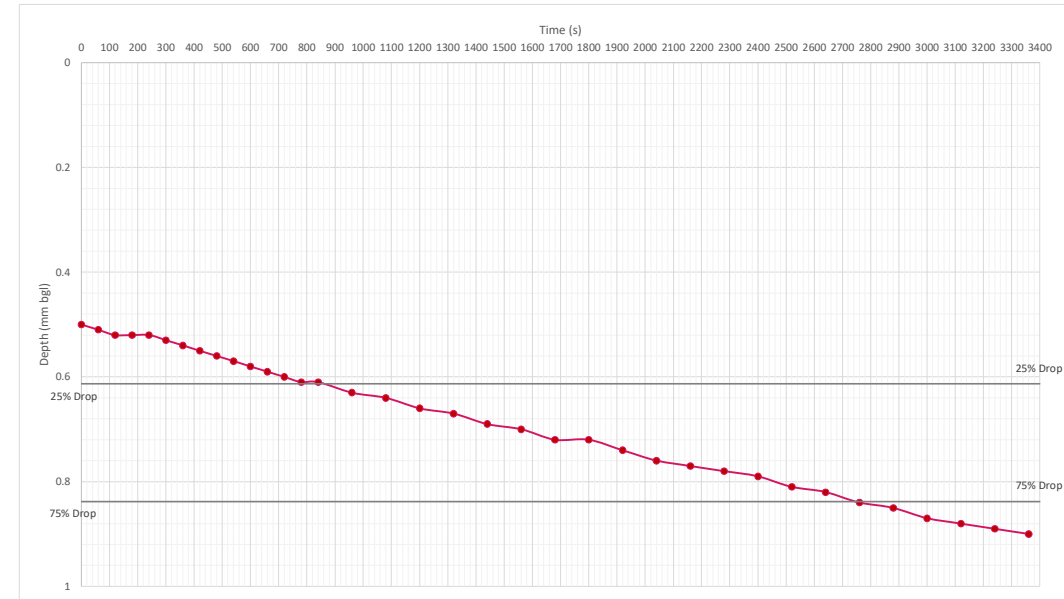

Note 1: Pit backfilled with arisings.

CALCULATION SHEET - SOIL INFILTRATION RATE

Project: West Cumberland Hospital
Job Number: 73039
Author: ZH

Hole Ref.: SA02
Test Date: 03/08/2021
Test No.: 1 of 1

2.20 m	Length of trial pit
0.90 m	Width of trial pit
1.65 m	Depth (total) of trial pit
1.98 m ²	Area of trial pit base
1.16 m bgl	Water level at start of test (approximate invert level)
1.16 m bgl	Water level at end of test
0.490 m	Effective storage depth
1.283 m bgl	Effective storage depth (75% full)
1.528 m bgl	Effective storage depth (25% full)
0.485 m ³	Effective storage volume (V_{75-25})
3.499 m ²	Internal surface area (50% effective depth) (A_{50})
N/A s	Time for head to fall from 75% to 25% effective depth (t_{75-25})

N/A m/s Soil infiltration rate (f)


RAW DATA

Project: West Cumberland Hospital
Job Number: 73039
Author: ZH

Hole Ref.: SA02
Test Date: 03/08/2021
Test No.: 1 of 1

c	Time (min)	u	Time (s)	Depth (mm bgl)	Stratum
	0		0	1.16	
	1		60	1.16	
	2		120	1.16	
	3		180	1.16	
	4		240	1.16	
	5		300	1.16	
	6		360	1.16	
	7		420	1.16	
	8		480	1.16	
	9		540	1.16	
	10		600	1.16	
	11		660	1.16	
	12		720	1.16	
	13		780	1.16	
	14		840	1.16	
	16		960	1.16	
	18		1080	1.16	
	20		1200	1.16	
	22		1320	1.16	
	24		1440	1.16	
	26		1560	1.16	
	28		1680	1.16	
	30		1800	1.16	
	32		1920	1.16	
	34		2040	1.16	
	36		2160	1.16	
	38		2280	1.16	
	40		2400	1.16	
	42		2520	1.16	
	44		2640	1.16	
	46		2760	1.16	
	48		2880	1.16	
	50		3000	1.16	
	52		3120	1.16	
	54		3240	1.16	
	56		3360	1.16	
	58		3480	1.16	
	60		3600	1.16	
	62		3720	1.16	
	64		3840	1.16	
	66		3960	1.16	
	68		4080	1.16	
	70		4200	1.16	
	72		4320	1.16	
	74		4440	1.16	
	76		4560	1.16	
	78		4680	1.16	
	80		4800	1.16	
	82		4920	1.16	
	84		5040	1.16	
	86		5160	1.16	
	88		5280	1.16	
	90		5400	1.16	
	92		5520	1.16	
	94		5640	1.16	
	96		5760	1.16	
	98		5880	1.16	
	100		6000	1.16	
	102		6120	1.16	
	104		6240	1.16	

Light brown and grey weathered SANDSTONE, recovered as a sandy slightly clayey gravel of angular to subrounded sandstone.

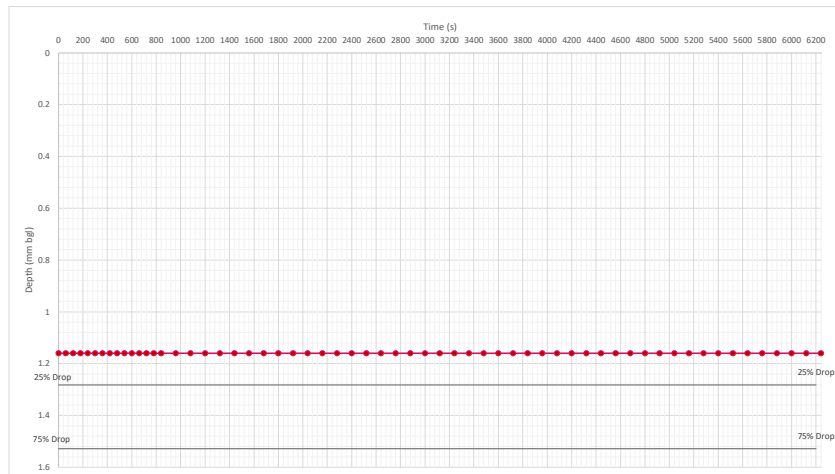

Note 1: Negligible infiltration, infiltration rate could not be calculated. Pit backfilled with arisings.

CALCULATION SHEET - SOIL INFILTRATION RATE

Project: West Cumberland Hospital
Job Number: 73039
Author: ZH

Hole Ref.: SA03
Test Date: 03/08/2021
Test No.: 1 of 1

2.80 m Length of trial pit
 1.00 m Width of trial pit
 1.40 m Depth (total) of trial pit
 2.80 m² Area of trial pit base
 1.07 m bgl Water level at start of test (approximate invert level)
 1.11 m bgl Water level at end of test

0.330 m Effective storage depth
 1.153 m bgl Effective storage depth (75% full)
 1.318 m bgl Effective storage depth (25% full)

0.462 m³ Effective storage volume (V_{75-25})
4.054 m² Internal surface area (50% effective depth) (a_{50})
N/A s Time for head to fall from 75% to 25% effective depth (t_{75-25})


N/A m/s Soil infiltration rate (f)

RAW DATA

Project: West Cumberland Hospital
Job Number: 73039
Author: ZH

Hole Ref.: SA03
Test Date: 03/08/2021
Test No.: 1 of 1

c	Time (min)	u	Time (s)	Depth (mm bgl)	Stratum
	0		0	1.07	Light brown and grey weathered SANDSTONE, recovered as a sandy slightly clayey gravel of angular to subrounded sandstone.
	1		60	1.07	
	2		120	1.075	
	3		180	1.08	
	4		240	1.08	
	5		300	1.08	
	6		360	1.08	
	7		420	1.08	
	8		480	1.08	
	9		540	1.08	
	10		600	1.08	
	11		660	1.08	
	12		720	1.08	
	13		780	1.08	
	14		840	1.08	
	16		960	1.08	
	18		1080	1.08	
	20		1200	1.085	
	22		1320	1.09	
	24		1440	1.09	
	26		1560	1.09	
	28		1680	1.09	
	30		1800	1.09	
	35		2100	1.09	
	40		2400	1.09	
	45		2700	1.09	
	50		3000	1.09	
	55		3300	1.1	
	60		3600	1.1	
	65		3900	1.1	
	70		4200	1.1	
	75		4500	1.1	
	80		4800	1.1	
	85		5100	1.11	
	90		5400	1.11	
	95		5700	1.11	
	100		6000	1.11	
	105		6300	1.11	
	110		6600	1.11	
	115		6900	1.11	
	120		7200	1.11	

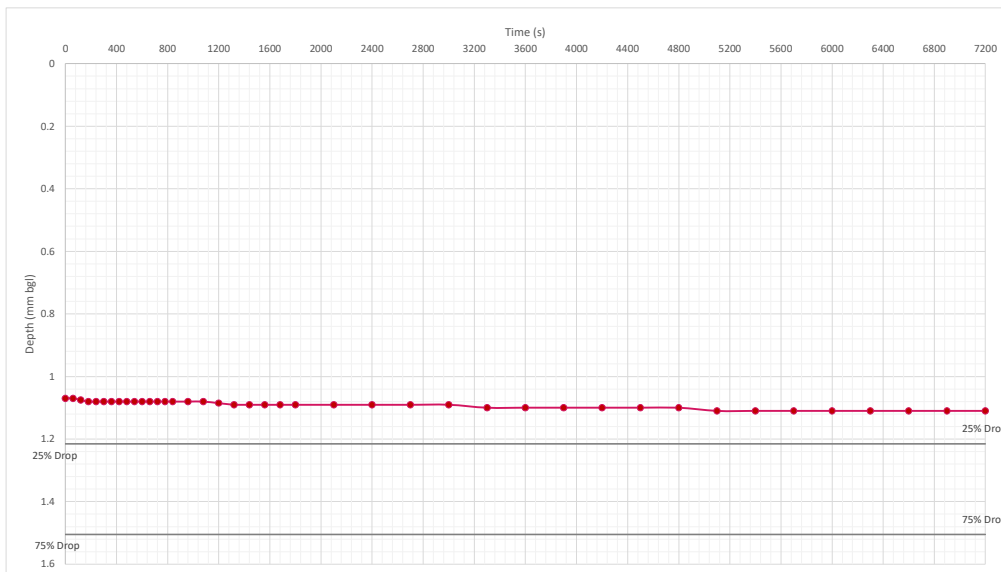

Note 1: Negligible infiltration, infiltration rate could not be calculated. Pit backfilled with arisings.

Appendix H - Risk Assessment Methodology

The site-specific risk assessment, presented in this report, follows the principle of establishing whether there is a viable linkage between a contaminant source to a potential receptor, via an exposure pathway.

The risk assessment corresponds with the total site area and incorporates both descriptive (qualitative) and, where available, numerical (quantitative) lines of evidence.

Risk assessment is the process of collating known information on a hazard or set of hazards to estimate actual or potential risk to receptors. The receptor may be humans, a water resource, a sensitive local ecosystem or future construction materials. Receptors can be connected to the source by one or several exposure pathways such as direct contact for example. Risks are generally managed by isolating the receptor or intercepting the exposure pathway or by isolating or removing the hazard.

Without the three essential components of a source, pathway and receptor there can be no risk. Therefore, the presence of contaminant source on a site does not necessarily mean there is a risk.

The risk assessment considers the likelihood of an event taking place (accounting for the presence of the source and receptor and the viability of the exposure pathway) in conjunction with the severity of the potential consequence (accounting for the potential severity of the hazard and the sensitivity of the receptor).

In the risk assessment, the consequence of the hazard has been classified as severe or medium or mild or minor and the probability (likelihood) of the circumstances occurring classified as high likelihood or likely or low likelihood or unlikely.

The consequences and probabilities are subsequently cross-correlated to give a qualitative estimation of the risk using Department of the Environment risk classifications as detailed in the table below and as referenced in CIRIA C552.

		Consequence			
		Severe	Medium	Mild	Minor
Probability (Likelihood)	High Likelihood	Very High Risk	High Risk	Moderate Risk	Moderate/Low Risk
	Likely	High Risk	Moderate Risk	Moderate/Low Risk	Low Risk
	Low Likelihood	Moderate Risk	Moderate/Low Risk	Low Risk	Very Low Risk
	Unlikely	Moderate/Low Risk	Low Risk	Very Low Risk	Very Low Risk

Ground Investigation Report

In accordance with DoE guidance, the following categorisation of **consequence** has been developed.

Classification	Definition	Examples
Severe	Short-term (acute) risk to human health likely to result in "significant harm" as defined by the Environment Protection Act 1990, Part IIA. Short-term risk of pollution of sensitive water resource. Catastrophic damage to buildings/property. A short-term risk to an ecosystem or organisation forming part of such ecosystem.	<p>High concentrations of cyanide on the surface of an informal recreation area.</p> <p>Major spillage of contaminants from site into controlled water.</p> <p>Explosion, causing building collapse (can also equate to a short-term human health risk if buildings are occupied).</p>
Medium	Chronic damage to Human Health. Pollution of sensitive water resources. A significant change in an ecosystem or organism forming part of such ecosystem.	<p>Concentration of a contaminant from site exceeds the generic or site-specific assessment criteria.</p> <p>Leaching of contaminants from a site to a Principal or Secondary A aquifer.</p> <p>Death of a species within a designated nature reserve.</p> <p>Lesser toxic and asphyxiate effects</p>
Mild	Pollution of non-sensitive water resources. Significant damage to crops, buildings, structures and services. Damage to sensitive buildings/structures/services or the environment.	<p>Pollution of non-classified groundwater (inc. Secondary B aquifers).</p> <p>Damage to building rendering it unsafe to occupy (e.g. foundation damage resulting in instability).</p>
Minor	Harm, although not necessarily significant harm, which may result in a financial loss or expenditure to resolve. Non-permanent health effects to human health (easily prevented by means such as personal protective clothing, etc). Easily repairable effects of damage to buildings, structures and services.	<p>The presence of contaminants at such concentrations that protective equipment is required during site works.</p> <p>The loss of plants in a landscaping scheme.</p> <p>Discoloration of concrete.</p>

Ground Investigation Report

In accordance with DoE guidance, the following categorisation of **probability** has been developed.

Classification	Definition
High Likelihood	There is a pollution linkage and an event that either appears very likely in the short term and almost inevitable over the long term or there is evidence at the receptor of harm or pollution.
Likely	There is a pollution linkage and all the elements are present and in the right place, which means that it is probable that an event will occur. Circumstances are such that an event is not inevitable, but possible in the short term and likely over the long term.
Low Likelihood	There is a pollution linkage and circumstances are possible under which an event could occur. However, it is by no means certain that even over a longer period such event would take place, and is less likely in the shorter term.
Unlikely	There is a pollution linkage but circumstances are such that it is improbable that an event would occur even in the very long term.

In accordance with DoE guidance, the following categorisation of **risk** has been developed.

Classification	Definition
Very High Risk	There is a <i>high probability</i> that <i>severe harm</i> could arise to a designated receptor from an identified hazard at the site without appropriate further action.
High Risk	<i>Harm is likely to arise</i> to a designated receptor from an identified hazard at the site without appropriate further action.
Moderate Risk	<i>It is possible</i> that without appropriate further action <i>harm could arise</i> to a designated receptor. It is relatively <i>unlikely</i> that any such harm would be <i>severe</i> , and if any harm were to occur it is <i>more likely</i> that such harm would be <i>relatively mild</i> .
Low Risk	<i>It is possible</i> that <i>harm could arise</i> to a designated receptor from an identified hazard. It is <i>likely</i> that, at worst, if any harm was realised any effects would be <i>mild</i> .
Very Low Risk	The presence of an identified hazard does not give rise to the potential to cause harm to a designated receptor.

The term 'risk' in this instance refers to the risk that the source, pathway, receptor linkage for a given source of contamination is complete. It does not refer to immediate risk to individuals or features present on the site from potential contaminants and is intended to be used as a tool to assess the necessity of further investigation.

Our Locations

Birmingham

2 The Wharf
Bridge Street
Birmingham
B1 2JS
T. 0121 643 4694
birmingham@curtins.com

Bristol

Quayside
40-58 Hotwell Road
Bristol
BS8 4UQ
T. 0117 302 7560
bristol@curtins.com

Cambridge

50 Cambridge Place
Cambridge
CB2 1NS
T. 01223 631 799
cambridge@curtins.com

Cardiff

3 Cwrt-y-Parc
Earlswood Road
Cardiff
CF14 5GH
T. 029 2068 0900
cardiff@curtins.com

Douglas

Varley House
29-31 Duke Street
Douglas
Isle of Man
IM1 2AZ
T. 01624 624 585
douglas@curtins.com

Dublin

39 Fitzwilliam Square
Dublin 2
Ireland
T. 00353 1 507 9447
dublin@curtins.com

Edinburgh

1a Belford Road
Edinburgh
EH4 3BL
T. 0131 225 2175
edinburgh@curtins.com

Glasgow

Queens House
29 St Vincent Place
Glasgow
G1 2DT
T. 0141 319 8777
glasgow@curtins.com

Kendal

28 Lowther Street
Kendal
Cumbria
LA9 4DH
T. 01539 724 823
kendal@curtins.com

Leeds

Rose Wharf
Ground Floor
Leeds
L29 8EE
T. 0113 274 8509
leeds@curtins.com

Liverpool

51-55 Tithebarn Street
Liverpool
L2 2SB
T. 0151 726 2000
liverpool@curtins.com

London

40 Compton Street
London
EC1V 0BD
T. 020 7324 2240
london@curtins.com

Manchester

Merchant Exchange
17-19 Whitworth Street West
Manchester
M1 5WG
T. 0161 236 2394
manchester@curtins.com

Nottingham

56 The Ropewalk
Nottingham
NG1 5DW
T. 0115 941 5551
nottingham@curtins.com