


DO NOT SCALE

NOTES

1. LIGHTING LEVELS REQUIRED ARE IN ACCORDANCE WITH CIBSE LG2 AND SSL LIGHTING GUIDE 6.
2. EXACT CONTROL METHODOLOGY TO BE AGREED
3. GENERALLY ALL EXTERNAL LIGHTING WILL BE CONTROLLED BY SOLAR DIAL TIMELOCK / ASTROTIMER, PHOTOCCELL AND MOVEMENT SENSING.
4. ALL TO PROVIDE TIMELOCKS AT EACH ORIGIN OF SUPPLY. (PROVISIONALLY 4No. TIMELOCKS TO BE ALLOWED)
5. ALLOWANCE TO BE MADE FOR A FEEDER PILLAR FOR CARPARK LIGHTING DISTRIBUTION BOARD AND CONTROLS
6. ALL EXTERNAL LIGHTING, BRACKETS AND COLUMNS TO BE FINISHED SUITABLE FOR USE IN A COASTAL CORROSIVE ENVIRONMENT.

ISOLINES

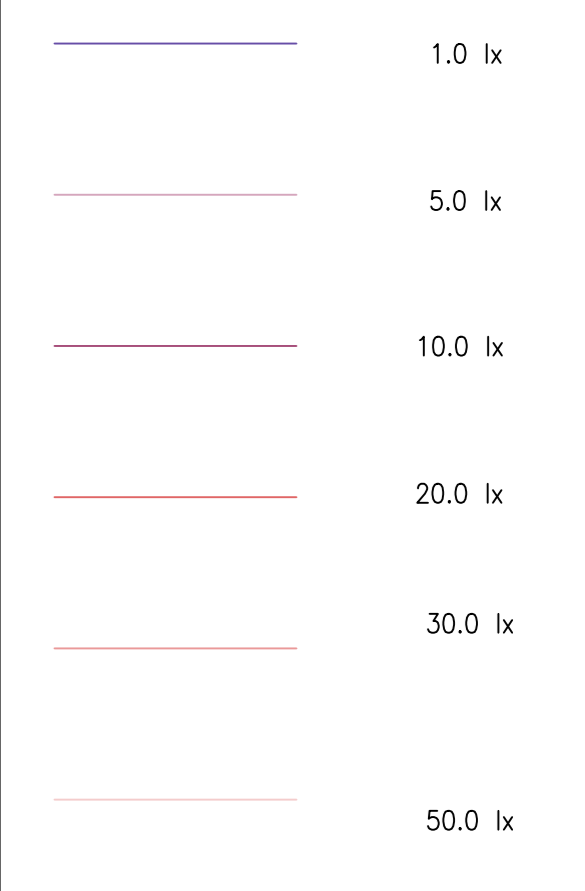

P1	MAR 22	BH	ISSUED FOR STAGE 4, INCORPORATED CHANGES TO GROUND WORKS AND LANDSCAPING LAYOUTS
PO	JUN 21	MP	FIRST ISSUE
REV	DATE	BY	DESCRIPTION

DRAWING STATUS

STAGE 4 ISSUE

SAFETY, HEALTH AND ENVIRONMENTAL INFORMATION

RECORDS OF THIS DRAWING
ALL EFFORTS HAVE BEEN TAKEN BY DSSR TO DESIGN OUT SIGNIFICANT HAZARDS WITHIN THE DESIGN RISK ASSESSMENT PROCESS. IT IS OUR OPINION THAT THE HAZARDS DETAILLED BELOW CANNOT BE DESIGNED OUT BY US GIVEN THE CONSTRAINTS OF THE BRIEF AND ARE HIGHLIGHTED SO THAT OTHER MAKERS CAN BE DEVELOPED TO MITIGATE THE RESIDUAL RISKS IDENTIFIED. MORE DETAIL AVAILABLE IN THE PROJECT SPECIFIC RISK REGISTER.

IT IS ASSUMED THAT A COMPETENT MAIN CONTRACTOR OR USER WILL BE AWARE OF THE STANDARD FORESEEABLE RISKS ASSOCIATED WITH WORKING WITH THE TYPE OF SERVICES DETAILED ON THIS DRAWING.

DSSR | CONSULTING ENGINEERS
Glasgow Harrogate London Manchester

Manchester Office
Trafford House
Chester Road
Stretford
Manchester
M32 0PS
Tel: +44 (0)161 872 4811
manchester@dssr.co.uk
www.dssr.co.uk

ARCHITECT

GRAHAM **PROCURE**

PROJECT
West Cumberland Hospital Phase 2

TITLE
EXTERNAL LIGHTING
LUX LEVEL PLOT
NEW BUILT
SHEET 2 OF 2

Drawn	MP	Check	JUN 21	Design	SR	Issue	JUN 21	
Scale	MP	Scale	JUN 21	Scale	AD	Scale	1:250	
CDW File	WCHPH2-DSSR-V7-SL-DR-E-90005-6.dwg							
Drawing No.	WCHPH2-DSSR-V7-SL-DR-E-90006						REV	P1