


- NOTES**
1. LIGHTING LEVELS REQUIRED ARE IN ACCORDANCE WITH CIBSE LG2 AND SSL LIGHTING GUIDE 01
  2. EXACT CONTROL METHODOLOGY TO BE DETERMINED AT A LATER DATE
  3. ORIGINALLY ALL SYSTEM LIGHTING WERE BEING CONTROLLED BY SOLAR DAY TIMECLOCK / ASTRONOMER, PHOTOCELL AND MOVEMENT SENSING.
  4. ALL TO PROVIDE TIMECLOCKS AT EACH ORIGIN OF SUPPLY, (PROVISIONALLY 40m TIMECLOCKS TO BE ALLOWED)
  5. ALLOWANCE TO BE MADE FOR A FEEDER PILLAR FOR CARPARK LIGHTING DISTRIBUTION BOARD AND CONTROLS
  6. ALL EXTERNAL LIGHTING, BRACKETS AND PILLARS TO BE PROVIDED FOR USE IN A CONSISTENT MANNER WITH THE EXISTING CARPARK ENVIRONMENT.

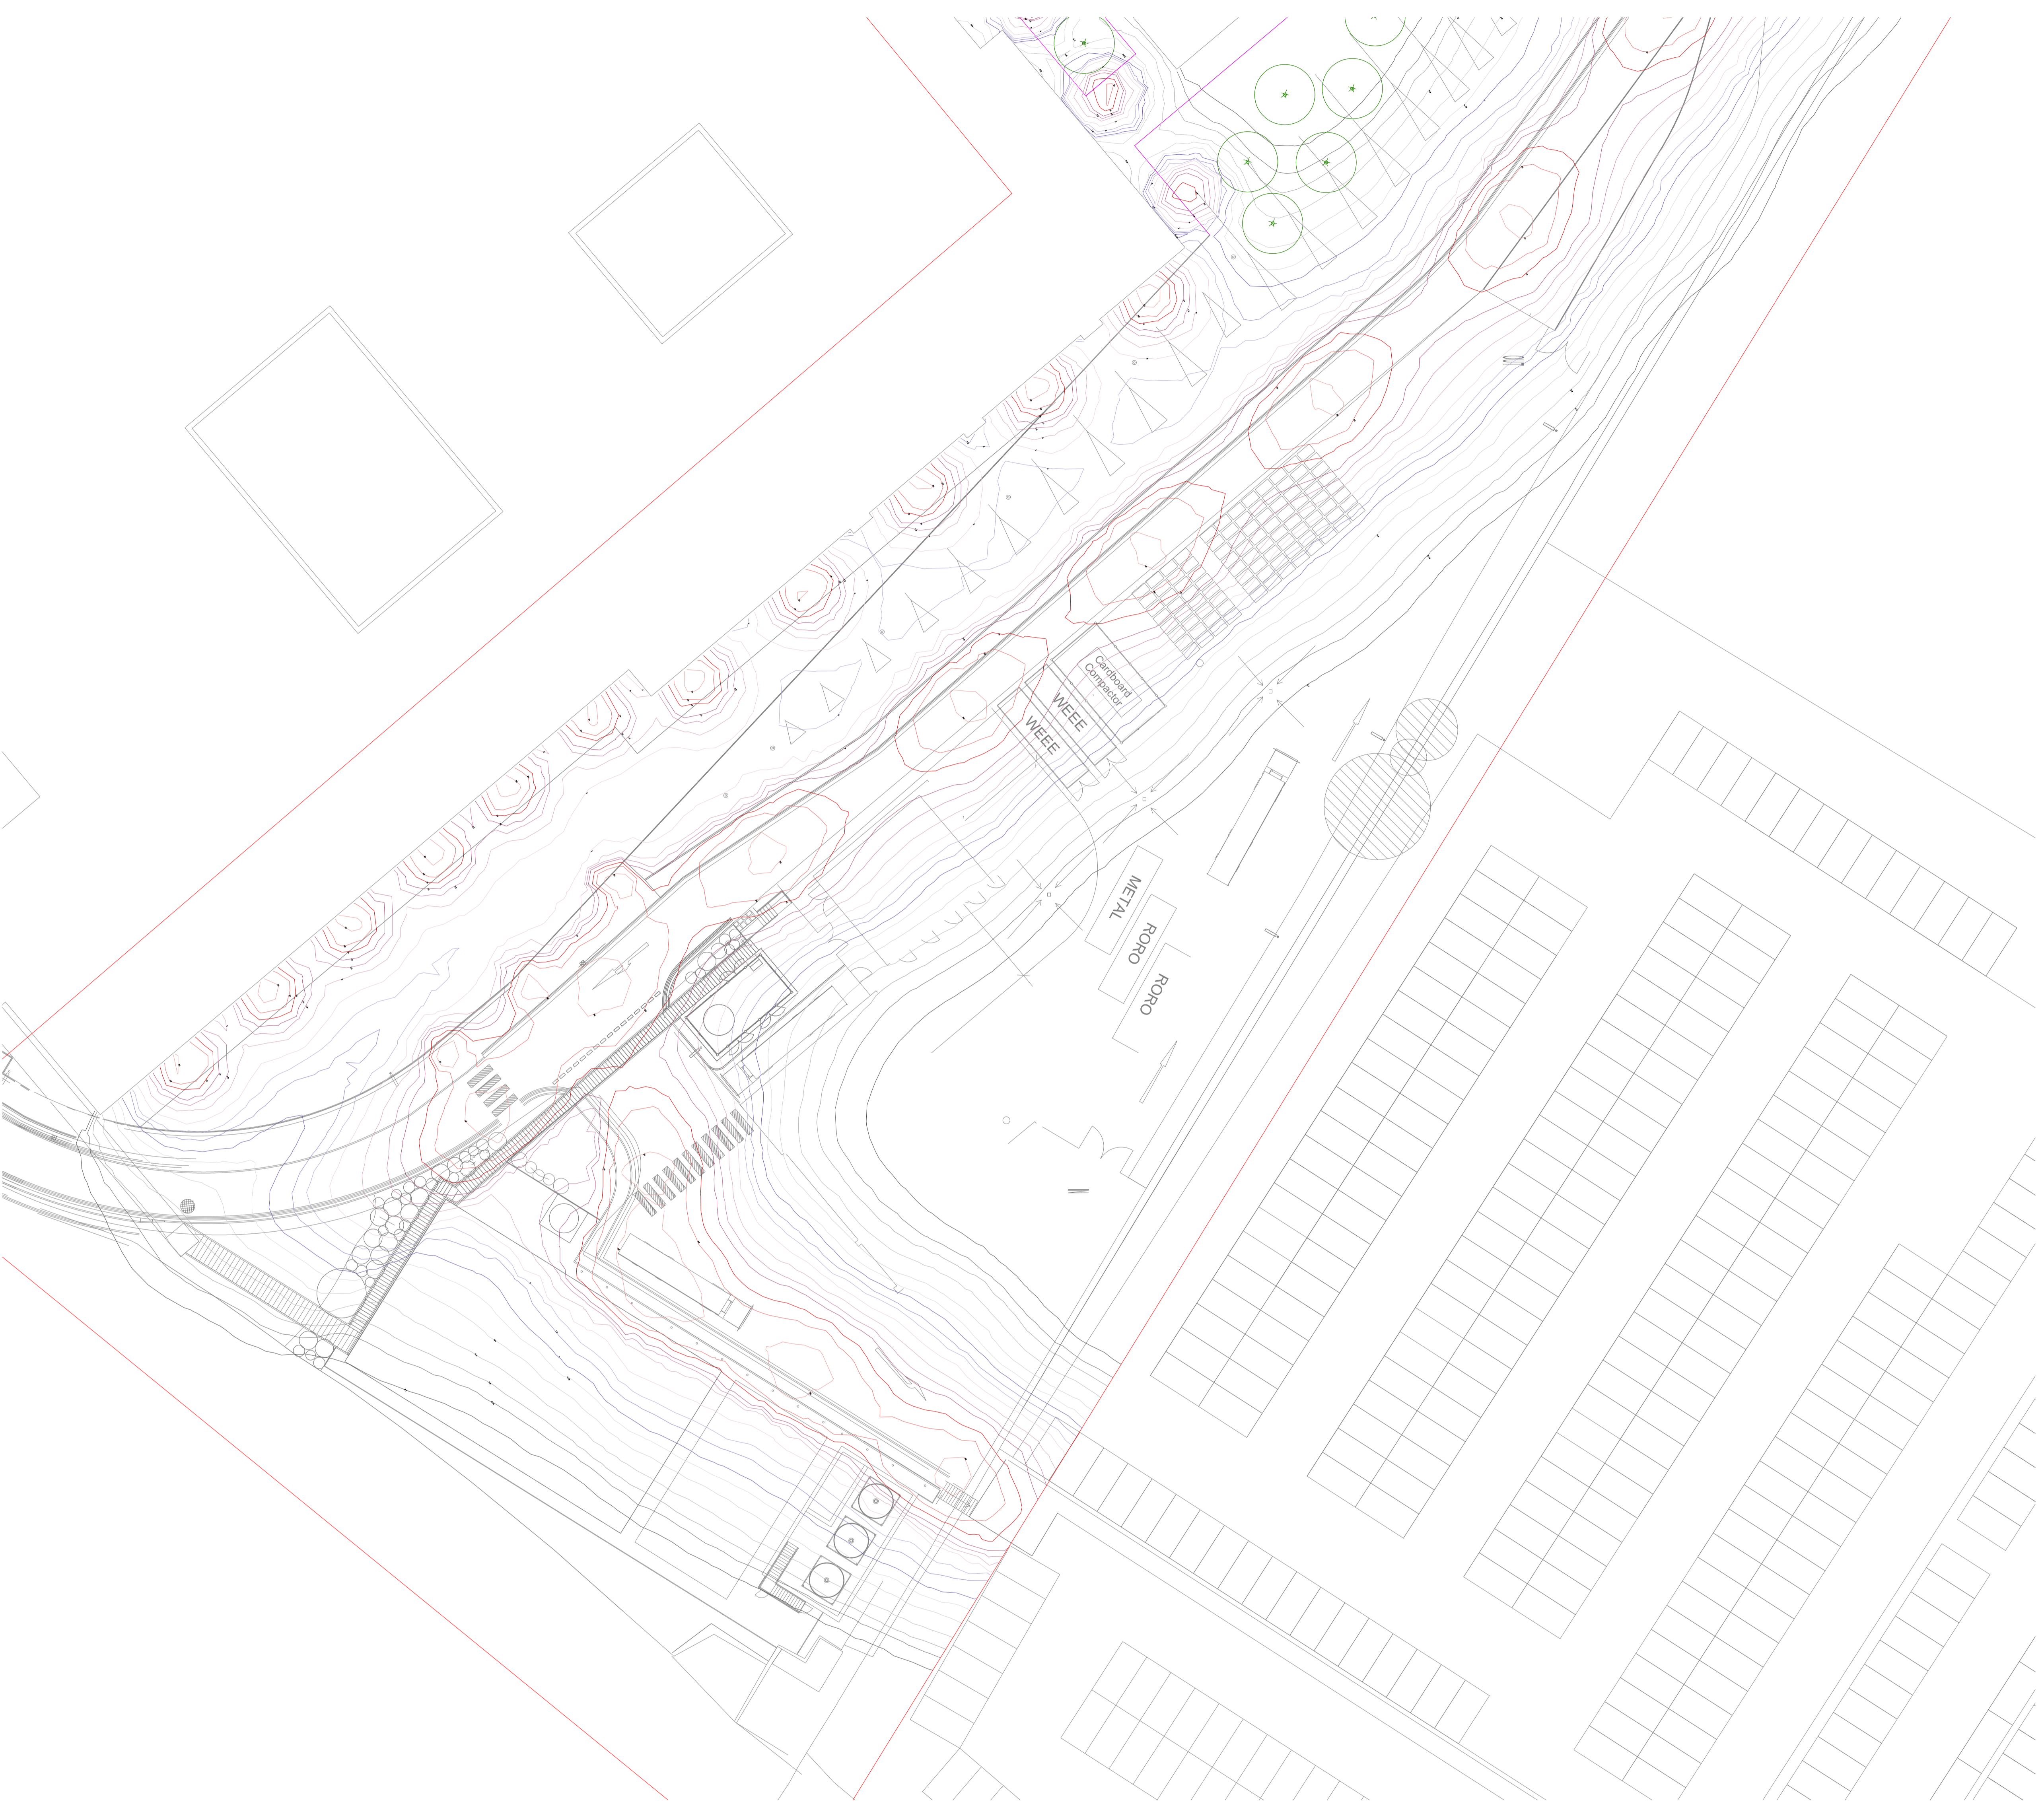

REV	DATE	BY	DESCRIPTION
001	JUN 22	MP	CONSTRUCTION ISSUE
P1	MAR 22	BH	ISSUED FOR CHECK & INTERPRETATION CHANGES TO GROUND WORKS AND LANDSCAPING LAYOUTS
PO	JUN 21	MP	FIRST ISSUE

**CONSTRUCTION**

**CONSTRUCTION**  
 ALL WORKS TO BE COMPLETED IN ACCORDANCE WITH THE CONSTRUCTION PROGRAMME AND THE CONSTRUCTION METHODOLOGY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE LOCAL AUTHORITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING SERVICES AND UTILITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING STRUCTURES AND UTILITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING SERVICES AND UTILITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING STRUCTURES AND UTILITIES.

IF RISK OF THE CONTRACTOR BEING CONSIDERED TO BE AVOIDABLE, THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING SERVICES AND UTILITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING STRUCTURES AND UTILITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING SERVICES AND UTILITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING STRUCTURES AND UTILITIES.

**DSSR CONSULTING ENGINEERS**  
 Group: Strategic Urban Movement  
 14, 44, 01811 871 811  
 info@dssr.co.uk  
 www.dssr.co.uk

**GRAHAM PROCURE**

**PROJECT**  
 West Cumberland Hospital Phase 2

**TITLE**  
 EXTERNAL LIGHTING LUX LEVEL PLOT NEW BUILT SHEET 2 OF 2